



APRIL 2024

MONTHLY CONSTRUCTION WATER QUALITY MONITORING REPORT

April 2024
Project No: 3200-0645
Project: Transgrid Maragle 500/330 kV Substation
Private & Confidential

CONTENTS

| | | |
|--------|--------------------------------------|----|
| 1. | BACKGROUND | 8 |
| 2. | INTRODUCTION | 9 |
| 3. | METHODOLOGY | 11 |
| 4. | BASELINE WATER QUALITY | 17 |
| 4.1. | Water Quality Objectives | 17 |
| 4.2. | Site Specific Guideline Values | 17 |
| 5. | APRIL 2024 MONITORING | 18 |
| 5.1. | Observations | 18 |
| 5.2. | Results | 23 |
| 5.2.1. | Key Physical and Chemical Parameters | 23 |
| 5.2.2. | Dissolved Metals | 36 |
| 5.2.3. | Total Metals | 37 |
| 5.3. | Discussion | 37 |
| 6. | CONCLUSION | 39 |
| | REFERENCES | 40 |

TABLES

| | |
|---|----|
| TABLE 1 WATER QUALITY MONITORING LOCATIONS OUTLINED IN THE METHODOLOGY (NGH, 2022) | 11 |
| TABLE 2 SEASONAL SSGV (NGH, 2024) AND DGV (ANZG, 2018) FOR WATER QUALITY PARAMETERS | 14 |
| TABLE 3 FIELD OBSERVATIONS DURING SAMPLING | 18 |
| TABLE 4: RESULTS FOR DISSOLVED METALS | 36 |
| TABLE 5: RESULTS FOR TOTAL METALS | 37 |

FIGURES

| | |
|---|----|
| FIGURE 1 LOCALITY OF THE PROJECT AND SWQ MONITORING LOCATIONS | 10 |
| FIGURE 2 WATER QUALITY MONITORING LOCATIONS ASSOCIATED WITH REFERENCE SITE YR-RS AND TR-RS IN RELATION TO THE PROJECT | 12 |
| FIGURE 3 WATER QUALITY MONITORING LOCATIONS ASSOCIATED WITH REFERENCE SITE WC-RS IN RELATION TO THE PROJECT..... | 13 |
| FIGURE 4 : TEMPERATURE FOR YARRANGOBILLY CATCHMENT..... | 24 |
| FIGURE 5: TEMPERATURE FOR TALBINGO RESERVOIR | 24 |
| FIGURE 6: TEMPERATURE FOR YORKERS CREEK CATCHMENT..... | 24 |
| FIGURE 7: PH FOR YARRANGOBILLY CATCHMENT | 25 |
| FIGURE 8: PH FOR TALBINGO RESERVOIR | 25 |
| FIGURE 9: PH FOR YORKERS CREEK CATCHMENT | 25 |
| FIGURE 10: DO FOR TALBINGO RESERVOIR..... | 26 |
| FIGURE 11: DO FOR YORKERS CREEK CATCHMENT..... | 26 |
| FIGURE 12: DO FOR YARRANGOBILLY CATCHMENT..... | 26 |
| FIGURE 13: SPC FOR YARRANGOBILLY CATCHMENT..... | 27 |
| FIGURE 14: SPC FOR TALBINGO RESERVOIR..... | 27 |
| FIGURE 15: SPC FOR YORKERS CREEK CATCHMENT | 27 |
| FIGURE 16: TURBIDITY FOR YARRANGOBILLY CATCHMENT..... | 28 |
| FIGURE 17: TURBIDITY FOR TALBINGO RESERVOIR..... | 28 |
| FIGURE 18: TURBIDITY FOR YORKERS CREEK CATCHMENT..... | 28 |
| FIGURE 19: TSS FOR YARRANGOBILLY CATCHMENT | 29 |
| FIGURE 20: TSS FOR TALBINGO RESERVOIR | 29 |
| FIGURE 21: TSS FOR YORKERS CREEK CATCHMENT | 29 |
| FIGURE 22: AMMONIA FOR YARRANGOBILLY CATCHMENT | 30 |
| FIGURE 23: AMMONIA FOR TALBINGO RESERVOIR | 30 |
| FIGURE 24: AMMONIA FOR YORKERS CREEK CATCHMENT | 30 |
| FIGURE 25: NITROGEN OXIDES FOR YARRANGOBILLY CATCHMENT..... | 31 |
| FIGURE 26: NITROGEN OXIDES FOR TALBINGO RESERVOIR..... | 31 |
| FIGURE 27: NITROGEN OXIDES FOR YORKERS CREEK CATCHMENT..... | 31 |
| FIGURE 28: TOTAL KJELDAHL NITROGEN FOR YARRANGOBILLY CATCHMENT | 32 |
| FIGURE 29: TOTAL KJELDAHL NITROGEN FOR TALBINGO RESERVOIR | 32 |
| FIGURE 30: TOTAL KJELDAHL NITROGEN FOR YORKERS CREEK CATCHMENT..... | 32 |
| FIGURE 31: TOTAL HARDNESS FOR YARRANGOBILLY CATCHMENT | 33 |
| FIGURE 32: TOTAL HARDNESS FOR TALBINGO RESERVOIR | 33 |
| FIGURE 33: TOTAL HARDNESS FOR YORKERS CREEK CATCHMENT | 33 |
| FIGURE 34: TOTAL NITROGEN FOR YARRANGOBILLY CATCHMENT | 34 |
| FIGURE 35: TOTAL NITROGEN FOR TALBINGO RESERVOIR | 34 |
| FIGURE 36: TOTAL NITROGEN FOR YORKERS CREEK CATCHMENT | 34 |
| FIGURE 37: TOTAL PHOSPHOROUS FOR YARRANGOBILLY CATCHMENT | 35 |
| FIGURE 38: TOTAL PHOSPHOROUS FOR TALBINGO RESERVOIR | 35 |
| FIGURE 39: TOTAL PHOSPHOROUS FOR YORKERS CREEK CATCHMENT | 35 |

APPENDICES

APPENDIX A: FIELD SHEET (UGL, 2024A)

APPENDIX B: COA (ALS, 2024A), QA/QC ASSESSMENT (ALS, 2024B), QCR (ALS, 2024C) AND COC (UGL, 2024B)

APPENDIX C: APRIL 2024 SWQ MONITORING RESULTS

APPENDIX D: CALIBRATION CERTIFICATE

ABBREVIATIONS

| Acronym | Full Form |
|-------------------|--|
| °C | degrees Celsius |
| µS/cm | micro Siemens per centimetre |
| % | percent |
| Ag | Silver |
| Al | Aluminium |
| ALS | ALS Limited |
| ANZECC | Australian and New Zealand Environment and Conservation Council |
| ANZG | Australian and New Zealand Guidelines |
| ARMCANZ | Agriculture and Resource Management Council of Australia and New Zealand |
| As | Arsenic |
| Baseline Report | 'Baseline Water Quality Report' (NGH, 2024) |
| CaCO ₃ | Total Hardness |
| Cd | Cadmium |
| COA | 'Certificate of Analysis' (ALS, 2024a) |
| COC | 'Chain of Custody' (UGL, 2024b) |
| Cr | Chromium |
| Cu | Copper |
| DGV | Default Guideline Values |
| DO | Dissolved Oxygen |
| EC | Electrical Conductivity |
| EIS | Environmental Impact Statement |
| EPL | Environmental Protection Licence |
| Fe | Iron |
| Field Sheet | 'Water Quality Monitoring Field Data Sheet' (UGL, 2024a) |
| Hg | Mercury |
| km | kilometres |
| KNP | Kosciuszko National Park |
| kV | kilovolt |
| mg/L | milligram per litre |
| Mn | Manganese |
| mV | millivolt |
| NATA | National Association of Testing Authorities, Australia |
| NEM | National Energy Market |
| NGH | NGH Pty Ltd |
| Ni | Nickel |

ABBREVIATIONS

| Acronym | Full Form |
|------------------|---|
| NSW | New South Wales |
| NTU | Nephelometric Turbidity Unit |
| Pb | Lead |
| ppm | parts per million |
| Pty Ltd | Proprietary Limited |
| QA/QC Assessment | 'QA/QC Compliance Assessment to assist with Quality Review' (ALS, 2024b) |
| QCR | 'Quality Control Report' (ALS, 2024c) |
| RS | Reference Site |
| Snowy 2.0 | Snowy Scheme expansion project (EPBC 2018/8322) |
| Snowy Hydro | Snowy Hydro Limited |
| Snowy Scheme | Snowy Mountains Hydro-electric Scheme |
| SPC | specific conductance |
| SSGV | Site Specific Guideline Values |
| SW | surface water |
| SWQ | surface water quality |
| TARP | 'Trigger Action Response Plan' (UGL, 2024c) |
| TDS | Total Dissolved Solids |
| The Methodology | 'Pre-construction Water Quality Monitoring Program and Methodology' (NGH, 2022) |
| The Project | Construction of a 330 kV substation and overhead transmission lines between Nurenmerenmong, NSW and Cabramurra, NSW |
| TKN | Total Kjeldahl Nitrogen |
| TN | Total Nitrogen |
| TP | Total Phosphorus |
| Transgrid | The Trustee for the NSW Electricity Operations Trust |
| TSS | Total Suspended Solids |
| UGL | UGL Limited |
| WQO | water quality objectives |
| Zn | Zinc |

1. BACKGROUND

In 2020 Snowy Hydro Limited (Snowy Hydro) obtained approval (EPBC 2018/8322) to expand the existing Snowy Mountains Hydro-electric Scheme (Snowy Scheme), by linking the existing Tantangara and Talbingo reservoirs through a series of underground tunnels and constructing a new underground hydro-electric power station (Snowy 2.0).

To connect Snowy 2.0 to the National Energy Market (NEM), a new transmission connection was required. The Trustee for the New South Wales (NSW) Electricity Operations Trust (TransGrid) is constructing a 330 kilovolt (kV) substation and overhead transmission lines (the Project) to facilitate the connection of Snowy 2.0 to the existing electrical transmission network. The Project is located within Kosciuszko National Park (KNP) between Nurenmerenmong and Cabramurra, NSW, approximately 27 kilometres (km) east of Tumbarumba, NSW (Figure 1). UGL Limited (UGL) has been engaged on behalf of Transgrid to undertake the Project.

2. INTRODUCTION

The Project is adjacent to, and forms part of, the Snowy 2.0 project area and is located within KNP, an area of high conservation value. A total of 22 mapped waterways, tributaries of Yarrangobilly River and Tumut River, transect the Project Boundary (Figure 1).

One of the conditions of approval to meet the requirements outlined in the 'Environmental Impact Statement' (EIS) (Jacobs, 2020) and the Project's Environmental Protection Licence (EPL 21753) is to undertake regular surface water quality (SWQ) monitoring to mitigate environmental impacts on SWQ.

Pre-construction SWQ monitoring was undertaken by NGH Pty Ltd (NGH) between March 2022 and February 2024 to determine site specific baseline values for SWQ parameters prior to Project construction works. The pre-construction SWQ monitoring was undertaken using the 'Pre-construction Water Quality Monitoring Program and Methodology' (the Methodology) developed by NGH in 2022 (refer Section 3). Two years of pre-construction SWQ monitoring was analysed and summarised in the 'Baseline Water Quality Report' (Baseline Report) (NGH, 2024). The results were used to determine seasonal Site Specific Guideline Values (SSGV) for ongoing SWQ monitoring during the construction phase.

Construction for the Project commenced in March 2024. Construction SWQ monitoring will be undertaken by UGL on a monthly basis as per the revised methodology outlined in Section 3 to identify potential changes to SWQ that may be associated with the Project. SW samples from the construction SWQ monitoring would be analysed and presented in monthly Construction Water Quality Monitoring Reports.

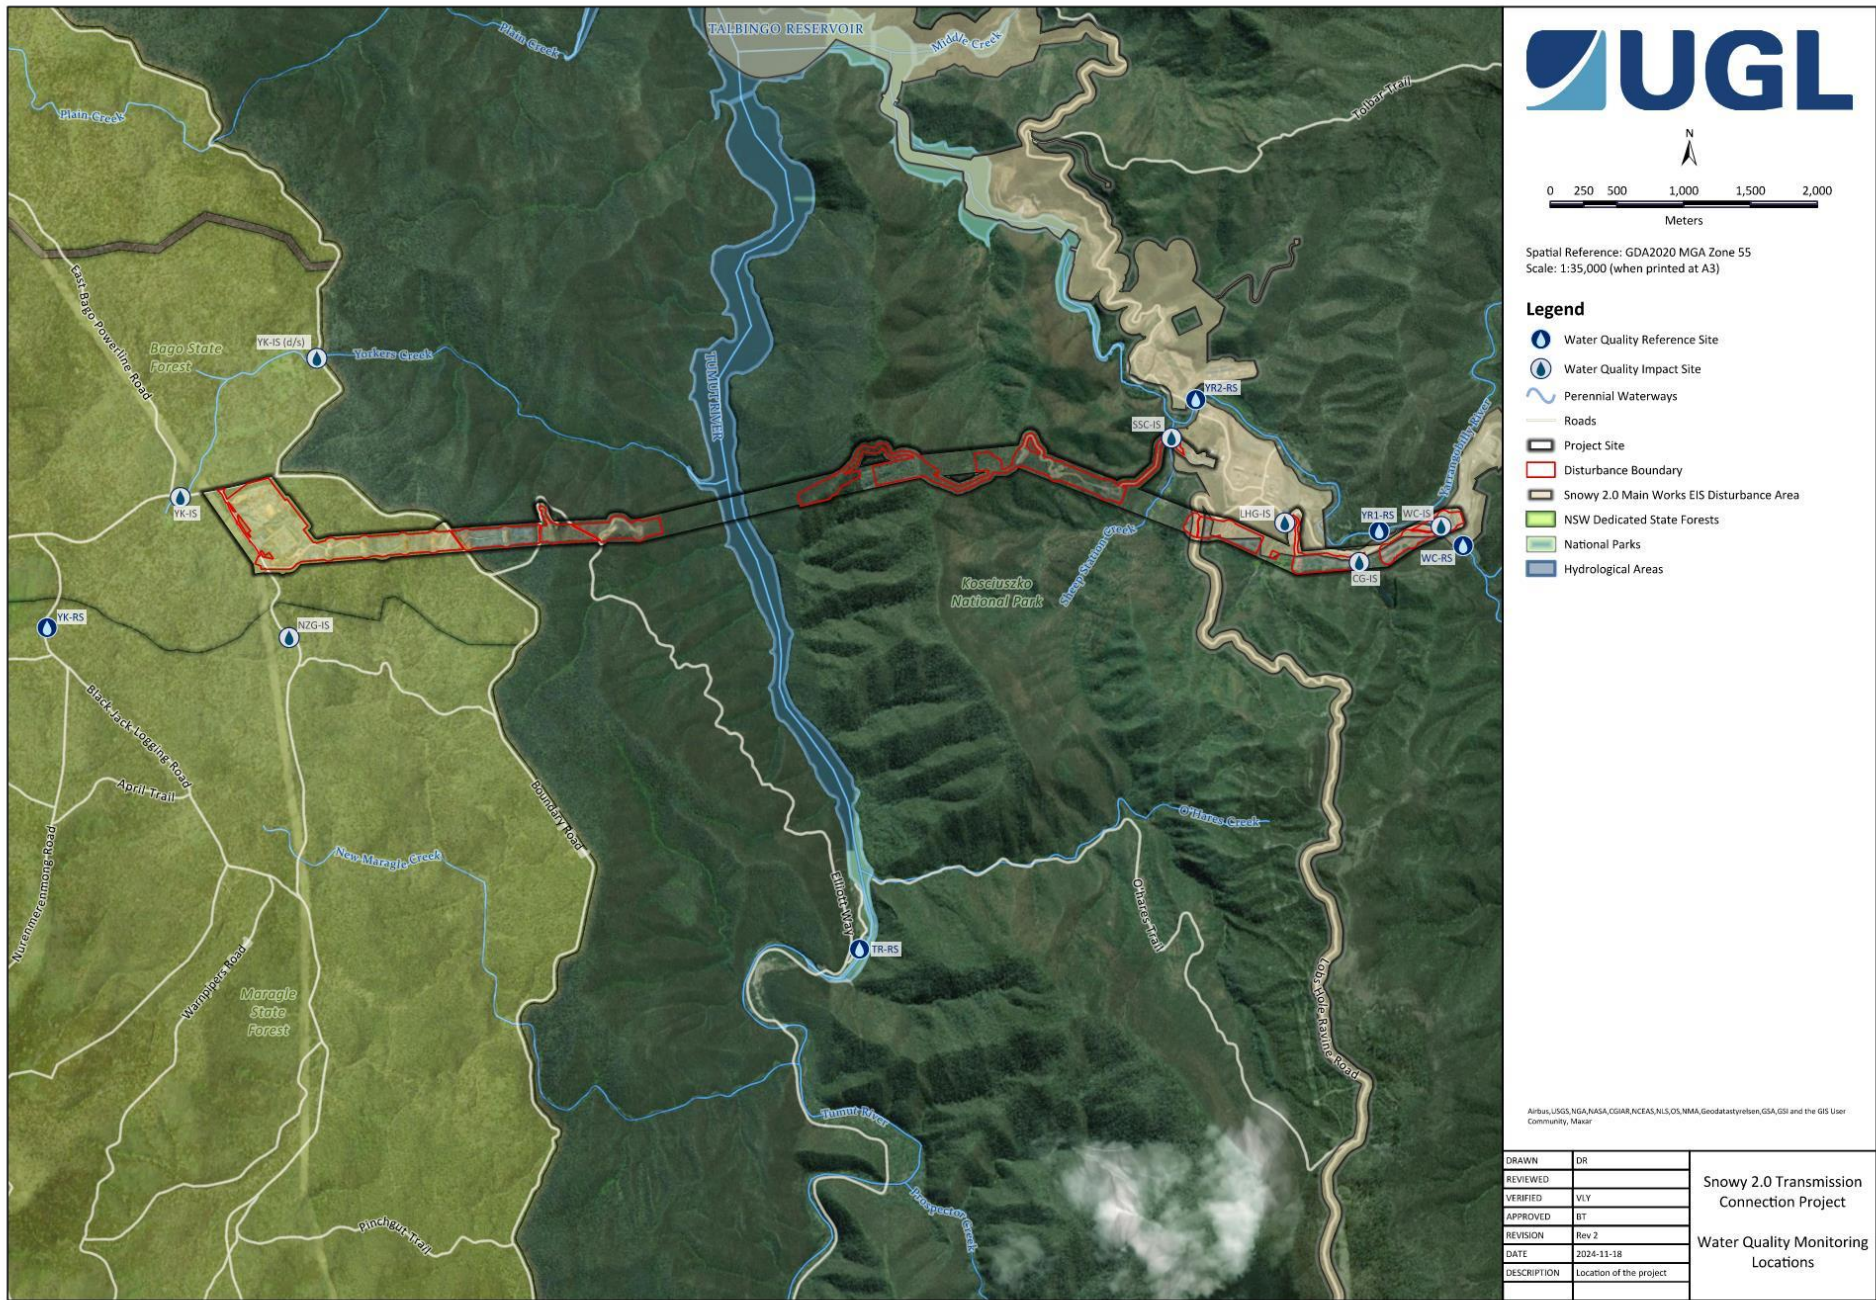


FIGURE 1 LOCALITY OF THE PROJECT AND SWQ MONITORING LOCATIONS

3. METHODOLOGY

The Methodology was prepared by NGH in 2022 to support the pre-construction SWQ monitoring for the Project. The Methodology detailed the water quality objectives (WQO) for the Project, identified the monitoring locations and outlined the methodology for surface water (SW) sampling during the pre-construction phase. The Methodology (NGH, 2022) took into account the Project location within an area of high conservation value where the WQO for physical and chemical stressors, as outlined in the ‘Australian and New Zealand Guidelines for Fresh and Marine Water Quality’ (ANZG) (ANZG, 2018), includes no change in biodiversity beyond natural variability and where possible, there should also be no change in water/sediment chemical and physical properties, including toxicants.

Monitoring locations are outlined in Table 1. Figure 2 and Figure 3 show the water quality monitoring locations in relation to the Project and Snowy 2.0.

The Methodology (NGH, 2022) has been revised for construction SWQ monitoring by taking into account the seasonal SSGV set out in the Baseline Report (NGH, 2024) (refer to Section 4.2).

Construction SWQ monitoring would be analysed against the seasonal SSGV where available and appropriate. The Default Guideline Values (DGV) for Upland Rivers (ANZG, 2018) would be applied to water quality parameters that were not assessed in the Baseline Report (NGH, 2024) or where a guideline range is more appropriate. Table 2 outlines the seasonal SSGV and DGV used to compare construction SWQ to pre-construction SWQ.

Table 1 Water quality monitoring locations outlined in the Methodology (NGH, 2022)

| WATER QUALITY MONITORING LOCATIONS | | | | | |
|------------------------------------|---------------------|-----------|---------------------|------------|------------|
| ID | Waterway | Site Type | Catchment | Latitude | Longitude |
| WC-RS | Wallace Creek | Reference | Yarrongabilly River | -35.794258 | 148.415253 |
| WC-IS | Wallace Creek | Impact | | -35.792982 | 148.413404 |
| CG-IS | Cave Gully | Impact | | -35.795495 | 148.406665 |
| YR1-IS | Yarrangobilly River | Impact | | -35.793358 | 148.408277 |
| LHG-IS | Lick Hole Gully | Impact | | -35.792890 | 148.400445 |
| YR2-IS | Yarrangobilly River | Impact | | -35.784656 | 148.392921 |
| SSC-IS | Sheep Station Creek | Impact | | -35.793243 | 148.391046 |
| TR-RS | Talbingo Reservoir | Reference | Talbingo Reservoir | -35.822094 | 148.365690 |
| YK-RS | Yorkers Creek | Reference | Yorkers Creek | -35.801126 | 148.297979 |
| YK-IS (D/S) | Yorkers Creek | Impact | | -35.782684 | 148.320040 |
| NZG-IS | New Zealand Gully | Impact | | -35.801575 | 148.318051 |
| YK-IS | Yorkers Creek | Impact | | -35.792209 | 148.308878 |

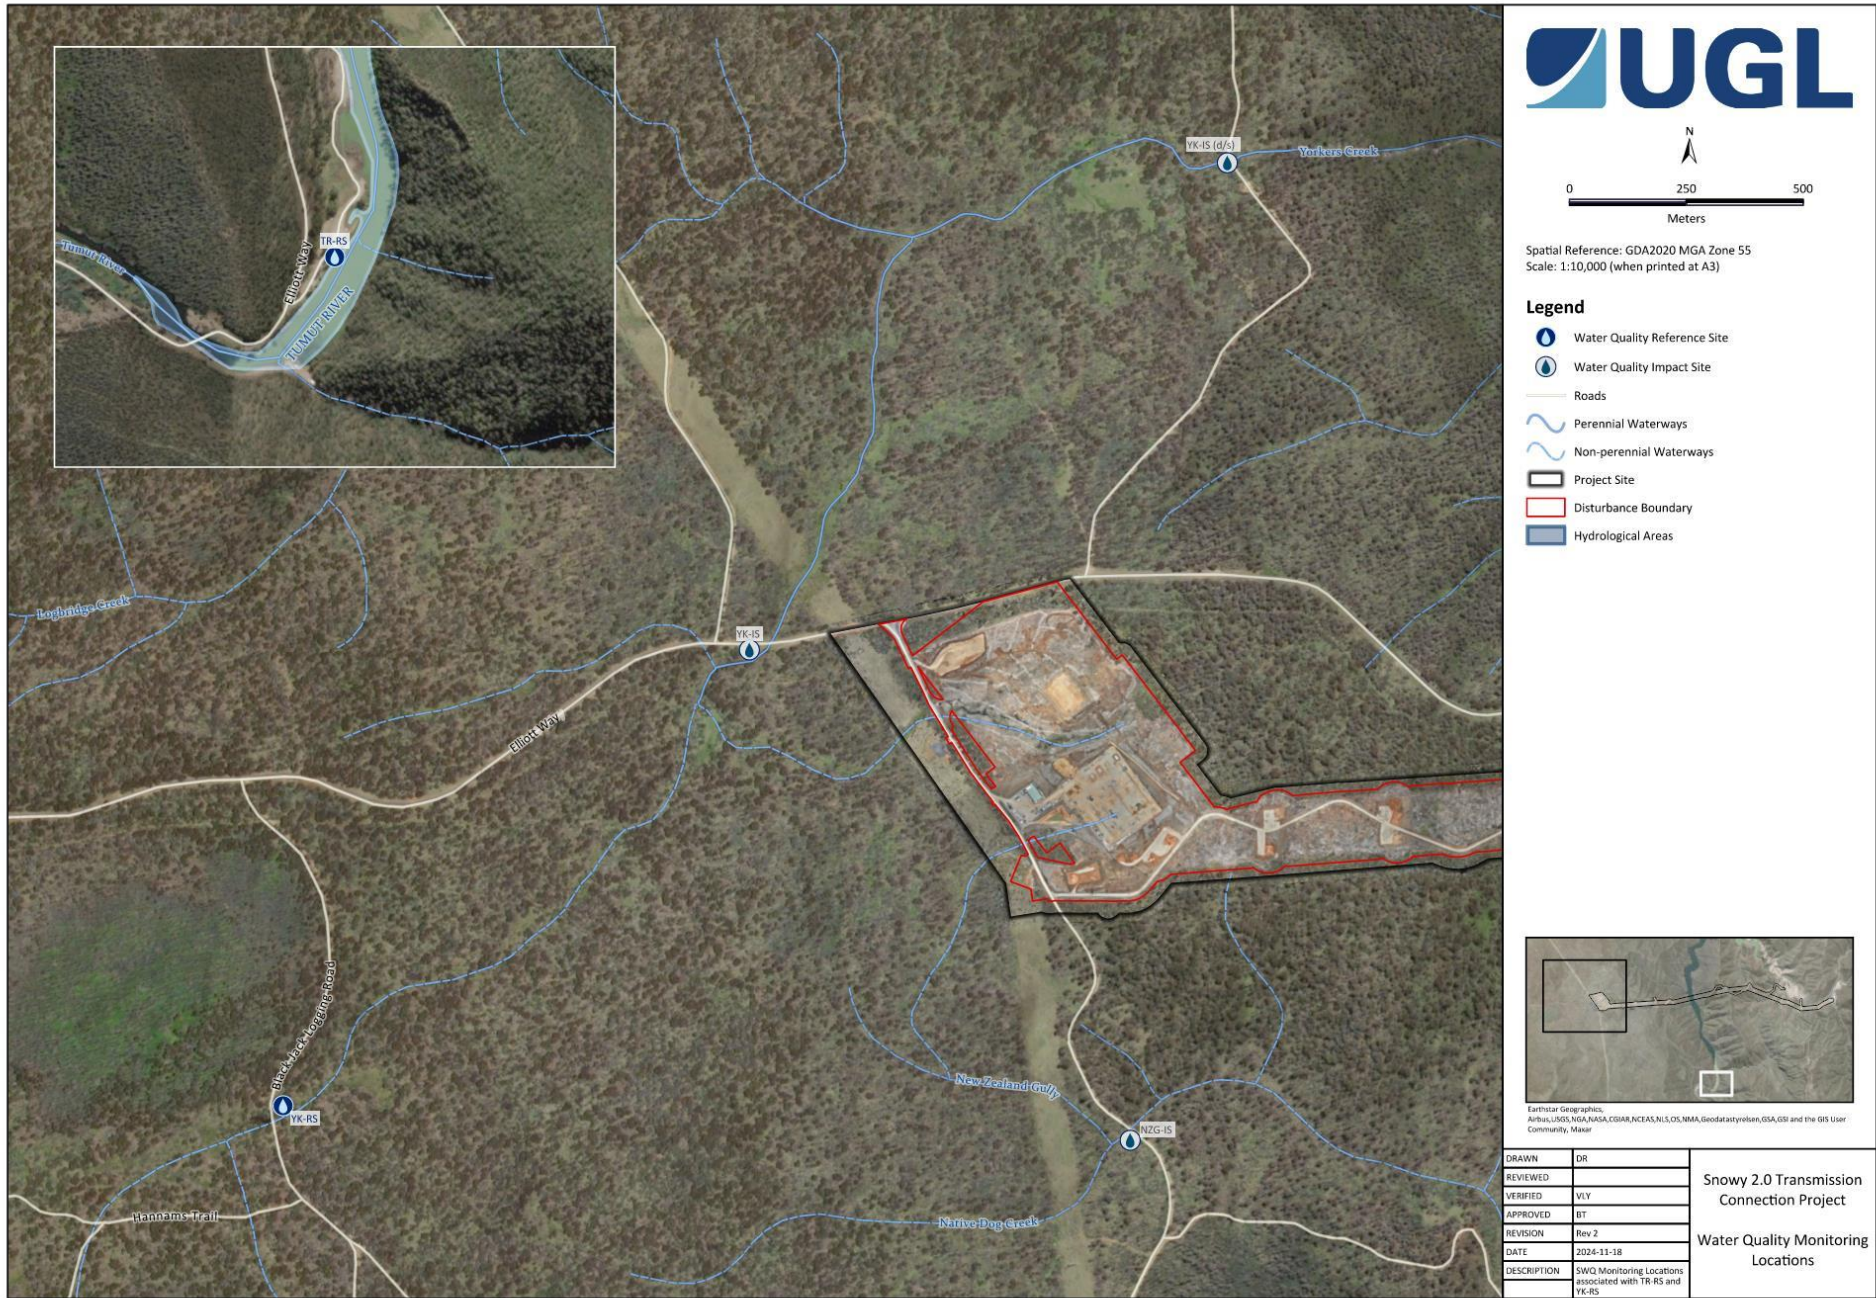


FIGURE 2 WATER QUALITY MONITORING LOCATIONS ASSOCIATED WITH REFERENCE SITE YR-RS AND TR-RS IN RELATION TO THE PROJECT

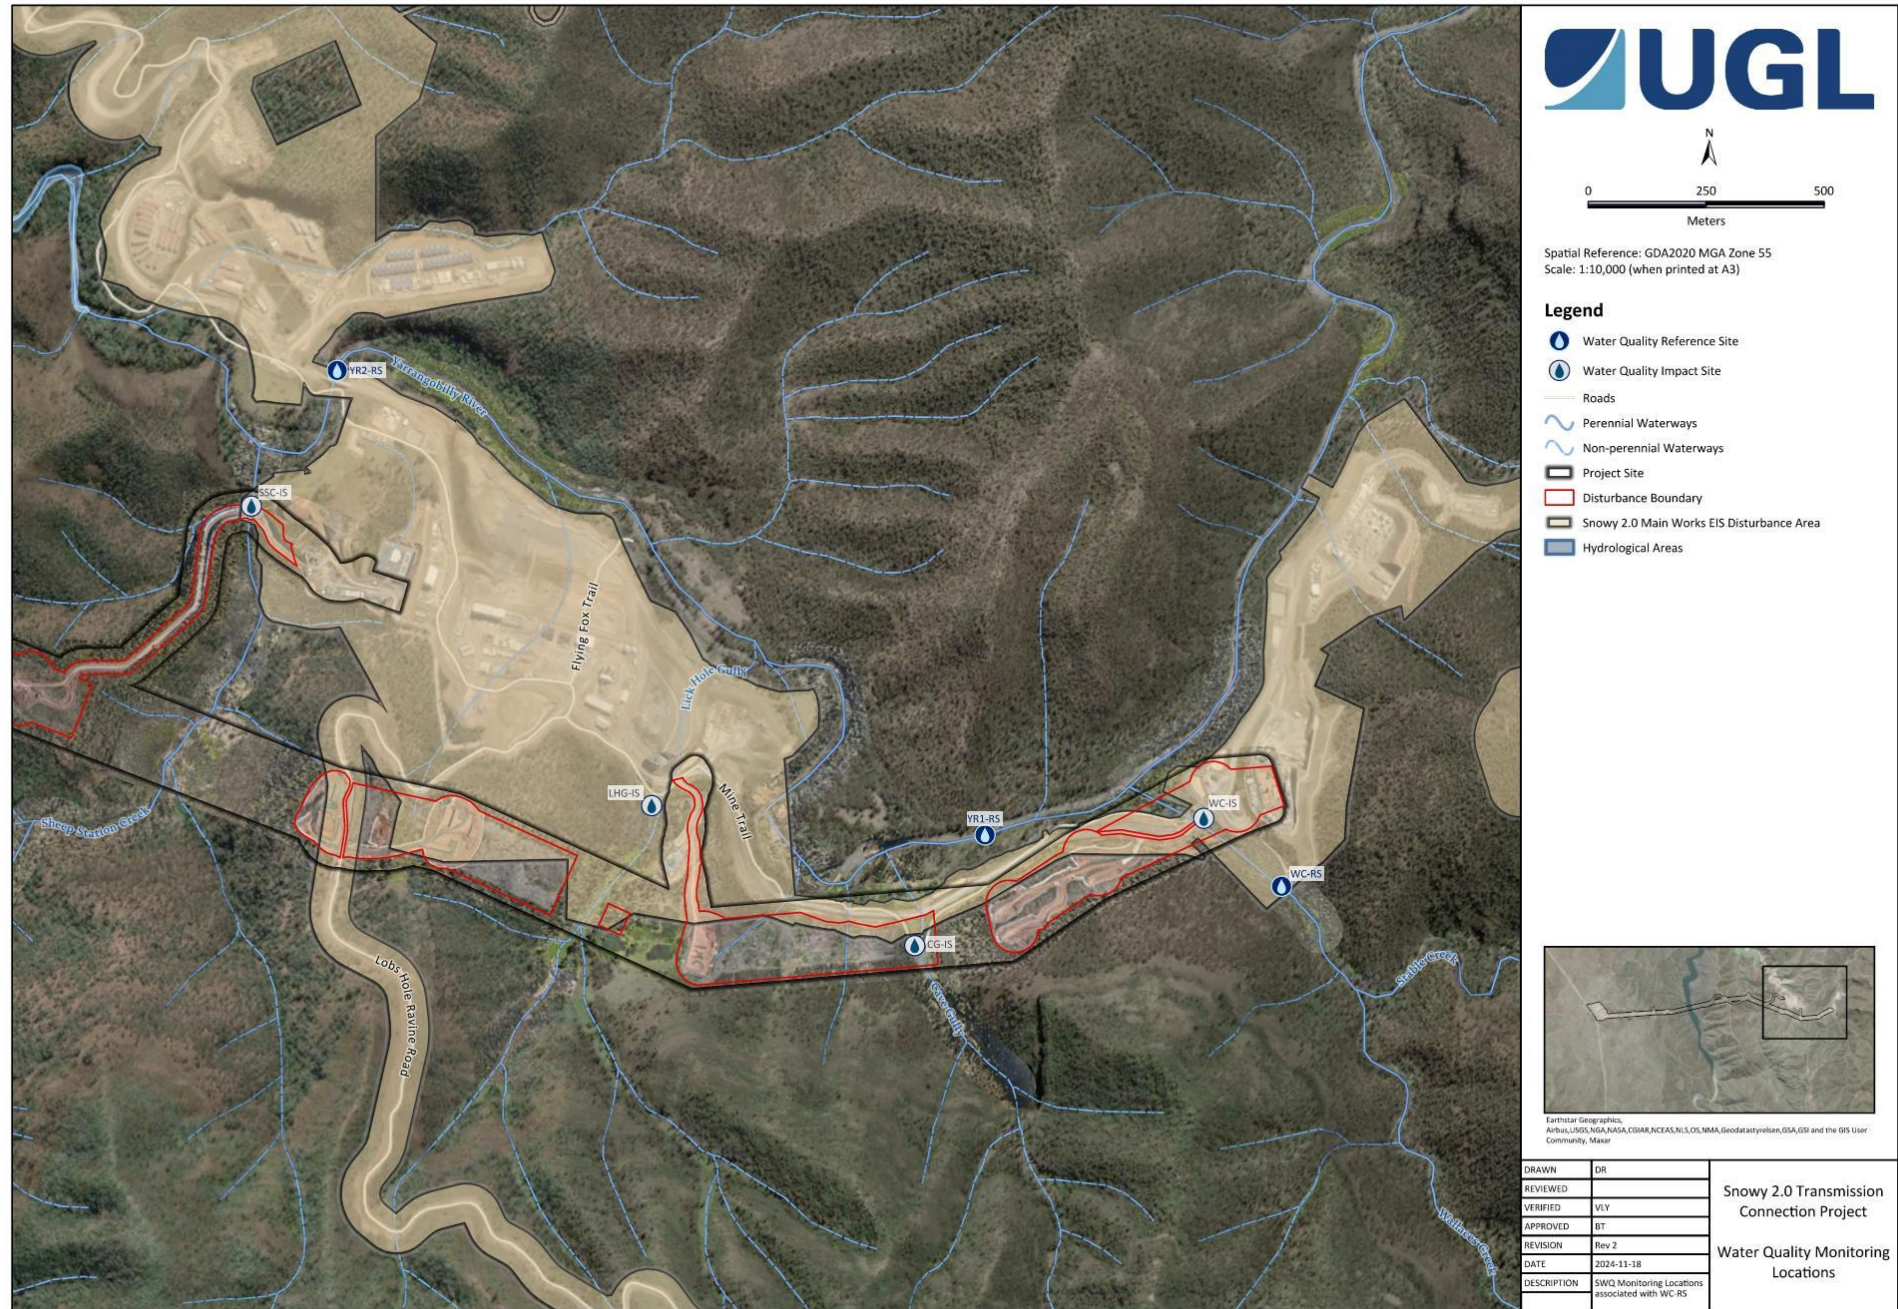


FIGURE 3 WATER QUALITY MONITORING LOCATIONS ASSOCIATED WITH REFERENCE SITE WC-RS IN RELATION TO THE PROJECT

Table 2 Seasonal SSGV (NGH, 2024) and DGV (ANZG, 2018) for water quality parameters

| SURFACE WATER QUALITY GUIDELINE VALUES | | | | | | | | |
|--|---|----------------------|----------------------|----------------------|----------------------|----------------------|----------------------|---------|
| Parameter | Unit | WC-RS | | TR-RS | | YK-RS | | DGV |
| | | SSGV (Summer/Autumn) | SSGV (Winter/Spring) | SSGV (Summer/Autumn) | SSGV (Winter/Spring) | SSGV (Summer/Autumn) | SSGV (Winter/Spring) | |
| Temperature | °C* | - | - | - | - | - | - | - |
| Dissolved Oxygen (DO) *** | %# | 96.2 | 89.7 | 91.3 | 95.5 | 89.6 | 88.7 | 90-110 |
| DO | ppm ⁺ | 9.08 | 10.28 | 8.79 | 11.53 | 8.35 | 10.2 | - |
| Specific Electrical Conductivity (EC)*** | SPC [^] μS/cm ^{^^} | 115 | 88 | 24 | 38.7 | 31 | 27.9 | 30-350 |
| EC*** | μS/cm | 93.2 | 60.85 | 20.3 | 26.2 | 24 | 20.5 | 30-350 |
| pH*** | - | 7.85 | 7.62 | 7.59 | 7.59 | 6.79 | 6.61 | 6.5-8 |
| Redox | mV ^{##} | 79.1 | 98.4 | 91.2 | 95.4 | 94.6 | 106.1 | - |
| Turbidity*** | NTU ^{**} | 0.37 | 5.12 | 0.09 | 1.56 | 9 | 7.87 | 2-25 |
| Dissolved Aluminium (Al) | mg/L ⁺⁺ | 0.03 | 0.04 | 0.03 | 0.015 | 0.36 | 0.32 | 0.027 |
| Dissolved Arsenic (As) | mg/L | 0.003 | 0.0003 | 0.003 | 0.0003 | 0.003 | 0.0003 | 0.0008 |
| Dissolved Cadmium (Cd) | mg/L | 0.00002 | 0.00002 | 0.00002 | 0.00002 | 0.00002 | 0.00002 | 0.0006 |
| Dissolved Chromium (Cr) | mg/L | 0.00001 | 0.00001 | 0.00001 | 0.00001 | 0.00001 | 0.00001 | 0.00001 |
| Dissolved Copper (Cu) | mg/L | 0.0002 | 0.0002 | 0.0002 | 0.0002 | 0.0002 | 0.0002 | 0.001 |
| Cyanide | mg/L | 0.002 | 0.002 | 0.002 | 0.002 | 0.002 | 0.002 | 0.004 |
| Dissolved Iron (Fe) | mg/L | 0.03 | 0.02 | 0.04 | 0.02 | 0.41 | 0.23 | 0.3 |
| Dissolved Lead (Pb) | mg/L | 0.001 | 0.001 | 0.001 | 0.001 | 0.001 | 0.001 | 0.001 |
| Dissolved Manganese (Mn) | mg/L | 0.002 | 0.002 | 0.003 | 0.002 | 0.005 | 0.003 | 1.2 |
| Dissolved Mercury (Hg) | mg/L | 0.00003 | 0.00003 | 0.00003 | 0.00003 | 0.00003 | 0.00003 | 0.00006 |

SURFACE WATER QUALITY GUIDELINE VALUES

| Parameter | Unit | WC-RS | | TR-RS | | YK-RS | | DGV |
|-------------------------------------|------|-------------------------|-------------------------|-------------------------|-------------------------|-------------------------|-------------------------|---------|
| | | SSGV (Summer/Autumn) | SSGV (Winter/Spring) | SSGV (Summer/Autumn) | SSGV (Winter/Spring) | SSGV (Summer/Autumn) | SSGV (Winter/Spring) | |
| Dissolved Nickel (Ni) | mg/L | 0.001 | 0.001 | 0.001 | 0.001 | 0.001 | 0.001 | 0.008 |
| Total Nitrogen (TN) | mg/L | 0.2 | 0.2 | 0.2 | 0.2 | 0.2 | 0.2 | 0.25 |
| Total Phosphorus (TP) | mg/L | 0.02 | 0.02 | 0.02 | 0.02 | 0.02 | 0.02 | 0.02 |
| Dissolved Silver (Ag) | mg/L | 0.00002 | 0.00002 | 0.00002 | 0.00002 | 0.00002 | 0.00002 | 0.00002 |
| Dissolved Zinc (Zn) | mg/L | 0.002 | 0.002 | 0.002 | 0.002 | 0.002 | 0.002 | 0.0024 |
| Ammonia | mg/L | 0.013 | 0.013 | 0.013 | 0.013 | 0.013 | 0.013 | 0.013 |
| Nitrogen Oxides | mg/L | 0.015 | 0.015 | 0.015 | 0.015 | 0.015 | 0.015 | 0.015 |
| Reactive Phosphorous | mg/L | 0.02 | 0.015 | 0.02 | 0.015 | 0.02 | 0.02 | 0.015 |
| Total Hardness (CaCO ₃) | mg/L | 47 | 30 | 7.5 | 8 | 1 | 7 | - |
| Total Kjeldahl Nitrogen (TKN) | mg/L | 0.2 | 0.2 | 0.1 | 0.2 | 0.1 | 0.2 | - |
| Total Dissolved Solids (TDS) | mg/L | 52 | 39 | 12.5 | 15 | 30 | 10 | - |
| Total Suspended Solids (TSS) | mg/L | 0.2 | 1 | 0.2 | 0.2 | 3 | 0.2 | 0.2 |
| Total Al [@] | mg/L | - | - | - | - | - | - | 0.027 |
| Total As [@] | mg/L | - | - | - | - | - | - | 0.0008 |
| Total Cd [@] | mg/L | - | - | - | - | - | - | 0.0006 |
| Total Cr [@] | mg/L | - | - | - | - | - | - | 0.00001 |
| Total Cu [@] | mg/L | - | - | - | - | - | - | 0.001 |
| Total Pb [@] | mg/L | - | - | - | - | - | - | 0.001 |
| Total Mn [@] | mg/L | - | - | - | - | - | - | 1.2 |
| Total Ni [@] | mg/L | - | - | - | - | - | - | 0.008 |

SURFACE WATER QUALITY GUIDELINE VALUES

| Parameter | Unit | WC-RS | | TR-RS | | YK-RS | | DGV |
|-----------------------|------|-------------------------|-------------------------|-------------------------|-------------------------|-------------------------|-------------------------|---------|
| | | SSGV (Summer/Autumn) | SSGV (Winter/Spring) | SSGV (Summer/Autumn) | SSGV (Winter/Spring) | SSGV (Summer/Autumn) | SSGV (Winter/Spring) | |
| Total Ag [@] | mg/L | - | - | - | - | - | - | 0.00002 |
| Total Zn [@] | mg/L | - | - | - | - | - | - | 0.0024 |
| Total Fe [@] | mg/L | - | - | - | - | - | - | 0.3 |
| Total Hg [@] | mg/L | - | - | - | - | - | - | 0.00006 |

* °C = degrees Celsius

% = percent

mV = millivolt

+ ppm = parts per million

^ SPC = specific conductance

** mg/L = milligram per litre

** NTU = Nephelometric Turbidity Unit

^^ μS/cm = micro Siemens per centimetre

@ parameter not analysed by NGH

*** assessed against DGV where guideline range is more appropriate for the parameter

4. BASELINE WATER QUALITY

4.1. Water Quality Objectives

Water quality objectives are outlined in Section 2.1 of the Baseline Report (NGH, 2024).

4.2. Site Specific Guideline Values

In accordance with the ANZG (ANZG, 2018), SSGV for the three Reference Sites (RS) (WC-RS, TR-RS and YK-RS) were derived from the results collected during the 24 month pre-construction SWQ monitoring period. The SSGV reflect the seasonality observed in the baseline data and are characterised by the drier months of Summer/Autumn (November to May) and wetter months of Winter/Spring (June to October) in accordance with the 'Australian and New Zealand Environment and Conservation Council (ANZECC) and Agriculture and Resource Management Council of Australia and New Zealand (ARMCANZ) (2000) methodology and derivatives developed to 2018 of the ANZG (ANZG, 2018).

Table 2 outlines the seasonal SSGV provided in the Baseline Report (NGH, 2024).

5. APRIL 2024 MONITORING

SW sampling was undertaken at 12 monitoring locations on 29 April 2024. Two monitoring location, CG-IS and SSC-IS, were not sampled as the waterways were dry at the time.

In accordance with the methodology outlined in Section 3, SW samples were either measured in situ using a calibrated YSI ProDSS Sonde Multiparameter Digital Water Quality Meter (refer to Appendix D) or analysed by National Association of Testing Authorities, Australia (NATA) accredited ALS Limited (ALS) laboratory. However, the following parameters were not measured:


- DO (ppm) (DO% has been measured)
- EC ($\mu\text{S}/\text{cm}$) (Specific conductance ($\mu\text{S}/\text{cm}$) has been measured)
- Redox (mV)

The 'Water Quality Monitoring Field Data Sheet' (Field Sheet) (UGL, 2024a) is provided in Appendix A. The 'Certificate of Analysis' (COA) (ALS, 2024a), 'QA/QC Compliance Assessment to assist with Quality Review' (QA/QC Assessment) (ALS, 2024b), 'Quality Control Report' (QCR) (ALS, 2024c) are attached in Appendix B.




5.1. Observations

Field observations during sampling are summarised in Table 3.




Table 3 Field observations during sampling

| FIELD OBSERVATIONS | | |
|--------------------|---|--|
| Date | 29.04.2024 | |
| Weather | Overcast conditions were present on the day of sampling, however no rainfall occurred. The last rainfall to occur across the sampling sites came on the 20.04.2024. | |
| ID | Observations | Photo |
| WC-RS | <ul style="list-style-type: none"> • Clear shallow waters, relatively fast flowing • Vegetation cover along banks of the creek |  |




FIELD OBSERVATIONS

| | | |
|----------------|---|--|
| Date | 29.04.2024 | |
| Weather | Overcast conditions were present on the day of sampling, however no rainfall occurred. The last rainfall to occur across the sampling sites came on the 20.04.2024. | |
| ID | Observations | Photo |
| WC-IS | <ul style="list-style-type: none"> • Clear shallow waters, relatively fast flowing • Small amount of debris and fine sediment visible • Strong weed/vegetation growth on northern bank |  |
| CG-IS | <ul style="list-style-type: none"> • Creek completely dry, no water present |  |
| YR1-IS | <ul style="list-style-type: none"> • Clear shallow waters, fast flowing |  |



FIELD OBSERVATIONS

| | | |
|----------------|---|--|
| Date | 29.04.2024 | |
| Weather | Overcast conditions were present on the day of sampling, however no rainfall occurred. The last rainfall to occur across the sampling sites came on the 20.04.2024. | |
| ID | Observations | Photo |
| LHG-IS | <ul style="list-style-type: none"> • High silt deposition • Shallow at time of sampling • Slight milky colour • Vegetation growing in and around gully • Slight orange colouring to water around aquatic flora • Limited flow |  |
| YR2-IS | <ul style="list-style-type: none"> • Deep water channel, high flow rate, • Clear water |  |
| SSC-IS | <ul style="list-style-type: none"> • Creek dry, no water present |  |

FIELD OBSERVATIONS

| | | |
|----------------|--|--|
| Date | 29.04.2024 | |
| Weather | Overcast conditions were present on the day of sampling, however no rainfall occurred. The last rainfall to occur across the sampling sites came on the 20.04.2024. | |
| ID | Observations | Photo |
| TR-RS | <ul style="list-style-type: none"> • Clear water, large volume with gradual surface flow |  |
| YK-IS (D/S) | <ul style="list-style-type: none"> • Clear water, shallow depth, with some fine sediment settled on the base • Thick vegetation cover on either bank |  |
| NZG-IS | <ul style="list-style-type: none"> • Thick vegetation cover on either bank • Relatively clear water, slight milky colouration • Fine sediment visible on either bank and on the bottom of the gully |  |

FIELD OBSERVATIONS

| | | |
|----------------|--|--|
| Date | 29.04.2024 | |
| Weather | Overcast conditions were present on the day of sampling, however no rainfall occurred. The last rainfall to occur across the sampling sites came on the 20.04.2024. | |
| ID | Observations | Photo |
| YK-IS | <ul style="list-style-type: none"> • Fine sediment evident on banks and bottom of Creek • Sticks/debris along Creek • Low water levels, fine sediment moving with gradual flow of water |  |
| YK-RS | <ul style="list-style-type: none"> • Minimal volume, sandy loam on base of Creek • Milky colouration to water • Grasses/vegetation on either bank. • Fine sediment evident in water flow |  |

5.2. Results

The results from the construction SWQ monitoring program have been reported for each respective catchment: Yarrangobilly River, Talbingo Reservoir, and Yorkers Creek.

- **Yarrangobilly River catchment** monitoring includes the reference site at Wallace Creek and impact sites at Yarrangobilly River, Wallace Creek, Cave Gully, Lick Hole Gully, and Sheep Station Creek.
- **Yorkers Creek catchment** monitoring includes the reference site at Yorkers Creek and impact sites at Yorkers Creek and New Zealand Gully.
- **Talbingo Reservoir** features a reference site located upstream within the reservoir, serving as an overall reference for monitoring sites in the Yarrangobilly River and Yorkers Creek catchments.

This reference site provides a baseline for the SWQ monitoring program.

The SWQ monitoring results for key physical and chemical parameters, along with site-specific trigger values, are detailed in Section 5.2.1. Results for dissolved and total metals, including site-specific trigger values, are covered in Sections 5.2.2 and 0. Upon review of the data, observations were noted between the reference and impact sites.

The complete table of results is attached in Appendix C.

5.2.1. Key Physical and Chemical Parameters

See below for results of key physical and chemical parameters.

Temperature

Temperatures (°C) within the Yarrangobilly catchment ranged from 10.7 °C to 12.3 °C, refer to Figure 4. In Talbingo Reservoir, temperatures decreased from 13.4 °C in March 2024 to 12.3 °C in April 2024, refer to Figure 5. Temperatures in the Yorkers Creek Catchment ranged between 5.4 °C to 6.8 °C in April 2024, refer to Figure 6.

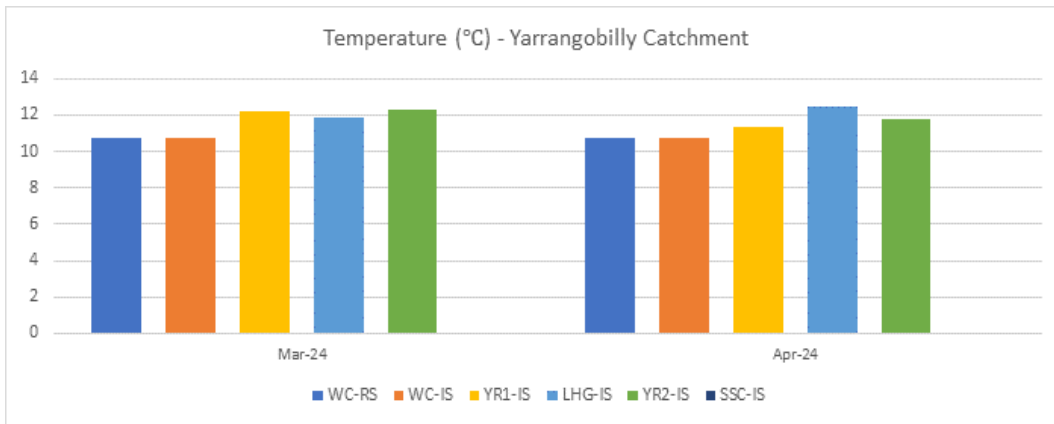


FIGURE 4 : TEMPERATURE FOR YARRANGOBILLY CATCHMENT

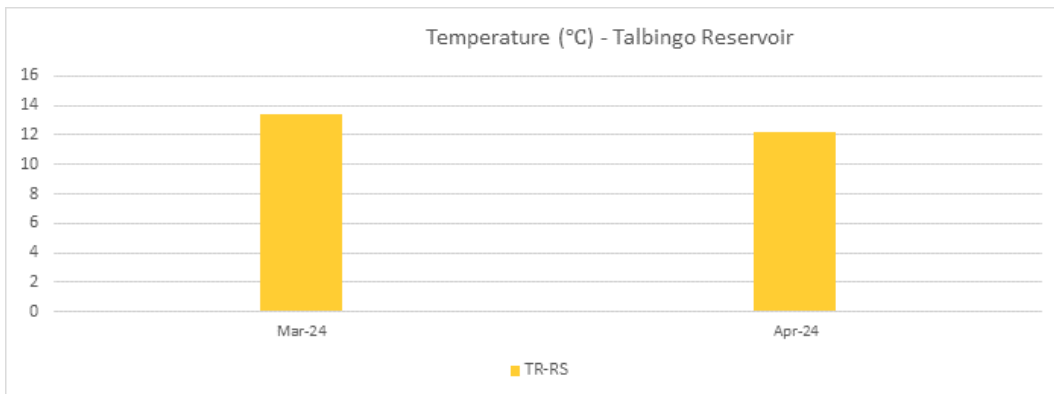


FIGURE 5: TEMPERATURE FOR TALBINGO RESERVOIR

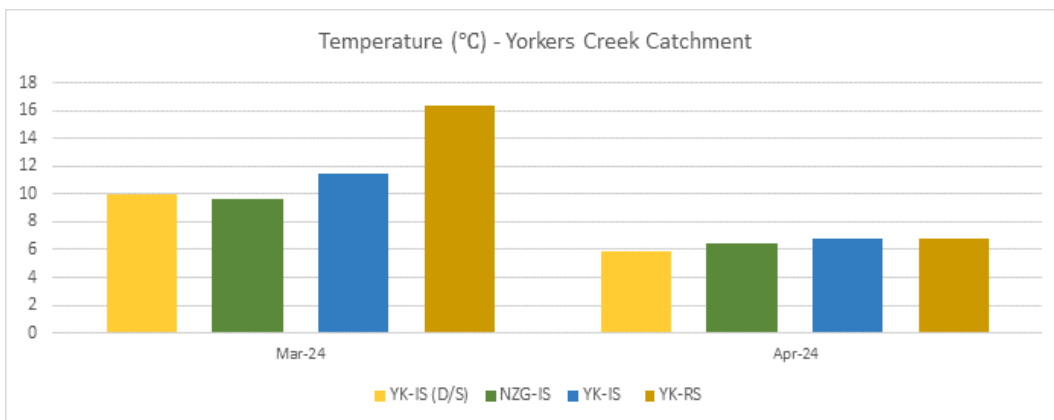


FIGURE 6: TEMPERATURE FOR YORKERS CREEK CATCHMENT

pH

pH across all catchments have increased since March 2024. In the Yarrangobilly catchment, the reference site (WC-RS) exceeded the upper pH limit (8.0), recording a value of 8.44. The impact sites in this catchment also exceeded the SSGV range (6.5 to 8.0), with values between 8.45 and 8.52, refer to Figure 7. Sites within the Talbingo Reservoir and Yorkers Creek catchments remained within the SSGV range refer Figure 8 and Figure 9.

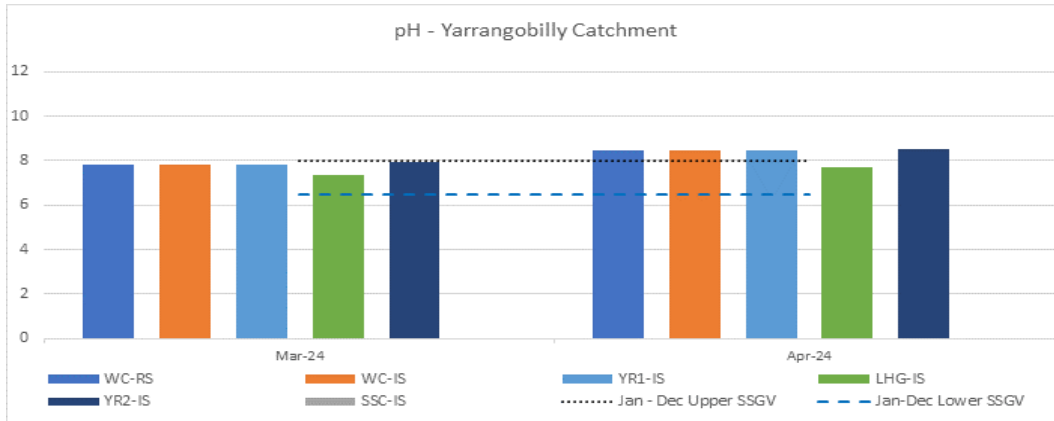


FIGURE 7: PH FOR YARRANGOBILLY CATCHMENT

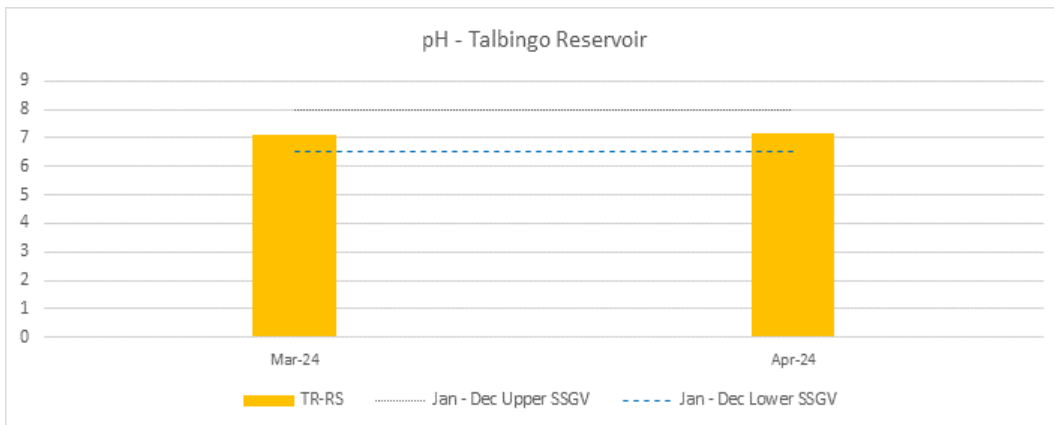


FIGURE 8: PH FOR TALBINGO RESERVOIR

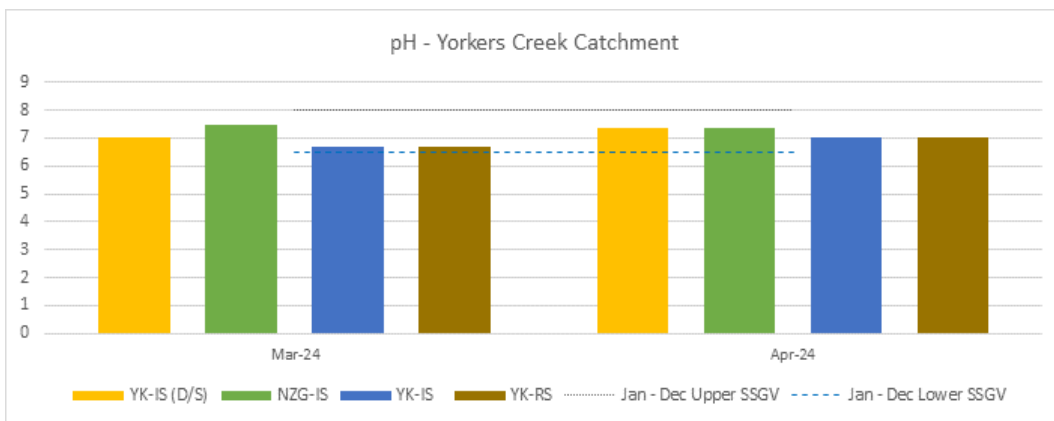


FIGURE 9: PH FOR YORKERS CREEK CATCHMENT

Dissolved Oxygen

DO (%) results for the Talbingo Reservoir (Figure 10) and Yorkers Creek catchments (Figure 11) remained below the SSGV lower threshold (90%) in both March and April, aligning with baseline monitoring results for this period. In the Yarrangobilly catchment, all results were within the SSGV range, except for LHG-IS, which showed an increase compared to March results, refer Figure 12.

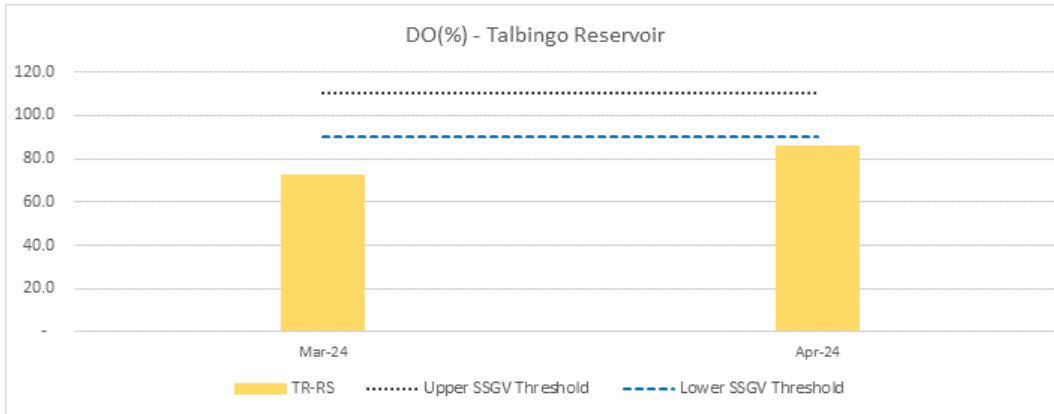


FIGURE 10: DO FOR TALBINGO RESERVOIR

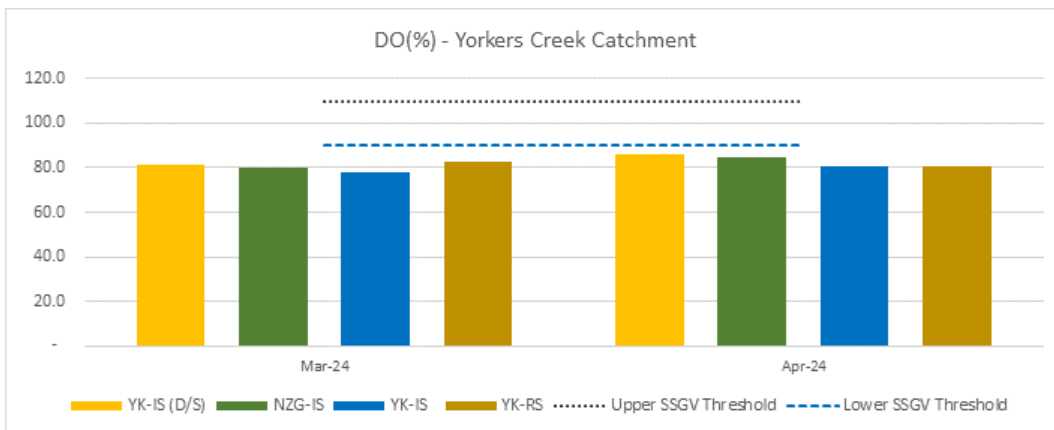


FIGURE 11: DO FOR YORKERS CREEK CATCHMENT

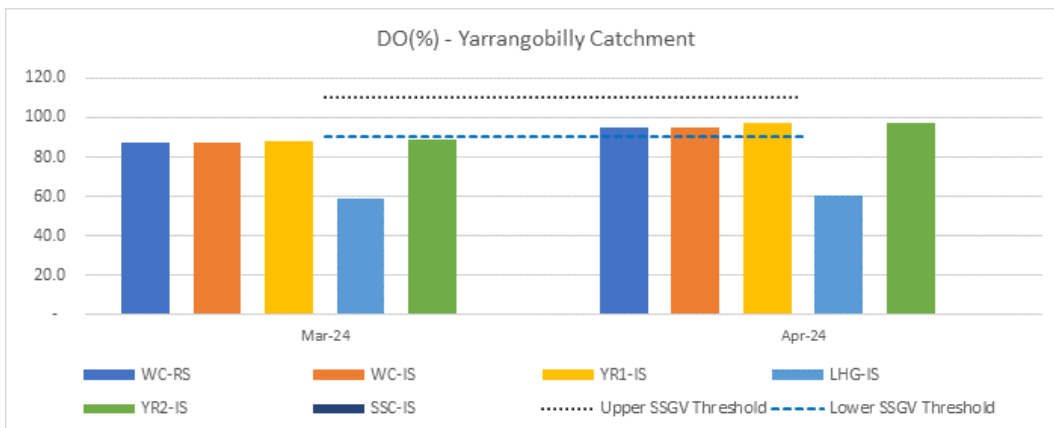


FIGURE 12: DO FOR YARRANGOBILLY CATCHMENT

Specific Conductance

SPC ($\mu\text{S}/\text{cm}$) results within the Yarrangobilly catchment indicate that all sites exceed the Dec-May SSGV ($115 \mu\text{S}/\text{cm}$), with the reference site (WC-RS) recording the highest value of $145.6 \mu\text{S}/\text{cm}$. An exception was noted at LHG-IS, which recorded a significantly higher value of $658 \mu\text{S}/\text{cm}$, consistent with the baseline data, refer Figure 13. In comparison, Talbingo Reservoir had much lower values ($25.9 \mu\text{S}/\text{cm}$), aligning with the Dec-May SSGV ($24 \mu\text{S}/\text{cm}$), refer Figure 14. In Yorkers Creek catchment, specific conductance consistently exceeded the Dec-May SSGV ($31 \mu\text{S}/\text{cm}$) including the reference site (YK-RS) which recorded $36.5 \mu\text{S}/\text{cm}$, refer to Figure 15.

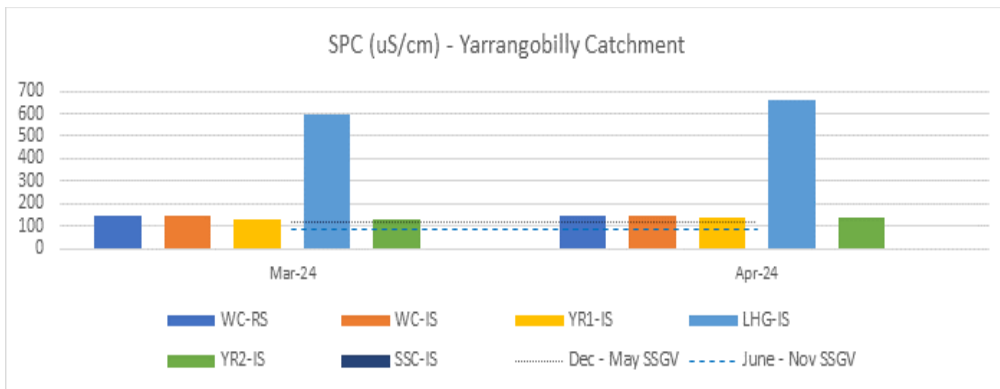


FIGURE 13: SPC FOR YARRANGOBILLY CATCHMENT

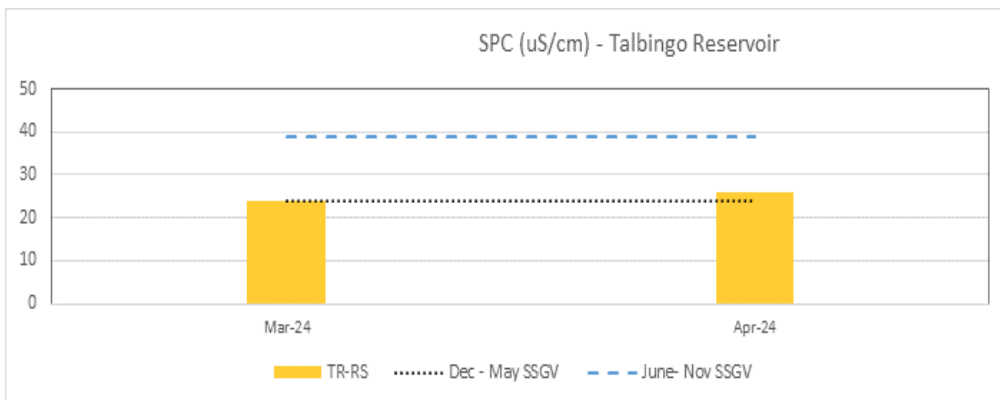


FIGURE 14: SPC FOR TALBINGO RESERVOIR

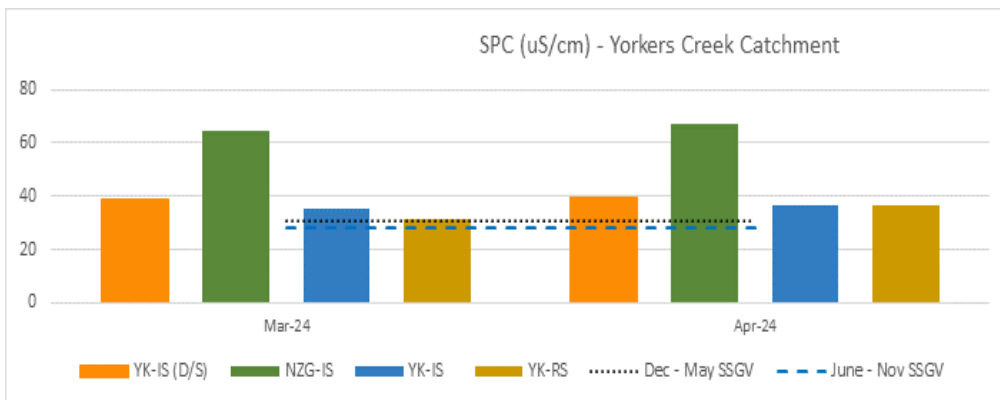


FIGURE 15: SPC FOR YORKERS CREEK CATCHMENT

Turbidity

Turbidity (NTU) slightly exceeded the Dec – May SSGV across each catchment, except for NGZ-IS, which recorded 0.96 NTU, remaining below the SSGV. In contrast, and LGH-IS and YC-IS (D/S) were significantly above the SSGV at 69.72 NTU and 221.78 NTU respectively, refer Figure 16 to Figure 18.

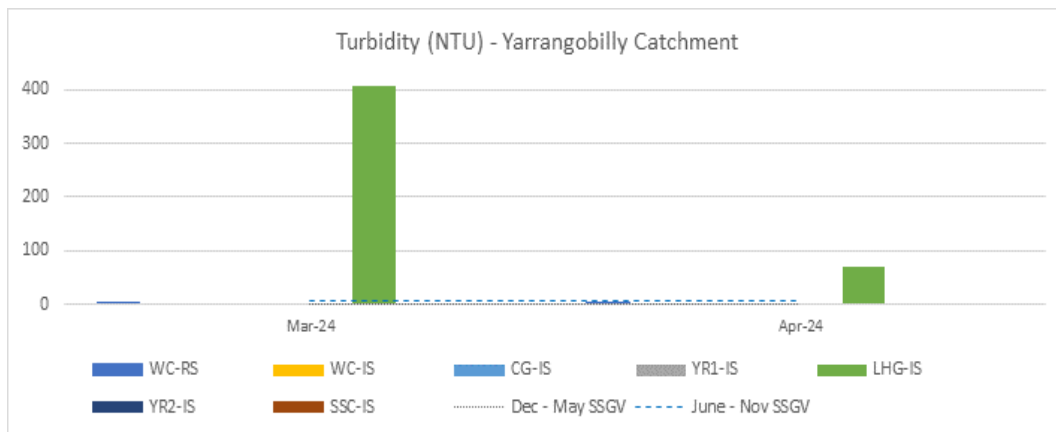


FIGURE 16: TURBIDITY FOR YARRANGOBILLY CATCHMENT

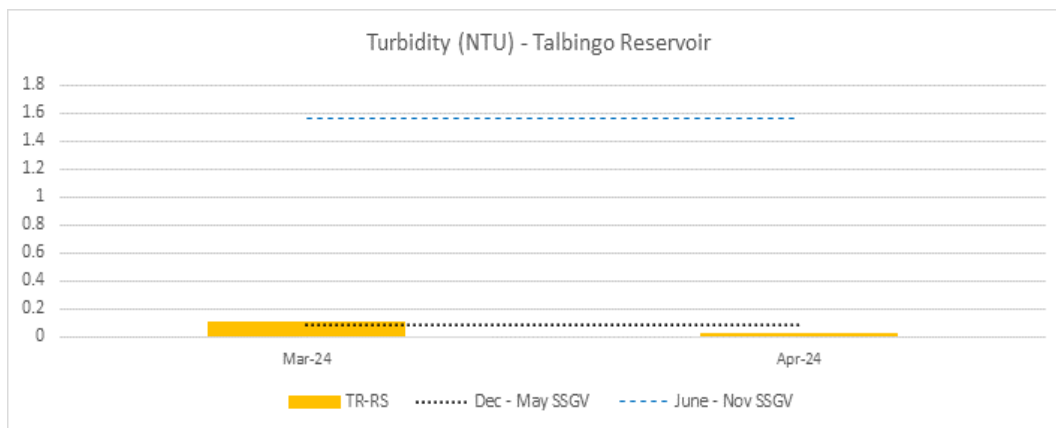


FIGURE 17: TURBIDITY FOR TALBINGO RESERVOIR

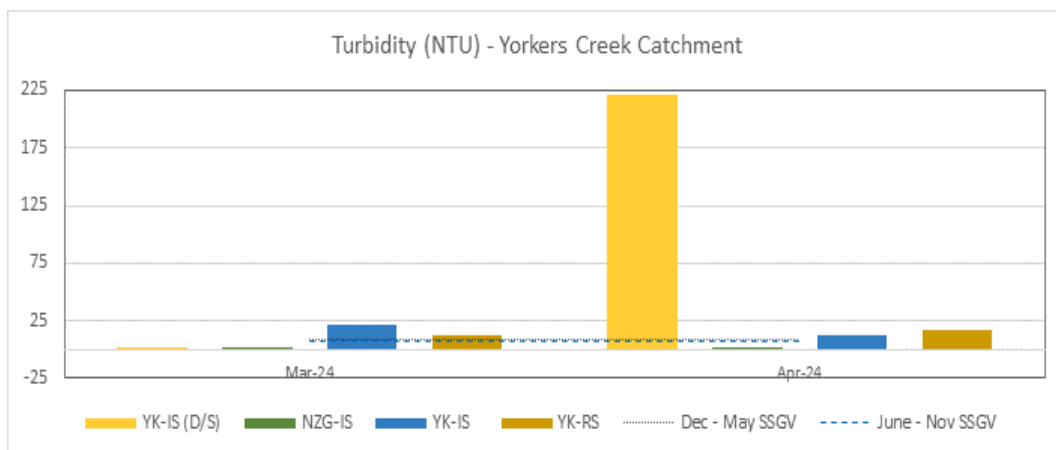


FIGURE 18: TURBIDITY FOR YORKERS CREEK CATCHMENT

Total Suspended Solids

TSS (mg/L) results in Yarrangobilly catchment exceeded the Dec-Jan SSGV (0.2 mg/L) at all sites. Notably, LHG-IS, YR-IS and WC-IS recorded higher values of 70 mg/L, 5 mg/L and 11 mg/L respectively, refer Figure 19. In the Talbingo Reservoir TSS also exceeded the Dec-Jan SSGV, with a recorded value of 3 mg/L, refer to Figure 20. Within the Yorkers Creek catchment, the reference site (YK-RS) recorded the highest value (24 mg/L), with all the impact sites recording below this value, with YK-IS (D/S) matching the Dec-Jan SSGV at 3 mg/L, refer to Figure 21.

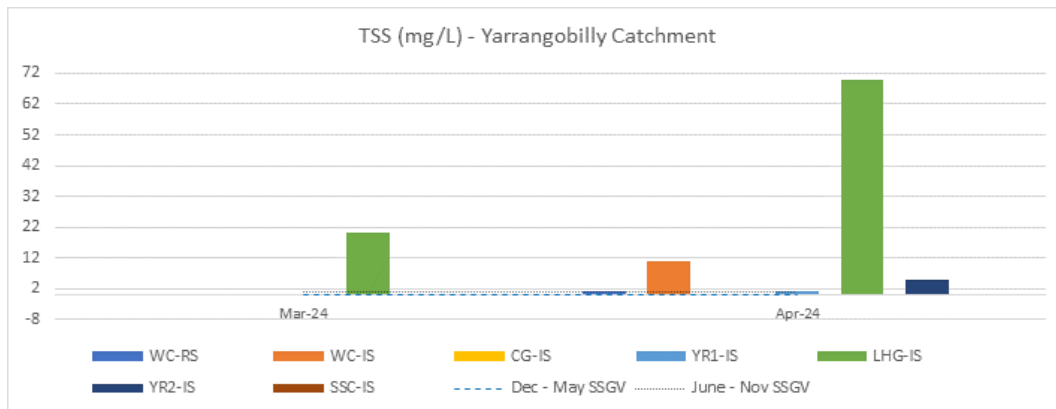


FIGURE 19: TSS FOR YARRANGOBILLY CATCHMENT

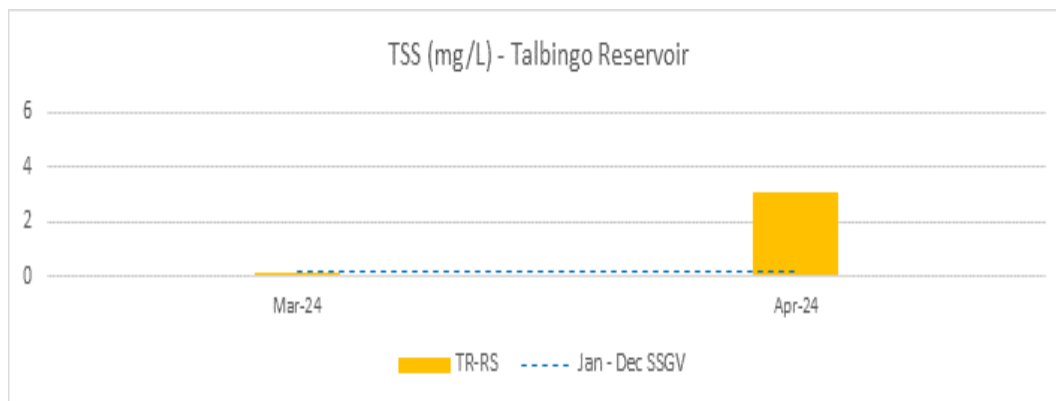


FIGURE 20: TSS FOR TALBINGO RESERVOIR

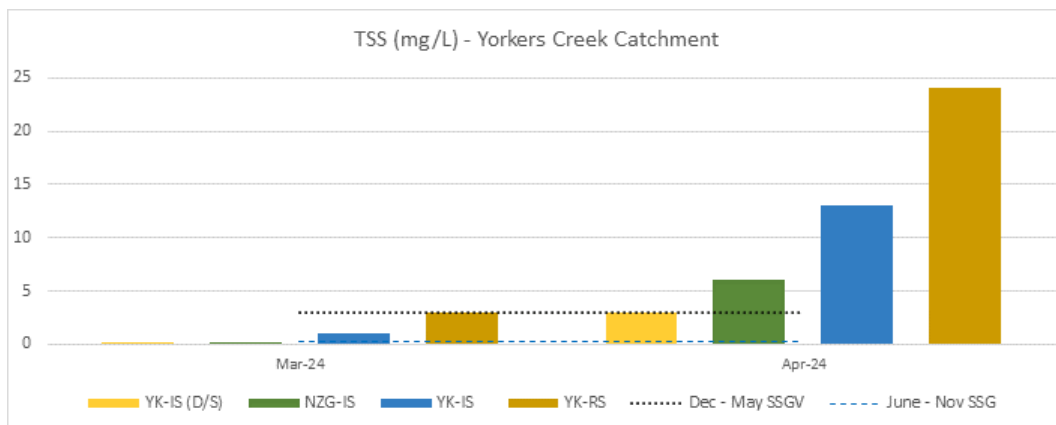


FIGURE 21: TSS FOR YORKERS CREEK CATCHMENT

Ammonia

Ammonia (mg/L) levels across all catchments were either below the LOR or lower than the levels recorded at the reference site, with the exception of LHG-IS (0.02 mg/L), refer to Figure 22 to Figure 24

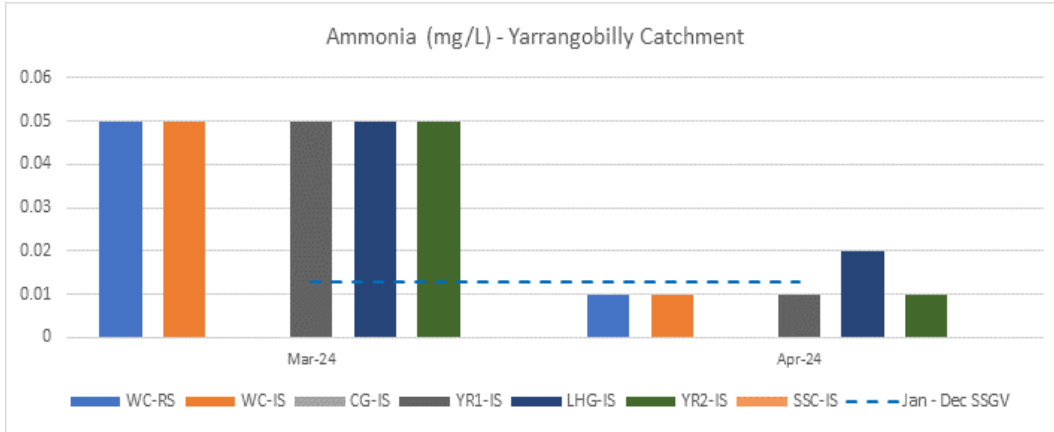


FIGURE 22: AMMONIA FOR YARRANGOBILLY CATCHMENT

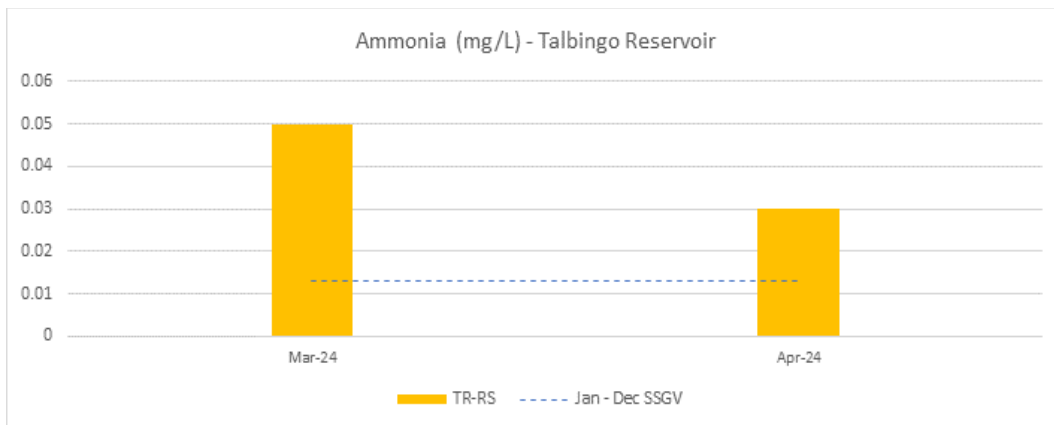


FIGURE 23: AMMONIA FOR TALBINGO RESERVOIR

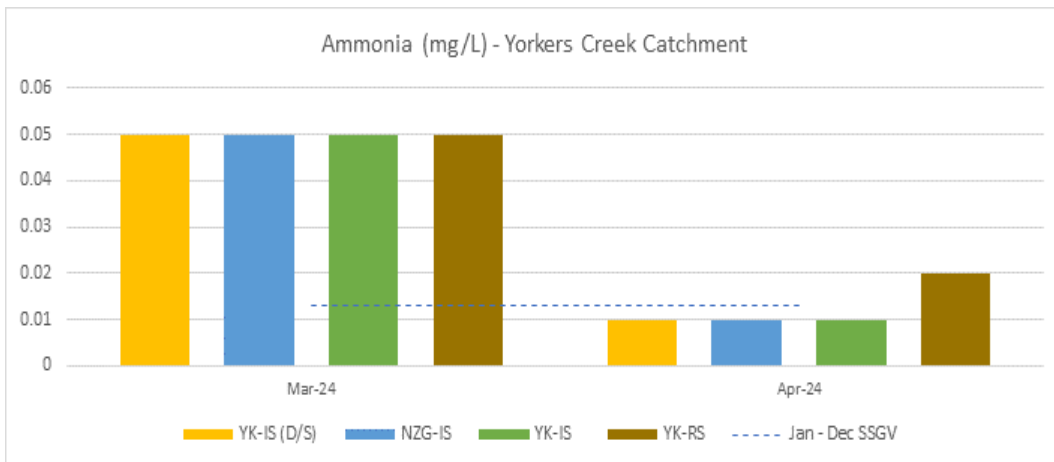


FIGURE 24: AMMONIA FOR YORKERS CREEK CATCHMENT

Nitrogen Oxides

Nitrogen Oxides (mg/L) were below the LOR for WC-RS, YR2-IS and NGZ-IS. However, the other impact sites exceeded the Jan-Dec SSGV (0.015 mg/L), with WC-IS recording a value of 2.42 mg/L, refer to Figure 25 to Figure 27.

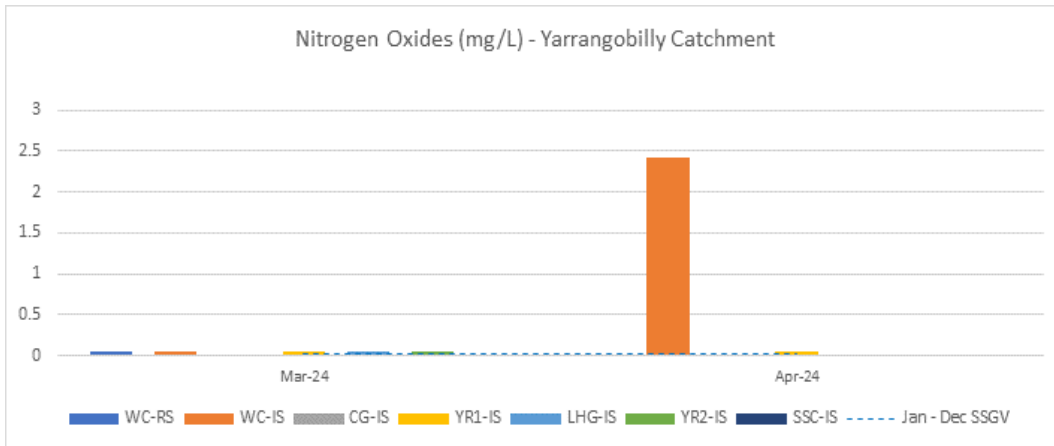


FIGURE 25: NITROGEN OXIDES FOR YARRANGOBILLY CATCHMENT

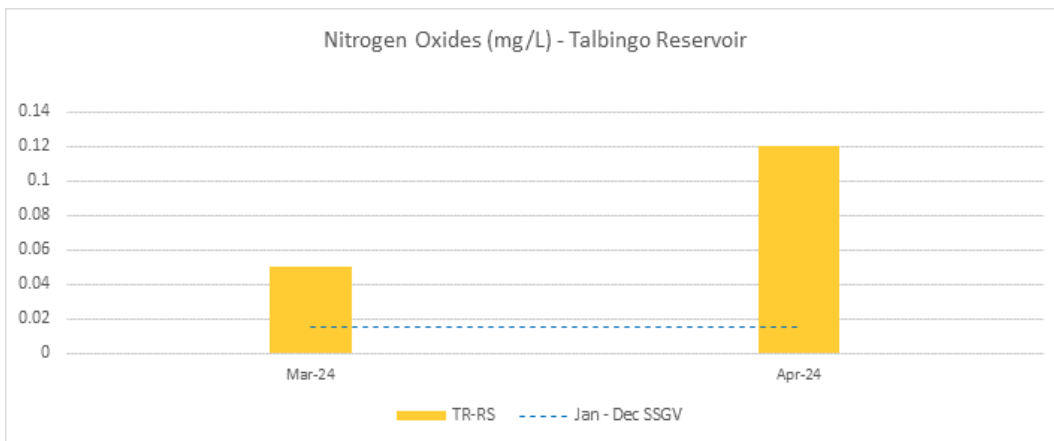


FIGURE 26: NITROGEN OXIDES FOR TALBINGO RESERVOIR

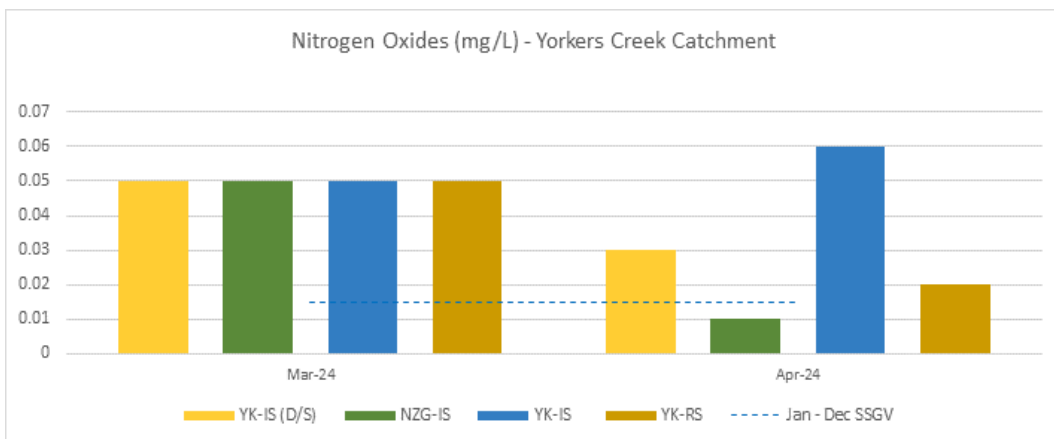


FIGURE 27: NITROGEN OXIDES FOR YORKERS CREEK CATCHMENT

Total Kjeldahl Nitrogen

TKN (mg/L) was below the LOR at all sites, except for WC-IS which recorded 2.42 mg/L, and Talbingo Reservoir, which recorded 0.12 mg/L, refer to Figure 28 to Figure 30.

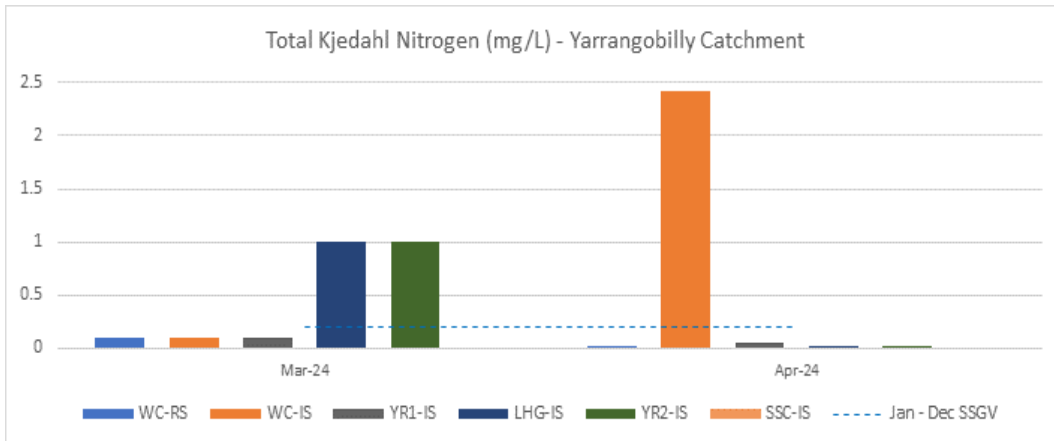


FIGURE 28: TOTAL KJELDAHL NITROGEN FOR YARRANGOBILLY CATCHMENT

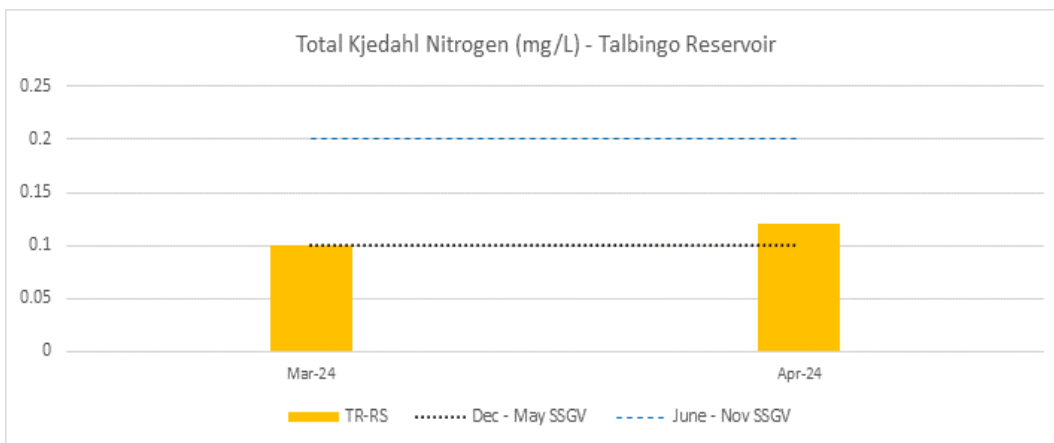


FIGURE 29: TOTAL KJEHAHL NITROGEN FOR TALBINGO RESERVOIR

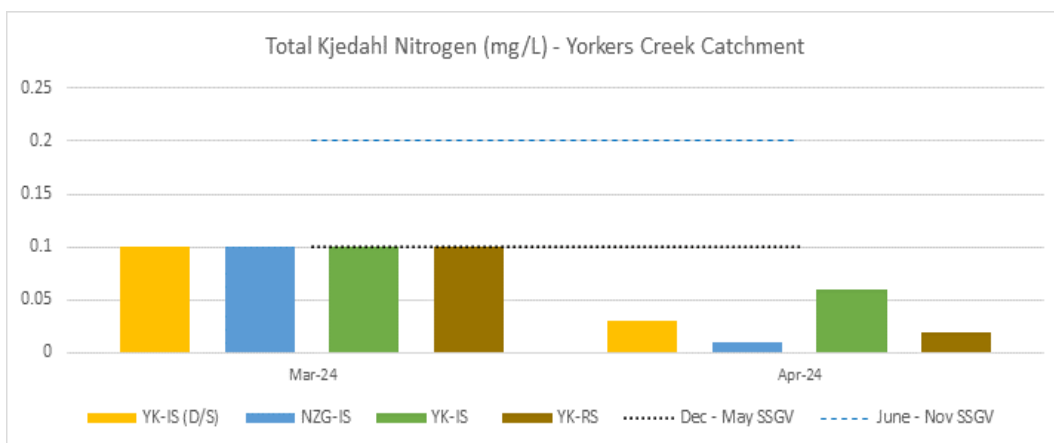


FIGURE 30: TOTAL KJELDAHL NITROGEN FOR YORKERS CREEK CATCHMENT

Total Hardness

CaCO₃ (mg/L) results exceeded the Dec-May SSGV for both the reference and impact sites in the Yarrangobilly catchment (SSGV: 47 mg/L) and Yorkers Creek catchment (SSGV: 1 mg/L). In contrast, Talbingo Reservoir was below the Dec-May SSGV (7.5 mg/L) at 5 mg/L, refer Figure 31 to Figure 33.

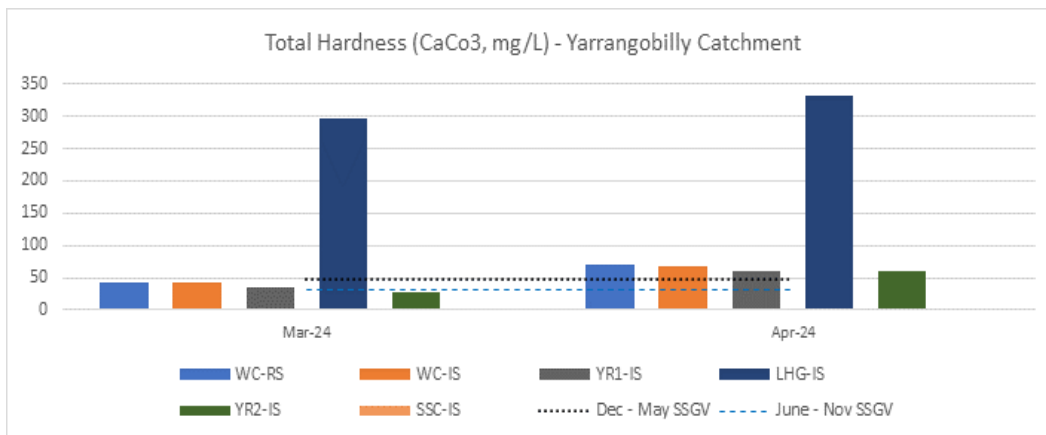


FIGURE 31: TOTAL HARDNESS FOR YARRANGOBILLY CATCHMENT

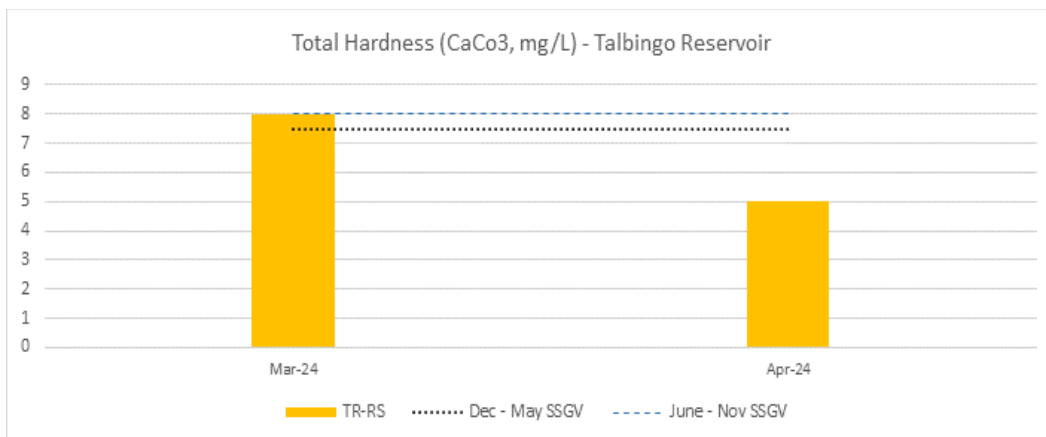


FIGURE 32: TOTAL HARDNESS FOR TALBINGO RESERVOIR

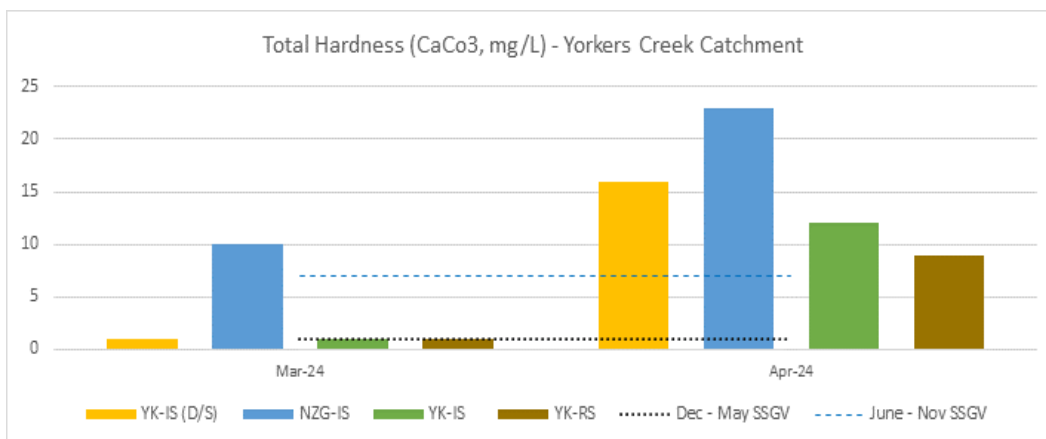


FIGURE 33: TOTAL HARDNESS FOR YORKERS CREEK CATCHMENT

Total Nitrogen

TN (mg/L) remained below the SSGV (0.2 mg/L) at all sites in the Yarrangobilly catchment, except for WC-IS, which recorded a significantly higher value of 2.7 mg/L. TN levels also exceeded the SSGV at Talbingo Reservoir (1.3 mg/L), the Yorkers Creek reference site (YK-RS: 0.6 mg/L), and YK-IS (0.3 mg/L), refer to Figure 34 to Figure 36.

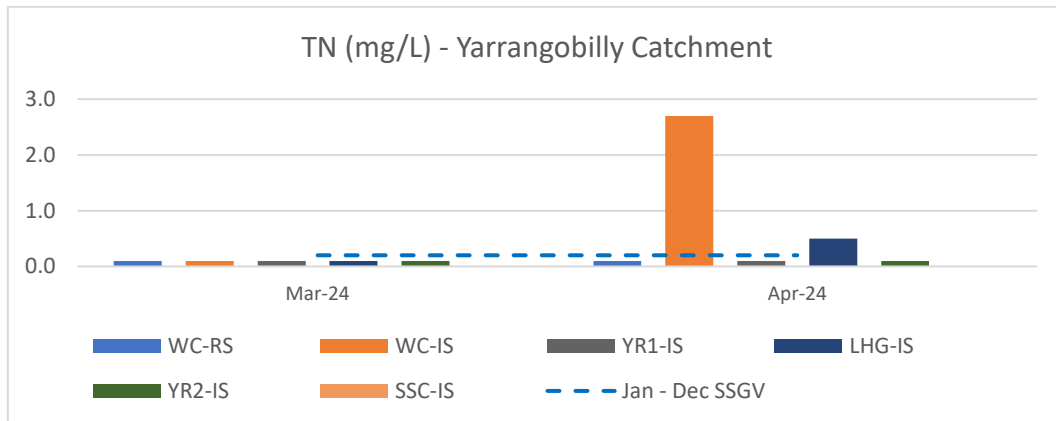


FIGURE 34: TOTAL NITROGEN FOR YARRANGOBILLY CATCHMENT

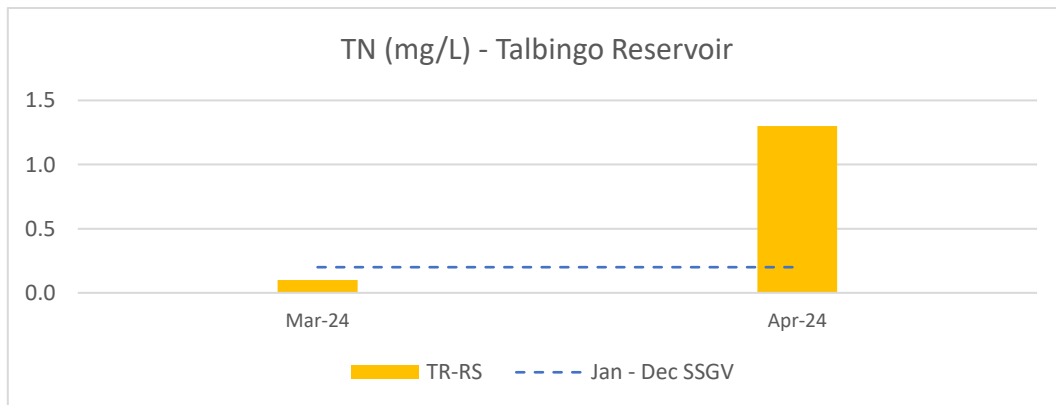


FIGURE 35: TOTAL NITROGEN FOR TALBINGO RESERVOIR

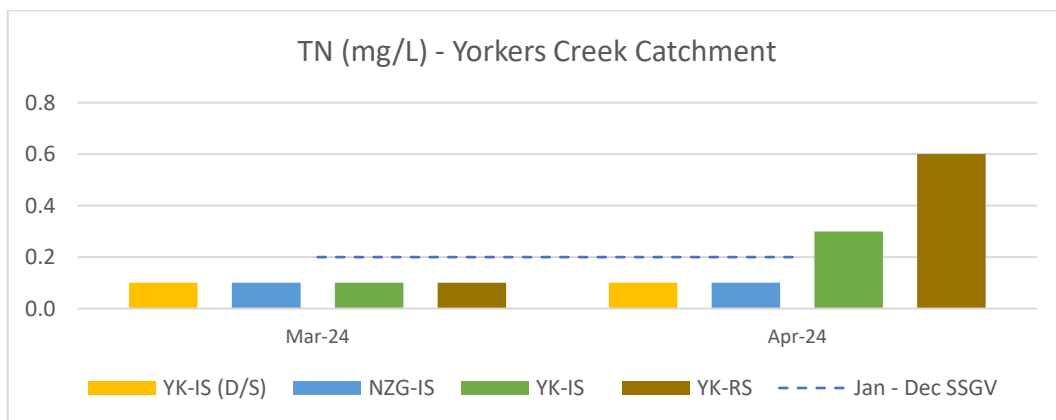


FIGURE 36: TOTAL NITROGEN FOR YORKERS CREEK CATCHMENT

Total Phosphorous

TP (mg/L) remained below the SSGV (0.02 mg/L) at all sites in the Yarrangobilly catchment, except for WC-IS, which recorded a significantly higher value of 0.09 mg/L. TP levels also exceeded the SSGV at the Yorkers Creek reference site (YK-RS: 0.04 mg/L), refer to Figure 37 to Figure 39.

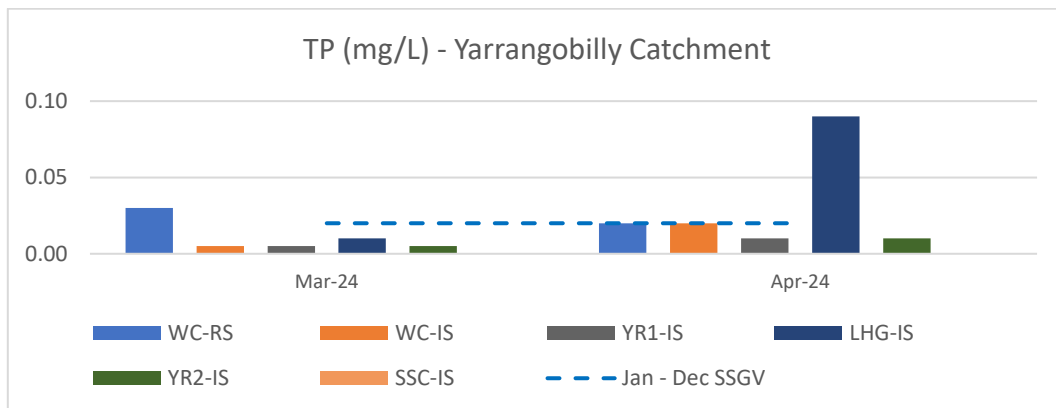


FIGURE 37: TOTAL PHOSPHOROUS FOR YARRANGOBILLY CATCHMENT

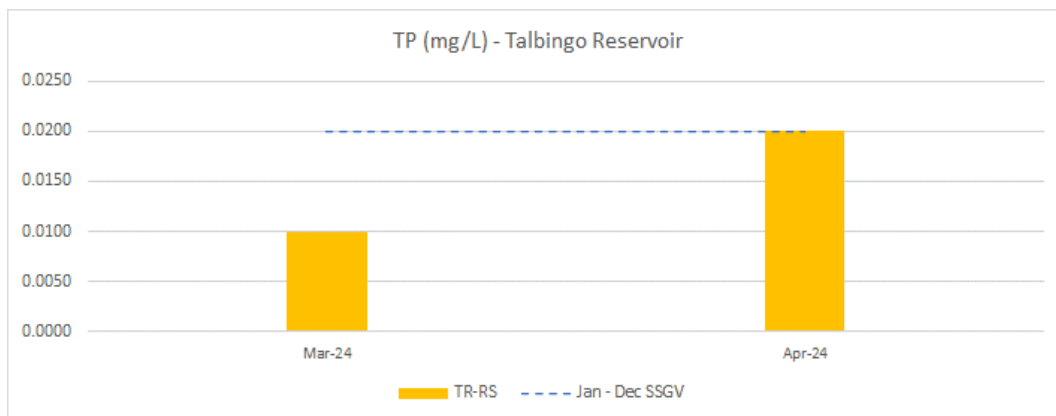


FIGURE 38: TOTAL PHOSPHOROUS FOR TALBINGO RESERVOIR

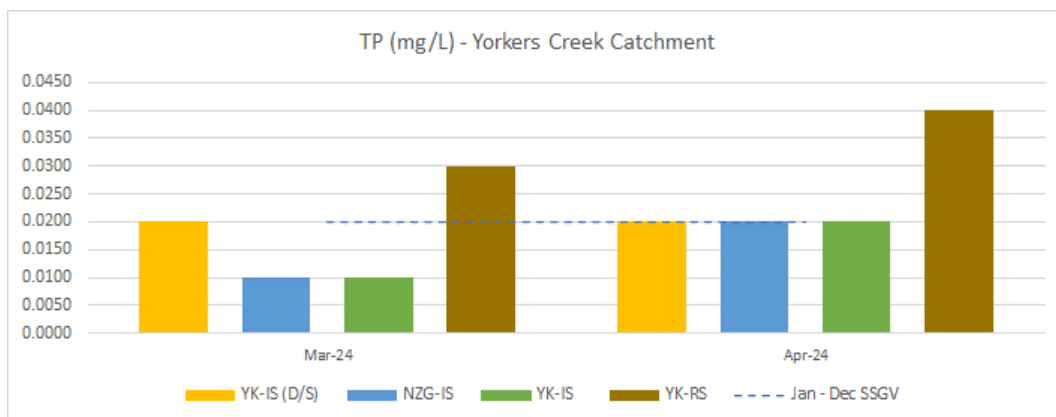


FIGURE 39: TOTAL PHOSPHOROUS FOR YORKERS CREEK CATCHMENT

5.2.2. Dissolved Metals

Dissolved metals exceeding the SSGV are listed in Table 4.

Table 4: Results for Dissolved Metals

| DISSOLVED METALS RESULTS | | | | |
|--------------------------|------------|---------------|------------|---|
| Analyte | Site | Result (mg/L) | SGV (mg/L) | Comment |
| Fe | WC-RS | 0.11 | 0.03 | Fe (mg/L) exceeded the SSGV for three sites within the Yarrangobilly catchment. All other sites across the catchments were either below the LOR or their respective SSGV. |
| | WC-IS | 0.07 | | |
| | LHG-IS | 0.34 | | |
| Mn | WC-RS | 0.007 | 0.002 | All reference sites, along with a number of impact sites exceeded the SSGV for Mn (mg/L). |
| | WC-IS | 0.006 | | |
| | LHG-IS | 0.184 | | |
| | TR-RS | 0.026 | 0.003 | |
| | YK-RS | 0.014 | 0.005 | |
| | YK-IS (DS) | 0.014 | | |
| | NZG-IS | 0.006 | | |
| | YK-IS | 0.016 | | |
| Cu | TR-RS | 0.005 | 0.0002 | Cu (mg/L) at Talbingo Reservoir was above the SSGV. All other sites across the catchments were either below the LOR or their respective SSGV. |

5.2.3. Total Metals

Total metals exceeding the DGV are listed in Table 5.

Table 5: Results for Total Metals

| TOTAL METALS RESULTS | | | | |
|----------------------|-------------|---------------|------------|---|
| Analyte | Site | Result (mg/L) | SGV (mg/L) | Comment |
| As | LHG-IS | 0.003 | 0.0008 | As (mg/L) exceeded the DGV for LHG-IS within the Yarrangobilly catchment. All other sites across the catchments were either below the LOR or their respective DGV. |
| Al | WC-IS | 0.15 | 0.027 | Al (mg/L) exceeded the DGV at the Yorkers Creek reference site (YK-RS), as well as at several impact sites within both the Yarrangobilly and Yorkers Creek catchments. |
| | LHG-IS | 0.25 | | |
| | YK-RS | 0.15 | | |
| | YK-IS (D/S) | 0.10 | | |
| | NZG-IS | 0.04 | | |
| | YK-IS | 0.15 | | |
| Zn | LHG-IS | 0.009 | 0.0024 | Zn (mg/L) exceeded the DGV in Talbingo Reservoir (TR-RS) and Yorkers Creek (YK-RS) reference sites. The impact site at LHG-IS also exceeded the DGV. |
| | TR-RS | 0.067 | | |
| | YK-RS | 0.016 | | |
| | YK-IS | 0.006 | | |
| Fe | LHG-IS | 2.22 | 0.3 | All sites were below either the DGV or the LOR, except for LHG-IS, which was significantly higher than the DGV, and YK-RS and YK-IS, which were slightly above the DGV. |
| | YK-RS | 0.46 | | |
| | YK-IS | 0.52 | | |
| Cu | LHG-IS | 0.002 | 0.001 | Cu (mg/L) at the reference sites for Talbingo Reservoir and Yorkers Creek were above the DGV. The impact site at LHG-IS was also above the DGV. All other sites were either below the LOR or the DGV. |
| | TR-RS | 0.006 | | |
| | YK-RS | 0.007 | | |

5.3. Discussion

Below is a summary of key observations and discussion points from the April monitoring results:

- Transmission line clearing and bulk earthworks activities were ongoing within the Yarrangobilly and Yorkers Creek catchment areas.
- Impact sites within the Yarrangobilly catchment are influenced by other activities associated with the Snowy 2.0 project.
- Cave Gully (CG-IS) and Sheep Station Creek (SSC-IS) impact sites within the Yarrangobilly catchment were both dry at the time of sampling.
- Lick Hole Gully (LHG-IS), within the Yarrangobilly catchment, has significantly exceeded the SSGV for multiple physical and chemical parameters, including metals. At the time of sampling, field observations at LHG-IS revealed shallow water with minimal flow and noticeable high silt deposition.

- Reactive phosphorous was not included in the lab sampling round in April.
- Many of the results are recorded as below (<) the LOR.
- The SSGV/DGV for a number of parameters is lower than the LOR from the laboratory.
- In both March and April, most parameters across the catchments generally complied with site specific guideline values (SSGVs). Instances of exceedances were largely isolated to specific sites, such as LHG-IS and YK-IS.
- A significant drop in temperature was recorded, with temperatures ranging from 5.4 °C to 12.3 °C, reflecting seasonal cooling.
- pH levels rose in the Yarrangobilly catchment, exceeding the upper limit (8.0) at multiple sites.
- DO levels fell below 90% in Talbingo Reservoir and Yorkers Creek, consistent with baseline data for these areas.
- Specific conductance exceedances were noted at LHG-IS in Yarrangobilly, while Talbingo Reservoir recorded significantly lower values.
- Slight exceedances in turbidity and TSS were noted at several sites, with spikes observed at LHG-IS, YK-RS, and YK-IS (D/S).
- TN exceeded SSGVs at Talbingo Reservoir and Yorkers Creek sites. TP exceeded guidelines at WC-IS and Yorkers Creek (YK-RS).
- Dissolved metals, including Fe, Mn, and Cu, frequently exceeded DGVs, especially at LHG-IS and Yorkers Creek sites.

6. CONCLUSION

The results from the construction SWQ monitoring program were reported for three key catchments: Yarrangobilly River, Talbingo Reservoir, and Yorkers Creek. Each catchment had a reference site, with impact sites also monitored for comparison. Key parameters such as temperature, pH, DO, SPC, turbidity, TSS, ammonia, nitrogen oxides, TKN, CaCO₃, TN, TP and metals (both dissolved and total) were analysed.

From March to April 2024, water quality monitoring across the catchments highlighted seasonal and site-specific variations. Temperature ranged from 5.4 °C to 12.3 °C, with the largest decreases observed in Talbingo Reservoir and Yorkers Creek catchment. pH levels rose, with the Yarrangobilly catchment exceeding the upper limit of 8.0 at multiple sites, while Talbingo Reservoir and Yorkers Creek remained within acceptable ranges. DO levels were consistently below 90% in Talbingo Reservoir and Yorkers Creek, consistent with baseline data, while most Yarrangobilly sites were within acceptable limits. SPC exceeded guidelines in Yarrangobilly, particularly at LHG-IS, while Talbingo Reservoir recorded significantly lower levels and Yorkers Creek consistently exceeded the SSGV. Turbidity and TSS slightly exceeded guidelines at several sites, with notable spikes at LHG-IS and reference site YK-RS and the associated impact site YK-IS (D/S). Ammonia levels were generally low, except at LHG-IS, and nitrogen oxides were below detection limits at most sites, though some impact sites, such as WC-IS, exceeded guidelines. TN exceeded the SSGV at the Talbingo Reservoir and Yorkers Creek reference sites and YK-IS and LHG-IS. TKN was undetectable at most sites except WC-IS and Talbingo Reservoir. TP exceeded the SSGV at WC-IS and the Yorkers Creek reference site. CaCO₃ exceeded guidelines in Yarrangobilly and Yorkers Creek but was within range at Talbingo Reservoir. Dissolved metals, including Fe, Mn and Cu, frequently surpassed DGVs, especially in the Yarrangobilly catchment. Total metals, such as As, Al, Zn and Cu, exceeded guidelines at multiple sites, including LHG-IS, YK-RS, and reference sites in Talbingo Reservoir and Yorkers Creek. Al, Zn, and Cu showed consistent exceedances, while As exceeded the SSGV at LHG-IS for the first time.

The results indicate that water quality at the sampling locations generally aligns with the SSGVs, with many parameters recorded below the thresholds. However, LHG-IS frequently exceeded the SSGV for various physical and chemical parameters. During sampling, this site was observed to have very shallow water, minimal flow, and significant silt deposition. NZG-IS recorded the highest specific conductance across all sampling rounds, including the baseline, with a slight increase to 67.1. Other exceedances were consistent with those observed at the catchment's reference site or documented in the baseline data.

REFERENCES

- ALS. (2024a). ES2414062. *Certificate of Analysis*. NSW, Australia: ALS Limited.
- ALS. (2024b). ES2414062. *QA/QC Compliance Assessment to assist with Quality Review*. NSW, Australia: ALS Limited.
- ALS. (2024c). ES2414062. *Quality Control Report*. NSW, Australia: ALS Limited.
- ANZG. (2018). *Australian and New Zealand Guidelines for Fresh and Marine Water Quality*. ACT, Australia: Australian and New Zealand Governments and Australian state and territory governments.
- Cohen, M. A., & Ryan, P. B. (1989). Observations Less than the Analytical Limit of Detection: A New Approach. *Journal of the Air Pollution Control Association*, 328-329.
- Jacobs. (2020). *Environmental Impact Statement*. NSW: Transgrid.
- NGH. (2022). *Pre-construction Water Quality Monitoring Program and Methodology*. NSW: NGH Pty Ltd.
- NGH. (2024). *Baseline Water Quality Report*. NSW: NGH Pty Ltd.
- UGL. (2024a). April 2024. *Water Quality Monitoring Field Data Sheet*. NSW, Australia: UGL Limited.
- UGL. (2024b). ES2414062. *Chain of Custody*. NSW, Australia: UGL Limited.
- UGL. (2024c). *Trigger Action Response Plan*. NSW, Australia: UGL Limited.



Appendix A: Field Sheet (UGL, 2024a)

Water Quality Monitoring Field Data Sheet



ate: 29.4.24

Sample Run: 2C

Sampling Purpose: Monthly surface monitoring

Samplers: Lachlan Whiteford

| Sample ID | Sample Location | Time | Temp (°C) | Water Pressure (mmHg) | Dissolved Oxygen (%) | Conductivity (SPC-µS/cm) | pH | Turbidity FNU | TSS (mg/L) | Water level | Description |
|------------|-----------------|------|-----------|-----------------------|----------------------|--------------------------|------|---------------|------------|-------------|--|
| WC-RS | East | 0900 | 10.7 | ██████████ | 94.8 | 145.6 | 8.44 | 1.05 | | | |
| WC-IS | East | 0915 | 10.7 | ██████████ | 95.0 | 145.2 | 8.45 | -0.90 | | | Debris like sticks settled in base covered in fine sediment, shallow |
| YR1-IS | East | 0950 | 11.3 | ██████████ | 97.4 | 136.1 | 8.49 | -1.23 | | | Very clear, solid flow |
| LHG-IS | East | 1030 | 12.5 | ██████████ | 8.4 | 658 | 7.69 | 69.72 | | | |
| YR2-IS | East | 1100 | 11.8 | ██████████ | 97.1 | 139.7 | 8.52 | 1.16 | | | Solid flow in parts of river, still surface |
| TR-RS | Reservoir | 1400 | 12.2 | ██████████ | 85.9 | 25.9 | 7.17 | 0.02 | | | No debris, water reflecting light. |
| SSC-IS | East | 1130 | | ██████████ | | | | | | | DRY |
| CG-IS | East | 1140 | | ██████████ | | | | | | | DRY |
| YK-IS (G1) | West | 1430 | 5.9 | ██████████ | 86.0 | 1.8 | 7.33 | 221.78 | | | Clear, low water level. |
| MZG-IS | West | 1500 | 6.4 | ██████████ | 84.9 | 67.1 | 7.38 | 0.96 | | | |
| YK-IS | West | 1530 | 6.2 | ██████████ | 80.7 | 36.5 | 7.04 | 12.37 | | | Wet muddy banks, fine sediment settled, low water levels |
| YK-RS | West | 1600 | 6.8 | ██████████ | 80.7 | 36.5 | 7.04 | 17.27 | | | |
| | | | | ██████████ | | | | | | | |
| | | | | ██████████ | | | | | | | |
| | | | | ██████████ | | | | | | | |
| | | | | ██████████ | | | | | | | |



**Appendix B: COA (ALS, 2024a), QA/QC Assessment (ALS, 2024b),
QCR (ALS, 2024c) and COC (UGL, 2024b)**



CERTIFICATE OF ANALYSIS

| | | | |
|-------------------------|---|-------------------------|---|
| Work Order | : ES2414062 | Page | : 1 of 8 |
| Client | : UGL LIMITED | Laboratory | : Environmental Division Sydney |
| Contact | : CAMILLE PALMER | Contact | : Customer Services ES |
| Address | : Level 4, 40 Miller Street North Sydney 2060 | Address | : 277-289 Woodpark Road Smithfield NSW Australia 2164 |
| Telephone | : ---- | Telephone | : +61-2-8784 8555 |
| Project | : 3200-0645 TransGrid Maragle 500/330kV Station. (Event 25) | Date Samples Received | : 01-May-2024 14:40 |
| Order number | : TBC | Date Analysis Commenced | : 01-May-2024 |
| C-O-C number | : ---- | Issue Date | : 08-May-2024 20:33 |
| Sampler | : ---- | | |
| Site | : Maragle/Lobs Hole | | |
| Quote number | : ES24UGLLIM0001_V2 | | |
| No. of samples received | : 12 | | |
| No. of samples analysed | : 12 | | |



This report supersedes any previous report(s) with this reference. Results apply to the sample(s) as submitted, unless the sampling was conducted by ALS. This document shall not be reproduced, except in full.

This Certificate of Analysis contains the following information:

- General Comments
- Analytical Results

Additional information pertinent to this report will be found in the following separate attachments: Quality Control Report, QA/QC Compliance Assessment to assist with Quality Review and Sample Receipt Notification.

Signatories

This document has been electronically signed by the authorized signatories below. Electronic signing is carried out in compliance with procedures specified in 21 CFR Part 11.

| Signatories | Position | Accreditation Category |
|---------------|-----------------------------|------------------------------------|
| Ankit Joshi | Senior Chemist - Inorganics | Sydney Inorganics, Smithfield, NSW |
| Wisam Marassa | Inorganics Coordinator | Sydney Inorganics, Smithfield, NSW |



General Comments

The analytical procedures used by ALS have been developed from established internationally recognised procedures such as those published by the USEPA, APHA, AS and NEPM. In house developed procedures are fully validated and are often at the client request.

Where moisture determination has been performed, results are reported on a dry weight basis.

Where a reported less than (<) result is higher than the LOR, this may be due to primary sample extract/digestate dilution and/or insufficient sample for analysis.

Where the LOR of a reported result differs from standard LOR, this may be due to high moisture content, insufficient sample (reduced weight employed) or matrix interference.

When sampling time information is not provided by the client, sampling dates are shown without a time component. In these instances, the time component has been assumed by the laboratory for processing purposes.

Where a result is required to meet compliance limits the associated uncertainty must be considered. Refer to the ALS Contract for details.

Key : CAS Number = CAS registry number from database maintained by Chemical Abstracts Services. The Chemical Abstracts Service is a division of the American Chemical Society.
LOR = Limit of reporting
^ = This result is computed from individual analyte detections at or above the level of reporting
ø = ALS is not NATA accredited for these tests.
~ = Indicates an estimated value.

- EG020: It is recognised that total concentration is less than dissolved for some metal analytes. However, the difference is within experimental variation of the methods.
- EG020-T : Insufficient sample has been provided to confirm positive results for ES2414062-012.
- EK067G,EK061G: LOR raised for TP and TKN on sample no.12 due to insufficient sample.
- Sodium Adsorption Ratio (where reported): Where results for Na, Ca or Mg are <LOR, a concentration at half the reported LOR is incorporated into the SAR calculation. This represents a conservative approach for Na relative to the assumption that <LOR = zero concentration and a conservative approach for Ca & Mg relative to the assumption that <LOR is equivalent to the LOR concentration.



Analytical Results

| Sub-Matrix: WATER (Matrix: WATER) | | | | Sample ID | WC-RS | WC-IS | YR1-RS | LHG-IS | YR2-RS |
|---|------------|--------|------|-------------------|-------------------|-------------------|-------------------|-------------------|--------|
| Sampling date / time | | | | 29-Apr-2024 14:55 | 29-Apr-2024 14:10 | 29-Apr-2024 13:25 | 29-Apr-2024 15:10 | 29-Apr-2024 15:50 | |
| Compound | CAS Number | LOR | Unit | ES2414062-001 | ES2414062-002 | ES2414062-003 | ES2414062-004 | ES2414062-005 | |
| | | | | Result | Result | Result | Result | Result | |
| EA025: Total Suspended Solids dried at 104 ± 2°C | | | | | | | | | |
| Suspended Solids (SS) | --- | 1 | mg/L | 1 | 11 | <1 | 70 | 5 | |
| ED093F: SAR and Hardness Calculations | | | | | | | | | |
| Total Hardness as CaCO3 | --- | 1 | mg/L | 70 | 67 | 61 | 332 | 61 | |
| EG020F: Dissolved Metals by ICP-MS | | | | | | | | | |
| Aluminium | 7429-90-5 | 0.01 | mg/L | <0.01 | <0.01 | <0.01 | <0.01 | <0.01 | |
| Arsenic | 7440-38-2 | 0.001 | mg/L | <0.001 | <0.001 | <0.001 | <0.001 | <0.001 | |
| Cadmium | 7440-43-9 | 0.0001 | mg/L | <0.0001 | <0.0001 | <0.0001 | <0.0001 | <0.0001 | |
| Chromium | 7440-47-3 | 0.001 | mg/L | <0.001 | <0.001 | <0.001 | <0.001 | <0.001 | |
| Copper | 7440-50-8 | 0.001 | mg/L | <0.001 | <0.001 | <0.001 | <0.001 | <0.001 | |
| Nickel | 7440-02-0 | 0.001 | mg/L | <0.001 | <0.001 | <0.001 | <0.001 | <0.001 | |
| Lead | 7439-92-1 | 0.001 | mg/L | <0.001 | <0.001 | <0.001 | <0.001 | <0.001 | |
| Zinc | 7440-66-6 | 0.005 | mg/L | <0.005 | <0.005 | <0.005 | <0.005 | <0.005 | |
| Manganese | 7439-96-5 | 0.001 | mg/L | 0.007 | 0.006 | 0.002 | 0.184 | 0.003 | |
| Silver | 7440-22-4 | 0.001 | mg/L | <0.001 | <0.001 | <0.001 | <0.001 | <0.001 | |
| Iron | 7439-89-6 | 0.05 | mg/L | 0.11 | 0.07 | <0.05 | 0.34 | <0.05 | |
| EG020T: Total Metals by ICP-MS | | | | | | | | | |
| Aluminium | 7429-90-5 | 0.01 | mg/L | 0.02 | 0.15 | 0.01 | 0.25 | 0.02 | |
| Arsenic | 7440-38-2 | 0.001 | mg/L | <0.001 | <0.001 | <0.001 | 0.003 | <0.001 | |
| Cadmium | 7440-43-9 | 0.0001 | mg/L | <0.0001 | <0.0001 | <0.0001 | <0.0001 | <0.0001 | |
| Chromium | 7440-47-3 | 0.001 | mg/L | <0.001 | <0.001 | <0.001 | <0.001 | <0.001 | |
| Copper | 7440-50-8 | 0.001 | mg/L | <0.001 | <0.001 | <0.001 | 0.002 | <0.001 | |
| Nickel | 7440-02-0 | 0.001 | mg/L | <0.001 | 0.004 | <0.001 | 0.006 | <0.001 | |
| Lead | 7439-92-1 | 0.001 | mg/L | <0.001 | <0.001 | <0.001 | <0.001 | <0.001 | |
| Zinc | 7440-66-6 | 0.005 | mg/L | <0.005 | <0.005 | <0.005 | 0.009 | <0.005 | |
| Manganese | 7439-96-5 | 0.001 | mg/L | 0.010 | 0.022 | 0.002 | 0.510 | 0.004 | |
| Silver | 7440-22-4 | 0.001 | mg/L | <0.001 | <0.001 | <0.001 | <0.001 | <0.001 | |
| Iron | 7439-89-6 | 0.05 | mg/L | <0.05 | 0.22 | <0.05 | 2.22 | <0.05 | |



Analytical Results

| Sub-Matrix: WATER (Matrix: WATER) | | | | Sample ID | WC-RS | WC-IS | YR1-RS | LHG-IS | YR2-RS |
|---|------------|--------|------|---------------|-------------------|-------------------|-------------------|-------------------|-------------------|
| Sampling date / time | | | | | 29-Apr-2024 14:55 | 29-Apr-2024 14:10 | 29-Apr-2024 13:25 | 29-Apr-2024 15:10 | 29-Apr-2024 15:50 |
| Compound | CAS Number | LOR | Unit | ES2414062-001 | ES2414062-002 | ES2414062-003 | ES2414062-004 | ES2414062-005 | |
| | | | | Result | Result | Result | Result | Result | |
| EG035F: Dissolved Mercury by FIMS | | | | | | | | | |
| Mercury | 7439-97-6 | 0.0001 | mg/L | <0.0001 | <0.0001 | <0.0001 | <0.0001 | <0.0001 | |
| EG035T: Total Recoverable Mercury by FIMS | | | | | | | | | |
| Mercury | 7439-97-6 | 0.0001 | mg/L | <0.0001 | <0.0001 | <0.0001 | <0.0001 | <0.0001 | |
| EK026SF: Total CN by Segmented Flow Analyser | | | | | | | | | |
| Total Cyanide | 57-12-5 | 0.002 | mg/L | <0.002 | <0.002 | <0.002 | <0.002 | <0.002 | |
| EK055G: Ammonia as N by Discrete Analyser | | | | | | | | | |
| Ammonia as N | 7664-41-7 | 0.01 | mg/L | <0.01 | <0.01 | <0.01 | 0.02 | <0.01 | |
| EK057G: Nitrite as N by Discrete Analyser | | | | | | | | | |
| Nitrite as N | 14797-65-0 | 0.01 | mg/L | <0.01 | <0.01 | <0.01 | <0.01 | <0.01 | |
| EK058G: Nitrate as N by Discrete Analyser | | | | | | | | | |
| Nitrate as N | 14797-55-8 | 0.01 | mg/L | <0.01 | 2.42 | 0.05 | 0.02 | 0.01 | |
| EK059G: Nitrite plus Nitrate as N (NOx) by Discrete Analyser | | | | | | | | | |
| Nitrite + Nitrate as N | ---- | 0.01 | mg/L | <0.01 | 2.42 | 0.05 | 0.02 | 0.01 | |
| EK061G: Total Kjeldahl Nitrogen By Discrete Analyser | | | | | | | | | |
| Total Kjeldahl Nitrogen as N | ---- | 0.1 | mg/L | <0.1 | 0.3 | <0.1 | 0.5 | <0.1 | |
| EK062G: Total Nitrogen as N (TKN + NOx) by Discrete Analyser | | | | | | | | | |
| [^] Total Nitrogen as N | ---- | 0.1 | mg/L | <0.1 | 2.7 | <0.1 | 0.5 | <0.1 | |
| EK067G: Total Phosphorus as P by Discrete Analyser | | | | | | | | | |
| Total Phosphorus as P | ---- | 0.01 | mg/L | 0.02 | 0.02 | <0.01 | 0.09 | 0.01 | |
| EK071G: Reactive Phosphorus as P by discrete analyser | | | | | | | | | |
| Reactive Phosphorus as P | 14265-44-2 | 0.01 | mg/L | <0.01 | <0.01 | <0.01 | <0.01 | <0.01 | |



Analytical Results

| Sub-Matrix: WATER (Matrix: WATER) | | | | Sample ID | TR-RS | YK-IS(d/s) | NZG-IS | YK-IS | YK-RS |
|---|------------|--------|------|-------------------|-------------------|-------------------|-------------------|-------------------|-------|
| Sampling date / time | | | | 29-Apr-2024 10:15 | 29-Apr-2024 09:31 | 29-Apr-2024 07:40 | 29-Apr-2024 08:58 | 29-Apr-2024 08:23 | |
| Compound | CAS Number | LOR | Unit | ES2414062-006 | ES2414062-007 | ES2414062-008 | ES2414062-009 | ES2414062-010 | |
| | | | | Result | Result | Result | Result | Result | |
| EA025: Total Suspended Solids dried at 104 ± 2°C | | | | | | | | | |
| Suspended Solids (SS) | --- | 1 | mg/L | 3 | 3 | 6 | 13 | 24 | |
| ED093F: SAR and Hardness Calculations | | | | | | | | | |
| Total Hardness as CaCO3 | --- | 1 | mg/L | 5 | 16 | 23 | 12 | 9 | |
| EG020F: Dissolved Metals by ICP-MS | | | | | | | | | |
| Aluminium | 7429-90-5 | 0.01 | mg/L | 0.01 | 0.05 | 0.03 | 0.09 | 0.10 | |
| Arsenic | 7440-38-2 | 0.001 | mg/L | <0.001 | <0.001 | <0.001 | <0.001 | <0.001 | |
| Cadmium | 7440-43-9 | 0.0001 | mg/L | <0.0001 | <0.0001 | <0.0001 | <0.0001 | <0.0001 | |
| Chromium | 7440-47-3 | 0.001 | mg/L | <0.001 | <0.001 | <0.001 | <0.001 | <0.001 | |
| Copper | 7440-50-8 | 0.001 | mg/L | 0.005 | <0.001 | <0.001 | <0.001 | 0.007 | |
| Nickel | 7440-02-0 | 0.001 | mg/L | <0.001 | 0.001 | <0.001 | <0.001 | <0.001 | |
| Lead | 7439-92-1 | 0.001 | mg/L | <0.001 | <0.001 | <0.001 | <0.001 | <0.001 | |
| Zinc | 7440-66-6 | 0.005 | mg/L | 0.066 | <0.005 | <0.005 | <0.005 | 0.013 | |
| Manganese | 7439-96-5 | 0.001 | mg/L | 0.026 | 0.014 | 0.006 | 0.016 | 0.014 | |
| Silver | 7440-22-4 | 0.001 | mg/L | <0.001 | <0.001 | <0.001 | <0.001 | <0.001 | |
| Iron | 7439-89-6 | 0.05 | mg/L | <0.05 | 0.11 | 0.08 | 0.15 | 0.12 | |
| EG020T: Total Metals by ICP-MS | | | | | | | | | |
| Aluminium | 7429-90-5 | 0.01 | mg/L | 0.02 | 0.10 | 0.04 | 0.15 | 0.15 | |
| Arsenic | 7440-38-2 | 0.001 | mg/L | <0.001 | <0.001 | <0.001 | <0.001 | <0.001 | |
| Cadmium | 7440-43-9 | 0.0001 | mg/L | <0.0001 | <0.0001 | <0.0001 | <0.0001 | <0.0001 | |
| Chromium | 7440-47-3 | 0.001 | mg/L | <0.001 | <0.001 | <0.001 | <0.001 | <0.001 | |
| Copper | 7440-50-8 | 0.001 | mg/L | 0.006 | <0.001 | <0.001 | <0.001 | 0.007 | |
| Nickel | 7440-02-0 | 0.001 | mg/L | 0.002 | 0.003 | <0.001 | <0.001 | 0.006 | |
| Lead | 7439-92-1 | 0.001 | mg/L | <0.001 | <0.001 | <0.001 | <0.001 | <0.001 | |
| Zinc | 7440-66-6 | 0.005 | mg/L | 0.067 | 0.006 | <0.005 | <0.005 | 0.016 | |
| Manganese | 7439-96-5 | 0.001 | mg/L | 0.039 | 0.016 | 0.012 | 0.024 | 0.021 | |
| Silver | 7440-22-4 | 0.001 | mg/L | <0.001 | <0.001 | <0.001 | <0.001 | <0.001 | |
| Iron | 7439-89-6 | 0.05 | mg/L | 0.07 | 0.26 | 0.24 | 0.52 | 0.46 | |



Analytical Results

| Sub-Matrix: WATER (Matrix: WATER) | | | | Sample ID | TR-RS | YK-IS(d/s) | NZG-IS | YK-IS | YK-RS |
|---|------------|--------|------|---------------|-------------------|-------------------|-------------------|-------------------|-------------------|
| Sampling date / time | | | | | 29-Apr-2024 10:15 | 29-Apr-2024 09:31 | 29-Apr-2024 07:40 | 29-Apr-2024 08:58 | 29-Apr-2024 08:23 |
| Compound | CAS Number | LOR | Unit | ES2414062-006 | ES2414062-007 | ES2414062-008 | ES2414062-009 | ES2414062-010 | |
| | | | | Result | Result | Result | Result | Result | |
| EG035F: Dissolved Mercury by FIMS | | | | | | | | | |
| Mercury | 7439-97-6 | 0.0001 | mg/L | <0.0001 | <0.0001 | <0.0001 | <0.0001 | <0.0001 | |
| EG035T: Total Recoverable Mercury by FIMS | | | | | | | | | |
| Mercury | 7439-97-6 | 0.0001 | mg/L | <0.0001 | <0.0001 | <0.0001 | <0.0001 | <0.0001 | |
| EK026SF: Total CN by Segmented Flow Analyser | | | | | | | | | |
| Total Cyanide | 57-12-5 | 0.002 | mg/L | <0.002 | <0.002 | <0.002 | <0.002 | <0.002 | |
| EK055G: Ammonia as N by Discrete Analyser | | | | | | | | | |
| Ammonia as N | 7664-41-7 | 0.01 | mg/L | 0.03 | <0.01 | <0.01 | <0.01 | 0.02 | |
| EK057G: Nitrite as N by Discrete Analyser | | | | | | | | | |
| Nitrite as N | 14797-65-0 | 0.01 | mg/L | <0.01 | <0.01 | <0.01 | <0.01 | <0.01 | |
| EK058G: Nitrate as N by Discrete Analyser | | | | | | | | | |
| Nitrate as N | 14797-55-8 | 0.01 | mg/L | 0.12 | 0.03 | <0.01 | 0.06 | 0.02 | |
| EK059G: Nitrite plus Nitrate as N (NOx) by Discrete Analyser | | | | | | | | | |
| Nitrite + Nitrate as N | ---- | 0.01 | mg/L | 0.12 | 0.03 | <0.01 | 0.06 | 0.02 | |
| EK061G: Total Kjeldahl Nitrogen By Discrete Analyser | | | | | | | | | |
| Total Kjeldahl Nitrogen as N | ---- | 0.1 | mg/L | 1.2 | 0.1 | <0.1 | 0.2 | 0.6 | |
| EK062G: Total Nitrogen as N (TKN + NOx) by Discrete Analyser | | | | | | | | | |
| [^] Total Nitrogen as N | ---- | 0.1 | mg/L | 1.3 | 0.1 | <0.1 | 0.3 | 0.6 | |
| EK067G: Total Phosphorus as P by Discrete Analyser | | | | | | | | | |
| Total Phosphorus as P | ---- | 0.01 | mg/L | 0.02 | 0.02 | 0.02 | 0.02 | 0.04 | |
| EK071G: Reactive Phosphorus as P by discrete analyser | | | | | | | | | |
| Reactive Phosphorus as P | 14265-44-2 | 0.01 | mg/L | <0.01 | <0.01 | <0.01 | <0.01 | <0.01 | |



Analytical Results

| Sub-Matrix: WATER (Matrix: WATER) | | | | Sample ID | DUP01 | WATERBLANK | ---- | ---- | ---- |
|---|------------|--------|------|-------------------|-------------------|------------|-------|-------|------|
| Sampling date / time | | | | 29-Apr-2024 00:00 | 29-Apr-2024 00:00 | ---- | ---- | ---- | |
| Compound | CAS Number | LOR | Unit | ES2414062-011 | ES2414062-012 | ----- | ----- | ----- | |
| | | | | Result | Result | ---- | ---- | ---- | |
| EA025: Total Suspended Solids dried at 104 ± 2°C | | | | | | | | | |
| Suspended Solids (SS) | ---- | 1 | mg/L | ---- | <1 | ---- | ---- | ---- | |
| ED093F: SAR and Hardness Calculations | | | | | | | | | |
| Total Hardness as CaCO3 | ---- | 1 | mg/L | ---- | <1 | ---- | ---- | ---- | |
| EG020F: Dissolved Metals by ICP-MS | | | | | | | | | |
| Aluminium | 7429-90-5 | 0.01 | mg/L | <0.01 | <0.01 | ---- | ---- | ---- | |
| Arsenic | 7440-38-2 | 0.001 | mg/L | <0.001 | <0.001 | ---- | ---- | ---- | |
| Cadmium | 7440-43-9 | 0.0001 | mg/L | <0.0001 | <0.0001 | ---- | ---- | ---- | |
| Chromium | 7440-47-3 | 0.001 | mg/L | <0.001 | <0.001 | ---- | ---- | ---- | |
| Copper | 7440-50-8 | 0.001 | mg/L | <0.001 | <0.001 | ---- | ---- | ---- | |
| Nickel | 7440-02-0 | 0.001 | mg/L | <0.001 | <0.001 | ---- | ---- | ---- | |
| Lead | 7439-92-1 | 0.001 | mg/L | <0.001 | <0.001 | ---- | ---- | ---- | |
| Zinc | 7440-66-6 | 0.005 | mg/L | <0.005 | <0.005 | ---- | ---- | ---- | |
| Manganese | 7439-96-5 | 0.001 | mg/L | <0.001 | <0.001 | ---- | ---- | ---- | |
| Silver | 7440-22-4 | 0.001 | mg/L | <0.001 | <0.001 | ---- | ---- | ---- | |
| Iron | 7439-89-6 | 0.05 | mg/L | <0.05 | <0.05 | ---- | ---- | ---- | |
| EG020T: Total Metals by ICP-MS | | | | | | | | | |
| Aluminium | 7429-90-5 | 0.01 | mg/L | 0.02 | <0.01 | ---- | ---- | ---- | |
| Arsenic | 7440-38-2 | 0.001 | mg/L | <0.001 | <0.001 | ---- | ---- | ---- | |
| Cadmium | 7440-43-9 | 0.0001 | mg/L | <0.0001 | <0.0001 | ---- | ---- | ---- | |
| Chromium | 7440-47-3 | 0.001 | mg/L | <0.001 | <0.001 | ---- | ---- | ---- | |
| Copper | 7440-50-8 | 0.001 | mg/L | <0.001 | <0.001 | ---- | ---- | ---- | |
| Nickel | 7440-02-0 | 0.001 | mg/L | <0.001 | 0.003 | ---- | ---- | ---- | |
| Lead | 7439-92-1 | 0.001 | mg/L | <0.001 | <0.001 | ---- | ---- | ---- | |
| Zinc | 7440-66-6 | 0.005 | mg/L | <0.005 | <0.005 | ---- | ---- | ---- | |
| Manganese | 7439-96-5 | 0.001 | mg/L | 0.002 | <0.001 | ---- | ---- | ---- | |
| Silver | 7440-22-4 | 0.001 | mg/L | <0.001 | <0.001 | ---- | ---- | ---- | |
| Iron | 7439-89-6 | 0.05 | mg/L | <0.05 | <0.05 | ---- | ---- | ---- | |



Analytical Results

| Sub-Matrix: WATER (Matrix: WATER) | | | | Sample ID | DUP01 | WATERBLANK | ---- | ---- | ---- |
|---|------------|--------|------|-------------------|-------------------|------------|-------|-------|------|
| Sampling date / time | | | | 29-Apr-2024 00:00 | 29-Apr-2024 00:00 | ---- | ---- | ---- | |
| Compound | CAS Number | LOR | Unit | ES2414062-011 | ES2414062-012 | ----- | ----- | ----- | |
| | | | | Result | Result | ---- | ---- | ---- | |
| EG035F: Dissolved Mercury by FIMS | | | | | | | | | |
| Mercury | 7439-97-6 | 0.0001 | mg/L | <0.0001 | <0.0001 | ---- | ---- | ---- | |
| EG035T: Total Recoverable Mercury by FIMS | | | | | | | | | |
| Mercury | 7439-97-6 | 0.0001 | mg/L | <0.0001 | <0.0001 | ---- | ---- | ---- | |
| EK055G: Ammonia as N by Discrete Analyser | | | | | | | | | |
| Ammonia as N | 7664-41-7 | 0.01 | mg/L | ---- | <0.01 | ---- | ---- | ---- | |
| EK057G: Nitrite as N by Discrete Analyser | | | | | | | | | |
| Nitrite as N | 14797-65-0 | 0.01 | mg/L | ---- | <0.01 | ---- | ---- | ---- | |
| EK058G: Nitrate as N by Discrete Analyser | | | | | | | | | |
| Nitrate as N | 14797-55-8 | 0.01 | mg/L | ---- | <0.01 | ---- | ---- | ---- | |
| EK059G: Nitrite plus Nitrate as N (NOx) by Discrete Analyser | | | | | | | | | |
| Nitrite + Nitrate as N | ---- | 0.01 | mg/L | ---- | <0.01 | ---- | ---- | ---- | |
| EK061G: Total Kjeldahl Nitrogen By Discrete Analyser | | | | | | | | | |
| Total Kjeldahl Nitrogen as N | ---- | 0.1 | mg/L | ---- | <0.2 | ---- | ---- | ---- | |
| EK062G: Total Nitrogen as N (TKN + NOx) by Discrete Analyser | | | | | | | | | |
| ^ Total Nitrogen as N | ---- | 0.1 | mg/L | ---- | <0.2 | ---- | ---- | ---- | |
| EK067G: Total Phosphorus as P by Discrete Analyser | | | | | | | | | |
| Total Phosphorus as P | ---- | 0.01 | mg/L | ---- | <0.02 | ---- | ---- | ---- | |
| EK071G: Reactive Phosphorus as P by discrete analyser | | | | | | | | | |
| Reactive Phosphorus as P | 14265-44-2 | 0.01 | mg/L | ---- | <0.01 | ---- | ---- | ---- | |



QA/QC Compliance Assessment to assist with Quality Review

| | | | |
|--------------|---|-------------------------|---------------------------------|
| Work Order | : ES2414062 | Page | : 1 of 9 |
| Client | : UGL LIMITED | Laboratory | : Environmental Division Sydney |
| Contact | : CAMILLE PALMER | Telephone | : +61-2-8784 8555 |
| Project | : 3200-0645 TransGrid Maragle 500/330kV Station. (Event 25) | Date Samples Received | : 01-May-2024 |
| Site | : Maragle/Lobs Hole | Issue Date | : 08-May-2024 |
| Sampler | : ---- | No. of samples received | : 12 |
| Order number | : TBC | No. of samples analysed | : 12 |

This report is automatically generated by the ALS LIMS through interpretation of the ALS Quality Control Report and several Quality Assurance parameters measured by ALS. This automated reporting highlights any non-conformances, facilitates faster and more accurate data validation and is designed to assist internal expert and external Auditor review. Many components of this report contribute to the overall DQO assessment and reporting for guideline compliance.

Brief method summaries and references are also provided to assist in traceability.

Summary of Outliers

Outliers : Quality Control Samples

This report highlights outliers flagged in the Quality Control (QC) Report.

- **NO** Method Blank value outliers occur.
- **NO** Duplicate outliers occur.
- **NO** Laboratory Control outliers occur.
- **NO** Matrix Spike outliers occur.
- For all regular sample matrices, **NO** surrogate recovery outliers occur.

Outliers : Analysis Holding Time Compliance

- Analysis Holding Time Outliers exist - please see following pages for full details.

Outliers : Frequency of Quality Control Samples

- Quality Control Sample Frequency Outliers exist - please see following pages for full details.



Outliers : Analysis Holding Time Compliance

Matrix: WATER

| Method | Extraction / Preparation | | | Analysis | | | |
|---|---------------------------------|----------------|--------------------|--------------|---------------|------------------|--------------|
| | Container / Client Sample ID(s) | Date extracted | Due for extraction | Days overdue | Date analysed | Due for analysis | Days overdue |
| EK055G: Ammonia as N by Discrete Analyser | | | | | | | |
| Clear Plastic Bottle - Natural WATERBLANK | ---- | ---- | ---- | | 06-May-2024 | 30-Apr-2024 | 6 |
| EK059G: Nitrite plus Nitrate as N (NOx) by Discrete Analyser | | | | | | | |
| Clear Plastic Bottle - Natural WATERBLANK | ---- | ---- | ---- | | 06-May-2024 | 01-May-2024 | 5 |
| EK061G: Total Kjeldahl Nitrogen By Discrete Analyser | | | | | | | |
| Clear Plastic Bottle - Natural WATERBLANK | 06-May-2024 | 30-Apr-2024 | 6 | | ---- | ---- | ---- |
| EK067G: Total Phosphorus as P by Discrete Analyser | | | | | | | |
| Clear Plastic Bottle - Natural WATERBLANK | 06-May-2024 | 01-May-2024 | 5 | | ---- | ---- | ---- |

Outliers : Frequency of Quality Control Samples

Matrix: WATER

| Quality Control Sample Type | Method | Count | | Rate (%) | | Quality Control Specification |
|------------------------------------|--------|-------|---------|----------|----------|--------------------------------|
| | | QC | Regular | Actual | Expected | |
| Laboratory Duplicates (DUP) | | | | | | |
| Ammonia as N by Discrete analyser | EK055G | 1 | 16 | 6.25 | 10.00 | NEPM 2013 B3 & ALS QC Standard |
| Matrix Spikes (MS) | | | | | | |
| Ammonia as N by Discrete analyser | EK055G | 0 | 16 | 0.00 | 5.00 | NEPM 2013 B3 & ALS QC Standard |

Analysis Holding Time Compliance

If samples are identified below as having been analysed or extracted outside of recommended holding times, this should be taken into consideration when interpreting results. This report summarizes extraction / preparation and analysis times and compares each with ALS recommended holding times (referencing USEPA SW 846, APHA, AS and NEPM) based on the sample container provided. Dates reported represent first date of extraction or analysis and preclude subsequent dilutions and reruns. A listing of breaches (if any) is provided herein. Holding time for leachate methods (e.g. TCLP) vary according to the analytes reported. Assessment compares the leach date with the shortest analyte holding time for the equivalent soil method. These are: organics 14 days, mercury 28 days & other metals 180 days. A recorded breach does not guarantee a breach for all non-volatile parameters. Holding times for VOC in soils vary according to analytes of interest. Vinyl Chloride and Styrene holding time is 7 days; others 14 days. A recorded breach does not guarantee a breach for all VOC analytes and should be verified in case the reported breach is a false positive or Vinyl Chloride and Styrene are not key analytes of interest/concern.

Matrix: WATER

Evaluation: * = Holding time breach ; ✓ = Within holding time.

| Method | Sample Date | Extraction / Preparation | | | Analysis | | |
|--------|-------------|---------------------------------|----------------|--------------------|------------|---------------|------------------|
| | | Container / Client Sample ID(s) | Date extracted | Due for extraction | Evaluation | Date analysed | Due for analysis |



Matrix: **WATER** Evaluation: * = Holding time breach ; ✓ = Within holding time.

| Method Container / Client Sample ID(s) | Sample Date | Extraction / Preparation | | | Analysis | | |
|---|-------------|--------------------------|--------------------|------------|---------------|------------------|------------|
| | | Date extracted | Due for extraction | Evaluation | Date analysed | Due for analysis | Evaluation |
| EA025: Total Suspended Solids dried at 104 ± 2°C | | | | | | | |
| Clear Plastic Bottle - Natural (EA025) WC-RS, WC-IS, YR1-RS, LHG-IS, YR2-RS, TR-RS, YK-IS(d/s), NZG-IS, YK-IS, YK-RS, WATERBLANK | 29-Apr-2024 | ---- | ---- | ---- | 03-May-2024 | 06-May-2024 | ✓ |
| ED093F: SAR and Hardness Calculations | | | | | | | |
| Clear Plastic Bottle - Natural (ED093F) WATERBLANK | 29-Apr-2024 | ---- | ---- | ---- | 03-May-2024 | 06-May-2024 | ✓ |
| Clear Plastic Bottle - Nitric Acid; Filtered (ED093F) WC-RS, WC-IS, YR1-RS, LHG-IS, YR2-RS, TR-RS, YK-IS(d/s), NZG-IS, YK-IS, YK-RS | 29-Apr-2024 | ---- | ---- | ---- | 03-May-2024 | 27-May-2024 | ✓ |
| EG020F: Dissolved Metals by ICP-MS | | | | | | | |
| Clear Plastic Bottle - Natural (EG020B-F) DUP01, WATERBLANK | 29-Apr-2024 | ---- | ---- | ---- | 03-May-2024 | 26-Oct-2024 | ✓ |
| Clear Plastic Bottle - Nitric Acid; Filtered (EG020B-F) WC-RS, WC-IS, YR1-RS, LHG-IS, YR2-RS, TR-RS, YK-IS(d/s), NZG-IS, YK-IS, YK-RS | 29-Apr-2024 | ---- | ---- | ---- | 03-May-2024 | 26-Oct-2024 | ✓ |
| EG020T: Total Metals by ICP-MS | | | | | | | |
| Clear Plastic Bottle - Natural (EG020B-T) DUP01, WATERBLANK | 29-Apr-2024 | 03-May-2024 | 26-Oct-2024 | ✓ | 03-May-2024 | 26-Oct-2024 | ✓ |
| Clear Plastic Bottle - Nitric Acid; Unfiltered (EG020B-T) WC-RS, WC-IS, YR1-RS, LHG-IS, YR2-RS, TR-RS, YK-IS(d/s), NZG-IS, YK-IS, YK-RS | 29-Apr-2024 | 03-May-2024 | 26-Oct-2024 | ✓ | 03-May-2024 | 26-Oct-2024 | ✓ |



Matrix: **WATER** Evaluation: ✖ = Holding time breach ; ✔ = Within holding time.

| Method Container / Client Sample ID(s) | Sample Date | Extraction / Preparation | | | Analysis | | |
|--|-------------|--------------------------|--------------------|------------|---------------|------------------|------------|
| | | Date extracted | Due for extraction | Evaluation | Date analysed | Due for analysis | Evaluation |
| EG035F: Dissolved Mercury by FIMS | | | | | | | |
| Clear Plastic Bottle - Natural (EG035F) DUP01, WATERBLANK | 29-Apr-2024 | ---- | ---- | ---- | 06-May-2024 | 27-May-2024 | ✔ |
| Clear Plastic Bottle - Nitric Acid; Filtered (EG035F) WC-RS, YR1-RS, YR2-RS, YK-IS(d/s), YK-IS, WC-IS, LHG-IS, TR-RS, NZG-IS, YK-RS | 29-Apr-2024 | ---- | ---- | ---- | 06-May-2024 | 27-May-2024 | ✔ |
| EG035T: Total Recoverable Mercury by FIMS | | | | | | | |
| Clear Plastic Bottle - Natural (EG035T) DUP01, WATERBLANK | 29-Apr-2024 | ---- | ---- | ---- | 06-May-2024 | 27-May-2024 | ✔ |
| Clear Plastic Bottle - Nitric Acid; Unfiltered (EG035T) WC-RS, YR1-RS, YR2-RS, YK-IS(d/s), YK-IS, WC-IS, LHG-IS, TR-RS, NZG-IS, YK-RS | 29-Apr-2024 | ---- | ---- | ---- | 06-May-2024 | 27-May-2024 | ✔ |
| EK026SF: Total CN by Segmented Flow Analyser | | | | | | | |
| Opaque plastic bottle - NaOH (EK026SF) WC-RS, YR1-RS, YR2-RS, YK-IS(d/s), YK-IS, WC-IS, LHG-IS, TR-RS, NZG-IS, YK-RS | 29-Apr-2024 | ---- | ---- | ---- | 07-May-2024 | 13-May-2024 | ✔ |
| EK055G: Ammonia as N by Discrete Analyser | | | | | | | |
| Clear Plastic Bottle - Natural (EK055G) WATERBLANK | 29-Apr-2024 | ---- | ---- | ---- | 06-May-2024 | 30-Apr-2024 | ✖ |
| Clear Plastic Bottle - Sulfuric Acid (EK055G) WC-RS, YR1-RS, YR2-RS, YK-IS(d/s), YK-IS, WC-IS, LHG-IS, TR-RS, NZG-IS, YK-RS | 29-Apr-2024 | ---- | ---- | ---- | 07-May-2024 | 27-May-2024 | ✔ |
| EK057G: Nitrite as N by Discrete Analyser | | | | | | | |
| Clear Plastic Bottle - Natural (EK057G) WC-RS, YR1-RS, YR2-RS, YK-IS(d/s), YK-IS, WATERBLANK, WC-IS, LHG-IS, TR-RS, NZG-IS, YK-RS | 29-Apr-2024 | ---- | ---- | ---- | 01-May-2024 | 01-May-2024 | ✔ |



Matrix: **WATER** Evaluation: ✘ = Holding time breach ; ✔ = Within holding time.

| Method Container / Client Sample ID(s) | Sample Date | Extraction / Preparation | | | Analysis | | |
|---|-------------|--------------------------|--------------------|------------|---------------|------------------|------------|
| | | Date extracted | Due for extraction | Evaluation | Date analysed | Due for analysis | Evaluation |
| EK059G: Nitrite plus Nitrate as N (NOx) by Discrete Analyser | | | | | | | |
| Clear Plastic Bottle - Natural (EK059G) WATERBLANK | 29-Apr-2024 | ---- | ---- | ---- | 06-May-2024 | 01-May-2024 | ✘ |
| Clear Plastic Bottle - Sulfuric Acid (EK059G) WC-RS, WC-IS, YR1-RS, LHG-IS, YR2-RS, TR-RS, YK-IS(d/s), NZG-IS, YK-IS, YK-RS | 29-Apr-2024 | ---- | ---- | ---- | 07-May-2024 | 27-May-2024 | ✔ |
| EK061G: Total Kjeldahl Nitrogen By Discrete Analyser | | | | | | | |
| Clear Plastic Bottle - Natural (EK061G) WATERBLANK | 29-Apr-2024 | 06-May-2024 | 30-Apr-2024 | ✘ | 06-May-2024 | 03-Jun-2024 | ✔ |
| Clear Plastic Bottle - Sulfuric Acid (EK061G) WC-RS, WC-IS, YR1-RS, LHG-IS, YR2-RS, TR-RS, YK-IS(d/s), NZG-IS, YK-IS, YK-RS | 29-Apr-2024 | 06-May-2024 | 27-May-2024 | ✔ | 06-May-2024 | 27-May-2024 | ✔ |
| EK067G: Total Phosphorus as P by Discrete Analyser | | | | | | | |
| Clear Plastic Bottle - Natural (EK067G) WATERBLANK | 29-Apr-2024 | 06-May-2024 | 01-May-2024 | ✘ | 06-May-2024 | 03-Jun-2024 | ✔ |
| Clear Plastic Bottle - Sulfuric Acid (EK067G) WC-RS, WC-IS, YR1-RS, LHG-IS, YR2-RS, TR-RS, YK-IS(d/s), NZG-IS, YK-IS, YK-RS | 29-Apr-2024 | 06-May-2024 | 27-May-2024 | ✔ | 06-May-2024 | 27-May-2024 | ✔ |
| EK071G: Reactive Phosphorus as P by discrete analyser | | | | | | | |
| Clear Plastic Bottle - Natural (EK071G) WC-RS, WC-IS, YR1-RS, LHG-IS, YR2-RS, TR-RS, YK-IS(d/s), NZG-IS, YK-IS, YK-RS, WATERBLANK | 29-Apr-2024 | ---- | ---- | ---- | 01-May-2024 | 01-May-2024 | ✔ |



Quality Control Parameter Frequency Compliance

The following report summarises the frequency of laboratory QC samples analysed within the analytical lot(s) in which the submitted sample(s) was(were) processed. Actual rate should be greater than or equal to the expected rate. A listing of breaches is provided in the Summary of Outliers.

Matrix: **WATER** Evaluation: ✘ = Quality Control frequency not within specification ; ✔ = Quality Control frequency within specification.

| Quality Control Sample Type | Method | Count | | Rate (%) | | | Quality Control Specification |
|---|----------|-------|--------|----------|----------|------------|--------------------------------|
| | | QC | Reular | Actual | Expected | Evaluation | |
| Laboratory Duplicates (DUP) | | | | | | | |
| Ammonia as N by Discrete analyser | EK055G | 1 | 16 | 6.25 | 10.00 | ✘ | NEPM 2013 B3 & ALS QC Standard |
| Dissolved Mercury by FIMS | EG035F | 4 | 35 | 11.43 | 10.00 | ✔ | NEPM 2013 B3 & ALS QC Standard |
| Dissolved Metals by ICP-MS - Suite A | EG020A-F | 6 | 45 | 13.33 | 10.00 | ✔ | NEPM 2013 B3 & ALS QC Standard |
| Dissolved Metals by ICP-MS - Suite B | EG020B-F | 5 | 37 | 13.51 | 10.00 | ✔ | NEPM 2013 B3 & ALS QC Standard |
| Nitrite and Nitrate as N (NOx) by Discrete Analyser | EK059G | 2 | 19 | 10.53 | 10.00 | ✔ | NEPM 2013 B3 & ALS QC Standard |
| Nitrite as N by Discrete Analyser | EK057G | 4 | 40 | 10.00 | 10.00 | ✔ | NEPM 2013 B3 & ALS QC Standard |
| Reactive Phosphorus as P-By Discrete Analyser | EK071G | 2 | 20 | 10.00 | 10.00 | ✔ | NEPM 2013 B3 & ALS QC Standard |
| Suspended Solids | EA025 | 2 | 20 | 10.00 | 10.00 | ✔ | NEPM 2013 B3 & ALS QC Standard |
| Total Cyanide by Segmented Flow Analyser | EK026SF | 2 | 20 | 10.00 | 10.00 | ✔ | NEPM 2013 B3 & ALS QC Standard |
| Total Kjeldahl Nitrogen as N By Discrete Analyser | EK061G | 2 | 17 | 11.76 | 10.00 | ✔ | NEPM 2013 B3 & ALS QC Standard |
| Total Mercury by FIMS | EG035T | 2 | 20 | 10.00 | 10.00 | ✔ | NEPM 2013 B3 & ALS QC Standard |
| Total Metals by ICP-MS - Suite A | EG020A-T | 2 | 20 | 10.00 | 10.00 | ✔ | NEPM 2013 B3 & ALS QC Standard |
| Total Metals by ICP-MS - Suite B | EG020B-T | 2 | 12 | 16.67 | 10.00 | ✔ | NEPM 2013 B3 & ALS QC Standard |
| Total Phosphorus as P By Discrete Analyser | EK067G | 2 | 20 | 10.00 | 10.00 | ✔ | NEPM 2013 B3 & ALS QC Standard |
| Laboratory Control Samples (LCS) | | | | | | | |
| Ammonia as N by Discrete analyser | EK055G | 1 | 16 | 6.25 | 5.00 | ✔ | NEPM 2013 B3 & ALS QC Standard |
| Dissolved Mercury by FIMS | EG035F | 3 | 35 | 8.57 | 5.00 | ✔ | NEPM 2013 B3 & ALS QC Standard |
| Dissolved Metals by ICP-MS - Suite A | EG020A-F | 3 | 45 | 6.67 | 5.00 | ✔ | NEPM 2013 B3 & ALS QC Standard |
| Dissolved Metals by ICP-MS - Suite B | EG020B-F | 3 | 37 | 8.11 | 5.00 | ✔ | NEPM 2013 B3 & ALS QC Standard |
| Nitrite and Nitrate as N (NOx) by Discrete Analyser | EK059G | 1 | 19 | 5.26 | 5.00 | ✔ | NEPM 2013 B3 & ALS QC Standard |
| Nitrite as N by Discrete Analyser | EK057G | 2 | 40 | 5.00 | 5.00 | ✔ | NEPM 2013 B3 & ALS QC Standard |
| Reactive Phosphorus as P-By Discrete Analyser | EK071G | 1 | 20 | 5.00 | 5.00 | ✔ | NEPM 2013 B3 & ALS QC Standard |
| Suspended Solids | EA025 | 3 | 20 | 15.00 | 15.00 | ✔ | NEPM 2013 B3 & ALS QC Standard |
| Total Cyanide by Segmented Flow Analyser | EK026SF | 2 | 20 | 10.00 | 10.00 | ✔ | NEPM 2013 B3 & ALS QC Standard |
| Total Kjeldahl Nitrogen as N By Discrete Analyser | EK061G | 3 | 17 | 17.65 | 15.00 | ✔ | NEPM 2013 B3 & ALS QC Standard |
| Total Mercury by FIMS | EG035T | 1 | 20 | 5.00 | 5.00 | ✔ | NEPM 2013 B3 & ALS QC Standard |
| Total Metals by ICP-MS - Suite A | EG020A-T | 1 | 20 | 5.00 | 5.00 | ✔ | NEPM 2013 B3 & ALS QC Standard |
| Total Metals by ICP-MS - Suite B | EG020B-T | 1 | 12 | 8.33 | 5.00 | ✔ | NEPM 2013 B3 & ALS QC Standard |
| Total Phosphorus as P By Discrete Analyser | EK067G | 3 | 20 | 15.00 | 15.00 | ✔ | NEPM 2013 B3 & ALS QC Standard |
| Method Blanks (MB) | | | | | | | |
| Ammonia as N by Discrete analyser | EK055G | 1 | 16 | 6.25 | 5.00 | ✔ | NEPM 2013 B3 & ALS QC Standard |
| Dissolved Mercury by FIMS | EG035F | 3 | 35 | 8.57 | 5.00 | ✔ | NEPM 2013 B3 & ALS QC Standard |
| Dissolved Metals by ICP-MS - Suite A | EG020A-F | 3 | 45 | 6.67 | 5.00 | ✔ | NEPM 2013 B3 & ALS QC Standard |
| Dissolved Metals by ICP-MS - Suite B | EG020B-F | 3 | 37 | 8.11 | 5.00 | ✔ | NEPM 2013 B3 & ALS QC Standard |
| Nitrite and Nitrate as N (NOx) by Discrete Analyser | EK059G | 1 | 19 | 5.26 | 5.00 | ✔ | NEPM 2013 B3 & ALS QC Standard |
| Nitrite as N by Discrete Analyser | EK057G | 2 | 40 | 5.00 | 5.00 | ✔ | NEPM 2013 B3 & ALS QC Standard |



Matrix: **WATER** Evaluation: ✖ = Quality Control frequency not within specification ; ✔ = Quality Control frequency within specification.

| Quality Control Sample Type | Method | Count | | Rate (%) | | | Quality Control Specification |
|---|----------|-------|---------|----------|----------|------------|--------------------------------|
| | | QC | Regular | Actual | Expected | Evaluation | |
| Analytical Methods | | | | | | | |
| Method Blanks (MB) - Continued | | | | | | | |
| Reactive Phosphorus as P-By Discrete Analyser | EK071G | 1 | 20 | 5.00 | 5.00 | ✔ | NEPM 2013 B3 & ALS QC Standard |
| Suspended Solids | EA025 | 1 | 20 | 5.00 | 5.00 | ✔ | NEPM 2013 B3 & ALS QC Standard |
| Total Cyanide by Segmented Flow Analyser | EK026SF | 1 | 20 | 5.00 | 5.00 | ✔ | NEPM 2013 B3 & ALS QC Standard |
| Total Kjeldahl Nitrogen as N By Discrete Analyser | EK061G | 1 | 17 | 5.88 | 5.00 | ✔ | NEPM 2013 B3 & ALS QC Standard |
| Total Mercury by FIMS | EG035T | 1 | 20 | 5.00 | 5.00 | ✔ | NEPM 2013 B3 & ALS QC Standard |
| Total Metals by ICP-MS - Suite A | EG020A-T | 1 | 20 | 5.00 | 5.00 | ✔ | NEPM 2013 B3 & ALS QC Standard |
| Total Metals by ICP-MS - Suite B | EG020B-T | 1 | 12 | 8.33 | 5.00 | ✔ | NEPM 2013 B3 & ALS QC Standard |
| Total Phosphorus as P By Discrete Analyser | EK067G | 1 | 20 | 5.00 | 5.00 | ✔ | NEPM 2013 B3 & ALS QC Standard |
| Matrix Spikes (MS) | | | | | | | |
| Ammonia as N by Discrete analyser | EK055G | 0 | 16 | 0.00 | 5.00 | ✖ | NEPM 2013 B3 & ALS QC Standard |
| Dissolved Mercury by FIMS | EG035F | 3 | 35 | 8.57 | 5.00 | ✔ | NEPM 2013 B3 & ALS QC Standard |
| Dissolved Metals by ICP-MS - Suite A | EG020A-F | 3 | 45 | 6.67 | 5.00 | ✔ | NEPM 2013 B3 & ALS QC Standard |
| Nitrite and Nitrate as N (NOx) by Discrete Analyser | EK059G | 1 | 19 | 5.26 | 5.00 | ✔ | NEPM 2013 B3 & ALS QC Standard |
| Nitrite as N by Discrete Analyser | EK057G | 2 | 40 | 5.00 | 5.00 | ✔ | NEPM 2013 B3 & ALS QC Standard |
| Reactive Phosphorus as P-By Discrete Analyser | EK071G | 1 | 20 | 5.00 | 5.00 | ✔ | NEPM 2013 B3 & ALS QC Standard |
| Total Cyanide by Segmented Flow Analyser | EK026SF | 1 | 20 | 5.00 | 5.00 | ✔ | NEPM 2013 B3 & ALS QC Standard |
| Total Kjeldahl Nitrogen as N By Discrete Analyser | EK061G | 1 | 17 | 5.88 | 5.00 | ✔ | NEPM 2013 B3 & ALS QC Standard |
| Total Mercury by FIMS | EG035T | 1 | 20 | 5.00 | 5.00 | ✔ | NEPM 2013 B3 & ALS QC Standard |
| Total Metals by ICP-MS - Suite A | EG020A-T | 1 | 20 | 5.00 | 5.00 | ✔ | NEPM 2013 B3 & ALS QC Standard |
| Total Phosphorus as P By Discrete Analyser | EK067G | 1 | 20 | 5.00 | 5.00 | ✔ | NEPM 2013 B3 & ALS QC Standard |



Brief Method Summaries

The analytical procedures used by the Environmental Division have been developed from established internationally recognized procedures such as those published by the US EPA, APHA, AS and NEPM. In house developed procedures are employed in the absence of documented standards or by client request. The following report provides brief descriptions of the analytical procedures employed for results reported in the Certificate of Analysis. Sources from which ALS methods have been developed are provided within the Method Descriptions.

| Analytical Methods | Method | Matrix | Method Descriptions |
|--------------------------------------|----------|--------|--|
| Suspended Solids | EA025 | WATER | In house: Referenced to APHA 2540D. A gravimetric procedure employed to determine the amount of 'non-filterable' residue in a aqueous sample. The prescribed GFC (1.2um) filter is rinsed with deionised water, oven dried and weighed prior to analysis. A well-mixed sample is filtered through a glass fibre filter (1.2um). The residue on the filter paper is dried at 104+/-2C . This method is compliant with NEPM Schedule B(3) |
| Major Cations - Dissolved | ED093F | WATER | In house: Referenced to APHA 3120 and 3125; USEPA SW 846 - 6010 and 6020; Cations are determined by either ICP-AES or ICP-MS techniques. This method is compliant with NEPM Schedule B(3) Sodium Adsorption Ratio is calculated from Ca, Mg and Na which determined by ALS in house method QWI-EN/ED093F. This method is compliant with NEPM Schedule B(3) Hardness parameters are calculated based on APHA 2340 B. This method is compliant with NEPM Schedule B(3) |
| Dissolved Metals by ICP-MS - Suite A | EG020A-F | WATER | In house: Referenced to APHA 3125; USEPA SW846 - 6020, ALS QWI-EN/EG020. Samples are 0.45µm filtered prior to analysis. The ICPMS technique utilizes a highly efficient argon plasma to ionize selected elements. Ions are then passed into a high vacuum mass spectrometer, which separates the analytes based on their distinct mass to charge ratios prior to their measurement by a discrete dynode ion detector. |
| Total Metals by ICP-MS - Suite A | EG020A-T | WATER | In house: Referenced to APHA 3125; USEPA SW846 - 6020, ALS QWI-EN/EG020. The ICPMS technique utilizes a highly efficient argon plasma to ionize selected elements. Ions are then passed into a high vacuum mass spectrometer, which separates the analytes based on their distinct mass to charge ratios prior to their measurement by a discrete dynode ion detector. |
| Dissolved Metals by ICP-MS - Suite B | EG020B-F | WATER | In house: Referenced to APHA 3125; USEPA SW846 - 6020, ALS QWI-EN/EG020. Samples are 0.45µm filtered prior to analysis. The ICPMS technique utilizes a highly efficient argon plasma to ionize selected elements. Ions are then passed into a high vacuum mass spectrometer, which separates the analytes based on their distinct mass to charge ratios prior to their measurement by a discrete dynode ion detector. |
| Total Metals by ICP-MS - Suite B | EG020B-T | WATER | In house: Referenced to APHA 3125; USEPA SW846 - 6020, ALS QWI-EN/EG020. The ICPMS technique utilizes a highly efficient argon plasma to ionize selected elements. Ions are then passed into a high vacuum mass spectrometer, which separates the analytes based on their distinct mass to charge ratios prior to their measurement by a discrete dynode ion detector. |
| Dissolved Mercury by FIMS | EG035F | WATER | In house: Referenced to APHA 3112 Hg - B (Flow-injection (SnCl ₂)(Cold Vapour generation) AAS) Samples are 0.45µm filtered prior to analysis. FIM-AAS is an automated flameless atomic absorption technique. A bromate/bromide reagent is used to oxidise any organic mercury compounds in the filtered sample. The ionic mercury is reduced online to atomic mercury vapour by SnCl ₂ which is then purged into a heated quartz cell. Quantification is by comparing absorbance against a calibration curve. This method is compliant with NEPM Schedule B(3). |
| Total Mercury by FIMS | EG035T | WATER | In house: Referenced to APHA 3112 Hg - B (Flow-injection (SnCl ₂)(Cold Vapour generation) AAS) FIM-AAS is an automated flameless atomic absorption technique. A bromate/bromide reagent is used to oxidise any organic mercury compounds in the unfiltered sample. The ionic mercury is reduced online to atomic mercury vapour by SnCl ₂ which is then purged into a heated quartz cell. Quantification is by comparing absorbance against a calibration curve. This method is compliant with NEPM Schedule B(3). |



| Analytical Methods | Method | Matrix | Method Descriptions |
|--|-------------|--------|---|
| Total Cyanide by Segmented Flow Analyser | EK026SF | WATER | In house: Referenced to APHA 4500-CN C&O / ASTM D7511 / ISO 14403. Sodium hydroxide preserved samples are introduced into an automated segmented flow analyser. Complex bound cyanide is decomposed in a continuously flowing stream, at a pH of 3.8, by the effect of UV light. A UV-B lamp (312 nm) and a decomposition spiral of borosilicate glass are used to filter out UV light with a wavelength of less than 290 nm thus preventing the conversion of thiocyanate into cyanide. The hydrogen cyanide present at a pH of 3.8 is separated by gas dialysis. The hydrogen cyanide is then determined photometrically, based on the reaction of cyanide with chloramine-T to form cyanogen chloride. This then reacts with 4-pyridine carboxylic acid and 1,3-dimethylbarbituric acid to give a red colour which is measured at 600 nm. This method is compliant with NEPM Schedule B(3) |
| Ammonia as N by Discrete analyser | EK055G | WATER | In house: Referenced to APHA 4500-NH3 G Ammonia is determined by direct colorimetry by Discrete Analyser. This method is compliant with NEPM Schedule B(3) |
| Nitrite as N by Discrete Analyser | EK057G | WATER | In house: Referenced to APHA 4500-NO2- B. Nitrite is determined by direct colourimetry by Discrete Analyser. This method is compliant with NEPM Schedule B(3) |
| Nitrate as N by Discrete Analyser | EK058G | WATER | In house: Referenced to APHA 4500-NO3- F. Nitrate is reduced to nitrite by way of a chemical reduction followed by quantification by Discrete Analyser. Nitrite is determined separately by direct colourimetry and result for Nitrate calculated as the difference between the two results. This method is compliant with NEPM Schedule B(3) |
| Nitrite and Nitrate as N (NOx) by Discrete Analyser | EK059G | WATER | In house: Referenced to APHA 4500-NO3- F. Combined oxidised Nitrogen (NO2+NO3) is determined by Chemical Reduction and direct colourimetry by Discrete Analyser. This method is compliant with NEPM Schedule B(3) |
| Total Kjeldahl Nitrogen as N By Discrete Analyser | EK061G | WATER | In house: Referenced to APHA 4500-Norg D (In house). An aliquot of sample is digested using a high temperature Kjeldahl digestion to convert nitrogenous compounds to ammonia. Ammonia is determined colorimetrically by discrete analyser. This method is compliant with NEPM Schedule B(3) |
| Total Nitrogen as N (TKN + Nox) By Discrete Analyser | EK062G | WATER | In house: Referenced to APHA 4500-Norg / 4500-NO3-. This method is compliant with NEPM Schedule B(3) |
| Total Phosphorus as P By Discrete Analyser | EK067G | WATER | In house: Referenced to APHA 4500-P H, Jirka et al, Zhang et al. This procedure involves sulphuric acid digestion of a sample aliquot to break phosphorus down to orthophosphate. The orthophosphate reacts with ammonium molybdate and antimony potassium tartrate to form a complex which is then reduced and its concentration measured at 880nm using discrete analyser. This method is compliant with NEPM Schedule B(3) |
| Reactive Phosphorus as P-By Discrete Analyser | EK071G | WATER | In house: Referenced to APHA 4500-P F Ammonium molybdate and potassium antimonyl tartrate reacts in acid medium with orthophosphate to form a heteropoly acid -phosphomolybdic acid - which is reduced to intensely coloured molybdenum blue by ascorbic acid. Quantification is by Discrete Analyser. This method is compliant with NEPM Schedule B(3) |
| Preparation Methods | Method | Matrix | Method Descriptions |
| TKN/TP Digestion | EK061/EK067 | WATER | In house: Referenced to APHA 4500 Norg - D; APHA 4500 P - H. This method is compliant with NEPM Schedule B(3) |
| Digestion for Total Recoverable Metals | EN25 | WATER | In house: Referenced to USEPA SW846-3005. Method 3005 is a Nitric/Hydrochloric acid digestion procedure used to prepare surface and ground water samples for analysis by ICPAES or ICPMS. This method is compliant with NEPM Schedule B(3) |



QUALITY CONTROL REPORT

| | | | |
|-------------------------|---|-------------------------|---|
| Work Order | : ES2414062 | Page | : 1 of 11 |
| Client | : UGL LIMITED | Laboratory | : Environmental Division Sydney |
| Contact | : CAMILLE PALMER | Contact | : Customer Services ES |
| Address | : Level 4, 40 Miller Street North Sydney 2060 | Address | : 277-289 Woodpark Road Smithfield NSW Australia 2164 |
| Telephone | : ---- | Telephone | : +61-2-8784 8555 |
| Project | : 3200-0645 TransGrid Maragle 500/330kV Station. (Event 25) | Date Samples Received | : 01-May-2024 |
| Order number | : TBC | Date Analysis Commenced | : 01-May-2024 |
| C-O-C number | : ---- | Issue Date | : 08-May-2024 |
| Sampler | : ---- | | |
| Site | : Maragle/Lobs Hole | | |
| Quote number | : ES24UGLLIM0001_V2 | | |
| No. of samples received | : 12 | | |
| No. of samples analysed | : 12 | | |



This report supersedes any previous report(s) with this reference. Results apply to the sample(s) as submitted, unless the sampling was conducted by ALS. This document shall not be reproduced, except in full.

This Quality Control Report contains the following information:

- Laboratory Duplicate (DUP) Report; Relative Percentage Difference (RPD) and Acceptance Limits
- Method Blank (MB) and Laboratory Control Spike (LCS) Report; Recovery and Acceptance Limits
- Matrix Spike (MS) Report; Recovery and Acceptance Limits

Signatories

This document has been electronically signed by the authorized signatories below. Electronic signing is carried out in compliance with procedures specified in 21 CFR Part 11.

| Signatories | Position | Accreditation Category |
|---------------|-----------------------------|------------------------------------|
| Ankit Joshi | Senior Chemist - Inorganics | Sydney Inorganics, Smithfield, NSW |
| Wisam Marassa | Inorganics Coordinator | Sydney Inorganics, Smithfield, NSW |



General Comments

The analytical procedures used by ALS have been developed from established internationally recognised procedures such as those published by the USEPA, APHA, AS and NEPM. In house developed procedures are fully validated and are often at the client request.

Where moisture determination has been performed, results are reported on a dry weight basis.

Where a reported less than (<) result is higher than the LOR, this may be due to primary sample extract/digestate dilution and/or insufficient sample for analysis. Where the LOR of a reported result differs from standard LOR, this may be due to high moisture content, insufficient sample (reduced weight employed) or matrix interference.

Key : Anonymous = Refers to samples which are not specifically part of this work order but formed part of the QC process lot

CAS Number = CAS registry number from database maintained by Chemical Abstracts Services. The Chemical Abstracts Service is a division of the American Chemical Society.

LOR = Limit of reporting

RPD = Relative Percentage Difference

= Indicates failed QC

* = The final LOR has been raised due to dilution or other sample specific cause; adjusted LOR is shown in brackets. The duplicate ranges for Acceptable RPD% are applied to the final LOR where applicable.

Laboratory Duplicate (DUP) Report

The quality control term Laboratory Duplicate refers to a randomly selected intralaboratory split. Laboratory duplicates provide information regarding method precision and sample heterogeneity. The permitted ranges for the Relative Percent Deviation (RPD) of Laboratory Duplicates are specified in ALS Method QWI-EN/38 and are dependent on the magnitude of results in comparison to the level of reporting: Result < 10 times LOR: No Limit; Result between 10 and 20 times LOR: 0% - 50%; Result > 20 times LOR: 0% - 20%.

Sub-Matrix: **WATER**

| | | | | Laboratory Duplicate (DUP) Report | | | | | |
|---|-----------|------------------------------|------------|-----------------------------------|------|-----------------|------------------|---------|--------------------|
| Laboratory sample ID | Sample ID | Method: Compound | CAS Number | LOR | Unit | Original Result | Duplicate Result | RPD (%) | Acceptable RPD (%) |
| EA025: Total Suspended Solids dried at 104 ± 2°C (QC Lot: 5768259) | | | | | | | | | |
| ES2414062-004 | LHG-IS | EA025: Suspended Solids (SS) | ---- | 1 | mg/L | 70 | 76 | 8.6 | 0% - 20% |
| ES2413715-001 | Anonymous | EA025: Suspended Solids (SS) | ---- | 1 | mg/L | 18 | 14 | 30.7 | 0% - 50% |
| EG020F: Dissolved Metals by ICP-MS (QC Lot: 5766566) | | | | | | | | | |
| ES2413802-001 | Anonymous | EG020A-F: Cadmium | 7440-43-9 | 0.0001 (0.0010)* | mg/L | <0.0010 | <0.0010 | 0.0 | No Limit |
| | | EG020A-F: Arsenic | 7440-38-2 | 0.001 (0.010) * | mg/L | 0.100 | 0.096 | 3.7 | 0% - 50% |
| | | EG020A-F: Chromium | 7440-47-3 | 0.001 (0.010) * | mg/L | 0.395 | 0.388 | 1.9 | 0% - 20% |
| | | EG020A-F: Copper | 7440-50-8 | 0.001 (0.010) * | mg/L | 0.018 | 0.017 | 7.2 | No Limit |
| | | EG020A-F: Lead | 7439-92-1 | 0.001 (0.010) * | mg/L | <0.010 | <0.010 | 0.0 | No Limit |
| | | EG020A-F: Manganese | 7439-96-5 | 0.001 (0.010) * | mg/L | 0.199 | 0.201 | 0.9 | 0% - 20% |
| | | EG020A-F: Nickel | 7440-02-0 | 0.001 (0.010) * | mg/L | 0.176 | 0.160 | 9.8 | 0% - 50% |
| | | EG020A-F: Zinc | 7440-66-6 | 0.005 (0.050) * | mg/L | 0.345 | 0.331 | 4.0 | No Limit |
| | | EG020A-F: Aluminium | 7429-90-5 | 0.01 (0.10)* | mg/L | 0.62 | 0.63 | 0.0 | No Limit |
| | | EG020A-F: Iron | 7439-89-6 | 0.05 (0.10)* | mg/L | 6.49 | 6.16 | 5.2 | 0% - 20% |
| ES2413804-014 | Anonymous | EG020A-F: Cadmium | 7440-43-9 | 0.0001 | mg/L | <0.1 µg/L | <0.0001 | 0.0 | No Limit |



| Sub-Matrix: WATER | | | | Laboratory Duplicate (DUP) Report | | | | | |
|---|-----------|---------------------|------------|-----------------------------------|-------|-----------------|------------------|---------|--------------------|
| Laboratory sample ID | Sample ID | Method: Compound | CAS Number | LOR | Unit | Original Result | Duplicate Result | RPD (%) | Acceptable RPD (%) |
| EG020F: Dissolved Metals by ICP-MS (QC Lot: 5766566) - continued | | | | | | | | | |
| ES2413804-014 | Anonymous | EG020A-F: Arsenic | 7440-38-2 | 0.001 | mg/L | <1 µg/L | <0.001 | 0.0 | No Limit |
| | | EG020A-F: Chromium | 7440-47-3 | 0.001 | mg/L | <1 µg/L | <0.001 | 0.0 | No Limit |
| | | EG020A-F: Copper | 7440-50-8 | 0.001 | mg/L | 1 µg/L | <0.001 | 0.0 | No Limit |
| | | EG020A-F: Lead | 7439-92-1 | 0.001 | mg/L | <1 µg/L | <0.001 | 0.0 | No Limit |
| | | EG020A-F: Manganese | 7439-96-5 | 0.001 | mg/L | 2060 µg/L | 2.11 | 2.3 | 0% - 20% |
| | | EG020A-F: Nickel | 7440-02-0 | 0.001 | mg/L | 9 µg/L | 0.009 | 0.0 | No Limit |
| | | EG020A-F: Zinc | 7440-66-6 | 0.005 | mg/L | 7 µg/L | 0.007 | 0.0 | No Limit |
| | | EG020A-F: Aluminium | 7429-90-5 | 0.01 | mg/L | 20 µg/L | 0.02 | 0.0 | No Limit |
| EG020A-F: Iron | 7439-89-6 | 0.05 | mg/L | <50 µg/L | <0.05 | 0.0 | No Limit | | |
| EG020F: Dissolved Metals by ICP-MS (QC Lot: 5766567) | | | | | | | | | |
| ES2413802-001 | Anonymous | EG020B-F: Silver | 7440-22-4 | 0.001 (0.010) * | mg/L | <0.010 | <0.010 | 0.0 | No Limit |
| ES2413804-014 | Anonymous | EG020B-F: Silver | 7440-22-4 | 0.001 | mg/L | <1 µg/L | <0.001 | 0.0 | No Limit |
| EG020F: Dissolved Metals by ICP-MS (QC Lot: 5766571) | | | | | | | | | |
| WN2405200-001 | Anonymous | EG020A-F: Cadmium | 7440-43-9 | 0.0001 | mg/L | 0.0002 | 0.0002 | 0.0 | No Limit |
| | | EG020A-F: Arsenic | 7440-38-2 | 0.001 | mg/L | <0.001 | <0.001 | 0.0 | No Limit |
| | | EG020A-F: Chromium | 7440-47-3 | 0.001 | mg/L | <0.001 | <0.001 | 0.0 | No Limit |
| | | EG020A-F: Copper | 7440-50-8 | 0.001 | mg/L | 0.029 | 0.029 | 0.0 | 0% - 20% |
| | | EG020A-F: Lead | 7439-92-1 | 0.001 | mg/L | 0.014 | 0.014 | 0.0 | 0% - 50% |
| | | EG020A-F: Manganese | 7439-96-5 | 0.001 | mg/L | 0.008 | 0.007 | 0.0 | No Limit |
| | | EG020A-F: Nickel | 7440-02-0 | 0.001 | mg/L | <0.001 | <0.001 | 0.0 | No Limit |
| | | EG020A-F: Zinc | 7440-66-6 | 0.005 | mg/L | 0.236 | 0.231 | 2.3 | 0% - 20% |
| | | EG020A-F: Aluminium | 7429-90-5 | 0.01 | mg/L | <0.01 | <0.01 | 0.0 | No Limit |
| EG020A-F: Iron | 7439-89-6 | 0.05 | mg/L | <0.05 | <0.05 | 0.0 | No Limit | | |
| ES2414062-008 | NZG-IS | EG020A-F: Cadmium | 7440-43-9 | 0.0001 | mg/L | <0.0001 | <0.0001 | 0.0 | No Limit |
| | | EG020A-F: Arsenic | 7440-38-2 | 0.001 | mg/L | <0.001 | <0.001 | 0.0 | No Limit |
| | | EG020A-F: Chromium | 7440-47-3 | 0.001 | mg/L | <0.001 | <0.001 | 0.0 | No Limit |
| | | EG020A-F: Copper | 7440-50-8 | 0.001 | mg/L | <0.001 | <0.001 | 0.0 | No Limit |
| | | EG020A-F: Lead | 7439-92-1 | 0.001 | mg/L | <0.001 | <0.001 | 0.0 | No Limit |
| | | EG020A-F: Manganese | 7439-96-5 | 0.001 | mg/L | 0.006 | 0.006 | 0.0 | No Limit |
| | | EG020A-F: Nickel | 7440-02-0 | 0.001 | mg/L | <0.001 | <0.001 | 0.0 | No Limit |
| | | EG020A-F: Zinc | 7440-66-6 | 0.005 | mg/L | <0.005 | <0.005 | 0.0 | No Limit |
| | | EG020A-F: Aluminium | 7429-90-5 | 0.01 | mg/L | 0.03 | 0.03 | 0.0 | No Limit |
| EG020A-F: Iron | 7439-89-6 | 0.05 | mg/L | 0.08 | 0.08 | 0.0 | No Limit | | |
| EG020F: Dissolved Metals by ICP-MS (QC Lot: 5766572) | | | | | | | | | |
| ES2414062-008 | NZG-IS | EG020B-F: Silver | 7440-22-4 | 0.001 | mg/L | <0.001 | <0.001 | 0.0 | No Limit |
| EG020F: Dissolved Metals by ICP-MS (QC Lot: 5767306) | | | | | | | | | |



| Sub-Matrix: WATER | | | | Laboratory Duplicate (DUP) Report | | | | | |
|---|-----------|---------------------|------------|-----------------------------------|-------|-----------------|------------------|---------|--------------------|
| Laboratory sample ID | Sample ID | Method: Compound | CAS Number | LOR | Unit | Original Result | Duplicate Result | RPD (%) | Acceptable RPD (%) |
| EG020F: Dissolved Metals by ICP-MS (QC Lot: 5767306) - continued | | | | | | | | | |
| ES2413805-002 | Anonymous | EG020B-F: Silver | 7440-22-4 | 0.001 | mg/L | <0.001 | <0.001 | 0.0 | No Limit |
| ES2413804-005 | Anonymous | EG020B-F: Silver | 7440-22-4 | 0.001 | mg/L | <1 µg/L | <0.001 | 0.0 | No Limit |
| EG020F: Dissolved Metals by ICP-MS (QC Lot: 5767309) | | | | | | | | | |
| ES2414005-006 | Anonymous | EG020A-F: Cadmium | 7440-43-9 | 0.0001 | mg/L | <0.0001 | <0.0001 | 0.0 | No Limit |
| | | EG020A-F: Arsenic | 7440-38-2 | 0.001 | mg/L | <0.001 | <0.001 | 0.0 | No Limit |
| | | EG020A-F: Chromium | 7440-47-3 | 0.001 | mg/L | <0.001 | <0.001 | 0.0 | No Limit |
| | | EG020A-F: Copper | 7440-50-8 | 0.001 | mg/L | <0.001 | <0.001 | 0.0 | No Limit |
| | | EG020A-F: Lead | 7439-92-1 | 0.001 | mg/L | <0.001 | <0.001 | 0.0 | No Limit |
| | | EG020A-F: Manganese | 7439-96-5 | 0.001 | mg/L | <0.001 | <0.001 | 0.0 | No Limit |
| | | EG020A-F: Nickel | 7440-02-0 | 0.001 | mg/L | <0.001 | <0.001 | 0.0 | No Limit |
| | | EG020A-F: Zinc | 7440-66-6 | 0.005 | mg/L | <0.005 | <0.005 | 0.0 | No Limit |
| | | EG020A-F: Aluminium | 7429-90-5 | 0.01 | mg/L | <0.01 | <0.01 | 0.0 | No Limit |
| WN2405136-005 | Anonymous | EG020A-F: Iron | 7439-89-6 | 0.05 | mg/L | <0.05 | <0.05 | 0.0 | No Limit |
| | | EG020A-F: Cadmium | 7440-43-9 | 0.0001 | mg/L | <0.0001 | <0.0001 | 0.0 | No Limit |
| | | EG020A-F: Arsenic | 7440-38-2 | 0.001 | mg/L | <0.001 | <0.001 | 0.0 | No Limit |
| | | EG020A-F: Chromium | 7440-47-3 | 0.001 | mg/L | <0.001 | <0.001 | 0.0 | No Limit |
| | | EG020A-F: Copper | 7440-50-8 | 0.001 | mg/L | 0.002 | 0.002 | 0.0 | No Limit |
| | | EG020A-F: Lead | 7439-92-1 | 0.001 | mg/L | <0.001 | <0.001 | 0.0 | No Limit |
| | | EG020A-F: Manganese | 7439-96-5 | 0.001 | mg/L | 0.008 | 0.008 | 0.0 | No Limit |
| | | EG020A-F: Nickel | 7440-02-0 | 0.001 | mg/L | <0.001 | <0.001 | 0.0 | No Limit |
| | | EG020A-F: Zinc | 7440-66-6 | 0.005 | mg/L | <0.005 | <0.005 | 0.0 | No Limit |
| EG020T: Total Metals by ICP-MS (QC Lot: 5765535) | | | | | | | | | |
| ES2414062-001 | WC-RS | EG020B-T: Silver | 7440-22-4 | 0.001 | mg/L | <0.001 | <0.001 | 0.0 | No Limit |
| ES2414062-011 | DUP01 | EG020B-T: Silver | 7440-22-4 | 0.001 | mg/L | <0.001 | <0.001 | 0.0 | No Limit |
| EG020T: Total Metals by ICP-MS (QC Lot: 5765536) | | | | | | | | | |
| ES2414062-001 | WC-RS | EG020A-T: Cadmium | 7440-43-9 | 0.0001 | mg/L | <0.0001 | <0.0001 | 0.0 | No Limit |
| | | EG020A-T: Arsenic | 7440-38-2 | 0.001 | mg/L | <0.001 | <0.001 | 0.0 | No Limit |
| | | EG020A-T: Chromium | 7440-47-3 | 0.001 | mg/L | <0.001 | <0.001 | 0.0 | No Limit |
| | | EG020A-T: Copper | 7440-50-8 | 0.001 | mg/L | <0.001 | <0.001 | 0.0 | No Limit |
| | | EG020A-T: Lead | 7439-92-1 | 0.001 | mg/L | <0.001 | <0.001 | 0.0 | No Limit |
| | | EG020A-T: Manganese | 7439-96-5 | 0.001 | mg/L | 0.010 | 0.008 | 14.5 | No Limit |
| | | EG020A-T: Nickel | 7440-02-0 | 0.001 | mg/L | <0.001 | <0.001 | 0.0 | No Limit |
| | | EG020A-T: Zinc | 7440-66-6 | 0.005 | mg/L | <0.005 | 0.010 | 59.1 | No Limit |
| | | EG020A-T: Aluminium | 7429-90-5 | 0.01 | mg/L | 0.02 | 0.02 | 0.0 | No Limit |
| EG020A-T: Iron | 7439-89-6 | 0.05 | mg/L | <0.05 | <0.05 | 0.0 | No Limit | | |



| Sub-Matrix: WATER | | | | Laboratory Duplicate (DUP) Report | | | | | |
|---|-----------|--------------------------------|------------|-----------------------------------|-------|-----------------|------------------|---------|--------------------|
| Laboratory sample ID | Sample ID | Method: Compound | CAS Number | LOR | Unit | Original Result | Duplicate Result | RPD (%) | Acceptable RPD (%) |
| EG020T: Total Metals by ICP-MS (QC Lot: 5765536) - continued | | | | | | | | | |
| ES2414062-011 | DUP01 | EG020A-T: Cadmium | 7440-43-9 | 0.0001 | mg/L | <0.0001 | <0.0001 | 0.0 | No Limit |
| | | EG020A-T: Arsenic | 7440-38-2 | 0.001 | mg/L | <0.001 | <0.001 | 0.0 | No Limit |
| | | EG020A-T: Chromium | 7440-47-3 | 0.001 | mg/L | <0.001 | <0.001 | 0.0 | No Limit |
| | | EG020A-T: Copper | 7440-50-8 | 0.001 | mg/L | <0.001 | <0.001 | 0.0 | No Limit |
| | | EG020A-T: Lead | 7439-92-1 | 0.001 | mg/L | <0.001 | <0.001 | 0.0 | No Limit |
| | | EG020A-T: Manganese | 7439-96-5 | 0.001 | mg/L | 0.002 | 0.002 | 0.0 | No Limit |
| | | EG020A-T: Nickel | 7440-02-0 | 0.001 | mg/L | <0.001 | <0.001 | 0.0 | No Limit |
| | | EG020A-T: Zinc | 7440-66-6 | 0.005 | mg/L | <0.005 | <0.005 | 0.0 | No Limit |
| | | EG020A-T: Aluminium | 7429-90-5 | 0.01 | mg/L | 0.02 | <0.01 | 0.0 | No Limit |
| EG020A-T: Iron | 7439-89-6 | 0.05 | mg/L | <0.05 | <0.05 | 0.0 | No Limit | | |
| EG035F: Dissolved Mercury by FIMS (QC Lot: 5766569) | | | | | | | | | |
| ES2413802-002 | Anonymous | EG035F: Mercury | 7439-97-6 | 0.0001 | mg/L | <0.0001 | <0.0001 | 0.0 | No Limit |
| ES2413804-013 | Anonymous | EG035F: Mercury | 7439-97-6 | 0.0001 | mg/L | <0.1 µg/L | <0.0001 | 0.0 | No Limit |
| EG035F: Dissolved Mercury by FIMS (QC Lot: 5766573) | | | | | | | | | |
| ES2414062-009 | YK-IS | EG035F: Mercury | 7439-97-6 | 0.0001 | mg/L | <0.0001 | <0.0001 | 0.0 | No Limit |
| EG035F: Dissolved Mercury by FIMS (QC Lot: 5767308) | | | | | | | | | |
| ES2414005-005 | Anonymous | EG035F: Mercury | 7439-97-6 | 0.0001 | mg/L | 0.0003 | 0.0003 | 0.0 | No Limit |
| EG035T: Total Recoverable Mercury by FIMS (QC Lot: 5766575) | | | | | | | | | |
| ES2414062-002 | WC-IS | EG035T: Mercury | 7439-97-6 | 0.0001 | mg/L | <0.0001 | <0.0001 | 0.0 | No Limit |
| ES2414062-011 | DUP01 | EG035T: Mercury | 7439-97-6 | 0.0001 | mg/L | <0.0001 | <0.0001 | 0.0 | No Limit |
| EK026SF: Total CN by Segmented Flow Analyser (QC Lot: 5771645) | | | | | | | | | |
| ES2414062-006 | TR-RS | EK026SF: Total Cyanide | 57-12-5 | 0.004 (0.002) * | mg/L | <0.002 | <0.002 | 0.0 | No Limit |
| ES2414014-001 | Anonymous | EK026SF: Total Cyanide | 57-12-5 | 0.004 (0.010) * | mg/L | 0.238 | 0.235 | 1.1 | 0% - 20% |
| EK055G: Ammonia as N by Discrete Analyser (QC Lot: 5769017) | | | | | | | | | |
| ES2414062-004 | LHG-IS | EK055G: Ammonia as N | 7664-41-7 | 0.01 | mg/L | 0.02 | 0.02 | 0.0 | No Limit |
| EK057G: Nitrite as N by Discrete Analyser (QC Lot: 5761468) | | | | | | | | | |
| ES2413955-001 | Anonymous | EK057G: Nitrite as N | 14797-65-0 | 0.01 | mg/L | <0.01 | <0.01 | 0.0 | No Limit |
| ES2413955-010 | Anonymous | EK057G: Nitrite as N | 14797-65-0 | 0.01 | mg/L | <0.01 | <0.01 | 0.0 | No Limit |
| EK057G: Nitrite as N by Discrete Analyser (QC Lot: 5761472) | | | | | | | | | |
| ES2414062-004 | LHG-IS | EK057G: Nitrite as N | 14797-65-0 | 0.01 | mg/L | <0.01 | <0.01 | 0.0 | No Limit |
| EW2401993-008 | Anonymous | EK057G: Nitrite as N | 14797-65-0 | 0.01 | mg/L | <0.01 | <0.01 | 0.0 | No Limit |
| EK059G: Nitrite plus Nitrate as N (NOx) by Discrete Analyser (QC Lot: 5769019) | | | | | | | | | |
| ES2413960-009 | Anonymous | EK059G: Nitrite + Nitrate as N | ---- | 0.01 | mg/L | 0.08 | 0.08 | 0.0 | No Limit |
| ES2414062-004 | LHG-IS | EK059G: Nitrite + Nitrate as N | ---- | 0.01 | mg/L | 0.02 | 0.03 | 0.0 | No Limit |
| EK061G: Total Kjeldahl Nitrogen By Discrete Analyser (QC Lot: 5769016) | | | | | | | | | |

Page : 6 of 11
 Work Order : ES2414062
 Client : UGL LIMITED
 Project : 3200-0645 TransGrid Maragle 500/330kV Station. (Event 25)



| Sub-Matrix: WATER | | | | Laboratory Duplicate (DUP) Report | | | | | |
|---|-----------|--------------------------------------|------------|-----------------------------------|------|-----------------|------------------|---------|--------------------|
| Laboratory sample ID | Sample ID | Method: Compound | CAS Number | LOR | Unit | Original Result | Duplicate Result | RPD (%) | Acceptable RPD (%) |
| EK061G: Total Kjeldahl Nitrogen By Discrete Analyser (QC Lot: 5769016) - continued | | | | | | | | | |
| ES2413960-010 | Anonymous | EK061G: Total Kjeldahl Nitrogen as N | ---- | 0.1 | mg/L | 0.8 | 0.8 | 0.0 | No Limit |
| ES2414062-005 | YR2-RS | EK061G: Total Kjeldahl Nitrogen as N | ---- | 0.1 | mg/L | <0.1 | 0.1 | 0.0 | No Limit |
| EK067G: Total Phosphorus as P by Discrete Analyser (QC Lot: 5769015) | | | | | | | | | |
| ES2413960-010 | Anonymous | EK067G: Total Phosphorus as P | ---- | 0.01 | mg/L | 0.04 | 0.03 | 0.0 | No Limit |
| ES2414062-005 | YR2-RS | EK067G: Total Phosphorus as P | ---- | 0.01 | mg/L | 0.01 | 0.01 | 0.0 | No Limit |
| EK071G: Reactive Phosphorus as P by discrete analyser (QC Lot: 5761471) | | | | | | | | | |
| ES2414062-004 | LHG-IS | EK071G: Reactive Phosphorus as P | 14265-44-2 | 0.01 | mg/L | <0.01 | <0.01 | 0.0 | No Limit |
| ES2413992-004 | Anonymous | EK071G: Reactive Phosphorus as P | 14265-44-2 | 0.01 | mg/L | <0.01 | <0.01 | 0.0 | No Limit |



Method Blank (MB) and Laboratory Control Sample (LCS) Report

The quality control term Method / Laboratory Blank refers to an analyte free matrix to which all reagents are added in the same volumes or proportions as used in standard sample preparation. The purpose of this QC parameter is to monitor potential laboratory contamination. The quality control term Laboratory Control Sample (LCS) refers to a certified reference material, or a known interference free matrix spiked with target analytes. The purpose of this QC parameter is to monitor method precision and accuracy independent of sample matrix. Dynamic Recovery Limits are based on statistical evaluation of processed LCS.

Sub-Matrix: **WATER**

| Method: Compound | CAS Number | LOR | Unit | Method Blank (MB) Report | Laboratory Control Spike (LCS) Report | | | | |
|--|------------|--------|------|--------------------------|---------------------------------------|--------------------|------|-----------------------|--|
| | | | | Result | Spike Concentration | Spike Recovery (%) | | Acceptable Limits (%) | |
| | | | | | | LCS | Low | High | |
| EA025: Total Suspended Solids dried at 104 ± 2°C (QCLot: 5768259) | | | | | | | | | |
| EA025: Suspended Solids (SS) | ---- | 1 | mg/L | <1 | 150 mg/L | 101 | 83.0 | 129 | |
| | | | | <1 | 1000 mg/L | 99.0 | 81.0 | 111 | |
| | | | | <1 | 928 mg/L | 97.1 | 83.0 | 118 | |
| EG020F: Dissolved Metals by ICP-MS (QCLot: 5766566) | | | | | | | | | |
| EG020A-F: Aluminium | 7429-90-5 | 0.01 | mg/L | <0.01 | 0.5 mg/L | 90.3 | 80.0 | 116 | |
| EG020A-F: Arsenic | 7440-38-2 | 0.001 | mg/L | <0.001 | 0.1 mg/L | 93.5 | 85.0 | 114 | |
| EG020A-F: Cadmium | 7440-43-9 | 0.0001 | mg/L | <0.0001 | 0.1 mg/L | 95.5 | 84.0 | 110 | |
| EG020A-F: Chromium | 7440-47-3 | 0.001 | mg/L | <0.001 | 0.1 mg/L | 91.2 | 85.0 | 111 | |
| EG020A-F: Copper | 7440-50-8 | 0.001 | mg/L | <0.001 | 0.1 mg/L | 92.6 | 81.0 | 111 | |
| EG020A-F: Lead | 7439-92-1 | 0.001 | mg/L | <0.001 | 0.1 mg/L | 90.8 | 83.0 | 111 | |
| EG020A-F: Manganese | 7439-96-5 | 0.001 | mg/L | <0.001 | 0.1 mg/L | 91.9 | 82.0 | 110 | |
| EG020A-F: Nickel | 7440-02-0 | 0.001 | mg/L | <0.001 | 0.1 mg/L | 92.6 | 82.0 | 112 | |
| EG020A-F: Zinc | 7440-66-6 | 0.005 | mg/L | <0.005 | 0.1 mg/L | 92.6 | 81.0 | 117 | |
| EG020A-F: Iron | 7439-89-6 | 0.05 | mg/L | <0.05 | 0.5 mg/L | 89.9 | 82.0 | 112 | |
| EG020F: Dissolved Metals by ICP-MS (QCLot: 5766567) | | | | | | | | | |
| EG020B-F: Silver | 7440-22-4 | 0.001 | mg/L | <0.001 | 0.02 mg/L | 116 | 70.0 | 130 | |
| EG020F: Dissolved Metals by ICP-MS (QCLot: 5766571) | | | | | | | | | |
| EG020A-F: Aluminium | 7429-90-5 | 0.01 | mg/L | <0.01 | 0.5 mg/L | 90.5 | 80.0 | 116 | |
| EG020A-F: Arsenic | 7440-38-2 | 0.001 | mg/L | <0.001 | 0.1 mg/L | 94.2 | 85.0 | 114 | |
| EG020A-F: Cadmium | 7440-43-9 | 0.0001 | mg/L | <0.0001 | 0.1 mg/L | 95.9 | 84.0 | 110 | |
| EG020A-F: Chromium | 7440-47-3 | 0.001 | mg/L | <0.001 | 0.1 mg/L | 90.2 | 85.0 | 111 | |
| EG020A-F: Copper | 7440-50-8 | 0.001 | mg/L | <0.001 | 0.1 mg/L | 91.4 | 81.0 | 111 | |
| EG020A-F: Lead | 7439-92-1 | 0.001 | mg/L | <0.001 | 0.1 mg/L | 91.8 | 83.0 | 111 | |
| EG020A-F: Manganese | 7439-96-5 | 0.001 | mg/L | <0.001 | 0.1 mg/L | 90.0 | 82.0 | 110 | |
| EG020A-F: Nickel | 7440-02-0 | 0.001 | mg/L | <0.001 | 0.1 mg/L | 91.8 | 82.0 | 112 | |
| EG020A-F: Zinc | 7440-66-6 | 0.005 | mg/L | <0.005 | 0.1 mg/L | 92.5 | 81.0 | 117 | |
| EG020A-F: Iron | 7439-89-6 | 0.05 | mg/L | <0.05 | 0.5 mg/L | 91.6 | 82.0 | 112 | |
| EG020F: Dissolved Metals by ICP-MS (QCLot: 5766572) | | | | | | | | | |
| EG020B-F: Silver | 7440-22-4 | 0.001 | mg/L | <0.001 | 0.02 mg/L | 129 | 70.0 | 130 | |
| EG020F: Dissolved Metals by ICP-MS (QCLot: 5767306) | | | | | | | | | |



Sub-Matrix: **WATER**

| Method: Compound | CAS Number | LOR | Unit | Method Blank (MB) Report Result | Laboratory Control Spike (LCS) Report | | | |
|--|------------|--------|------|---------------------------------|---------------------------------------|--------------------|-----------------------|------|
| | | | | | Spike Concentration | Spike Recovery (%) | Acceptable Limits (%) | |
| | | | | | | LCS | Low | High |
| EG020F: Dissolved Metals by ICP-MS (QCLot: 5767306) - continued | | | | | | | | |
| EG020B-F: Silver | 7440-22-4 | 0.001 | mg/L | <0.001 | 0.02 mg/L | 113 | 70.0 | 130 |
| EG020F: Dissolved Metals by ICP-MS (QCLot: 5767309) | | | | | | | | |
| EG020A-F: Aluminium | 7429-90-5 | 0.01 | mg/L | <0.01 | 0.5 mg/L | 92.7 | 80.0 | 116 |
| EG020A-F: Arsenic | 7440-38-2 | 0.001 | mg/L | <0.001 | 0.1 mg/L | 92.4 | 85.0 | 114 |
| EG020A-F: Cadmium | 7440-43-9 | 0.0001 | mg/L | <0.0001 | 0.1 mg/L | 93.2 | 84.0 | 110 |
| EG020A-F: Chromium | 7440-47-3 | 0.001 | mg/L | <0.001 | 0.1 mg/L | 94.3 | 85.0 | 111 |
| EG020A-F: Copper | 7440-50-8 | 0.001 | mg/L | <0.001 | 0.1 mg/L | 91.6 | 81.0 | 111 |
| EG020A-F: Lead | 7439-92-1 | 0.001 | mg/L | <0.001 | 0.1 mg/L | 90.3 | 83.0 | 111 |
| EG020A-F: Manganese | 7439-96-5 | 0.001 | mg/L | <0.001 | 0.1 mg/L | 92.2 | 82.0 | 110 |
| EG020A-F: Nickel | 7440-02-0 | 0.001 | mg/L | <0.001 | 0.1 mg/L | 92.0 | 82.0 | 112 |
| EG020A-F: Zinc | 7440-66-6 | 0.005 | mg/L | <0.005 | 0.1 mg/L | 94.4 | 81.0 | 117 |
| EG020A-F: Iron | 7439-89-6 | 0.05 | mg/L | <0.05 | 0.5 mg/L | 94.9 | 82.0 | 112 |
| EG020T: Total Metals by ICP-MS (QCLot: 5765535) | | | | | | | | |
| EG020B-T: Silver | 7440-22-4 | 0.001 | mg/L | <0.001 | 0.02 mg/L | 110 | 70.0 | 130 |
| EG020T: Total Metals by ICP-MS (QCLot: 5765536) | | | | | | | | |
| EG020A-T: Aluminium | 7429-90-5 | 0.01 | mg/L | <0.01 | 0.5 mg/L | 90.2 | 82.0 | 120 |
| EG020A-T: Arsenic | 7440-38-2 | 0.001 | mg/L | <0.001 | 0.1 mg/L | 102 | 82.0 | 114 |
| EG020A-T: Cadmium | 7440-43-9 | 0.0001 | mg/L | <0.0001 | 0.1 mg/L | 94.3 | 84.0 | 112 |
| EG020A-T: Chromium | 7440-47-3 | 0.001 | mg/L | <0.001 | 0.1 mg/L | 95.2 | 86.0 | 116 |
| EG020A-T: Copper | 7440-50-8 | 0.001 | mg/L | <0.001 | 0.1 mg/L | 98.9 | 83.0 | 118 |
| EG020A-T: Lead | 7439-92-1 | 0.001 | mg/L | <0.001 | 0.1 mg/L | 95.5 | 85.0 | 115 |
| EG020A-T: Manganese | 7439-96-5 | 0.001 | mg/L | <0.001 | 0.1 mg/L | 94.4 | 85.0 | 113 |
| EG020A-T: Nickel | 7440-02-0 | 0.001 | mg/L | <0.001 | 0.1 mg/L | 97.5 | 84.0 | 116 |
| EG020A-T: Zinc | 7440-66-6 | 0.005 | mg/L | <0.005 | 0.1 mg/L | 102 | 79.0 | 117 |
| EG020A-T: Iron | 7439-89-6 | 0.05 | mg/L | <0.05 | 0.5 mg/L | 106 | 85.0 | 117 |
| EG035F: Dissolved Mercury by FIMS (QCLot: 5766569) | | | | | | | | |
| EG035F: Mercury | 7439-97-6 | 0.0001 | mg/L | <0.0001 | 0.01 mg/L | 87.9 | 83.0 | 105 |
| EG035F: Dissolved Mercury by FIMS (QCLot: 5766573) | | | | | | | | |
| EG035F: Mercury | 7439-97-6 | 0.0001 | mg/L | <0.0001 | 0.01 mg/L | 89.1 | 83.0 | 105 |
| EG035F: Dissolved Mercury by FIMS (QCLot: 5767308) | | | | | | | | |
| EG035F: Mercury | 7439-97-6 | 0.0001 | mg/L | <0.0001 | 0.01 mg/L | 93.3 | 83.0 | 105 |
| EG035T: Total Recoverable Mercury by FIMS (QCLot: 5766575) | | | | | | | | |
| EG035T: Mercury | 7439-97-6 | 0.0001 | mg/L | <0.0001 | 0.01 mg/L | 91.7 | 77.0 | 111 |
| EK026SF: Total CN by Segmented Flow Analyser (QCLot: 5771645) | | | | | | | | |



Sub-Matrix: **WATER**

| Method: Compound | CAS Number | LOR | Unit | Method Blank (MB) Report Result | Laboratory Control Spike (LCS) Report | | | |
|--|------------|-------|------|---------------------------------|---------------------------------------|--------------------|-----------------------|------|
| | | | | | Spike Concentration | Spike Recovery (%) | Acceptable Limits (%) | |
| | | | | | | LCS | Low | High |
| EK026SF: Total CN by Segmented Flow Analyser (QCLot: 5771645) - continued | | | | | | | | |
| EK026SF: Total Cyanide | 57-12-5 | 0.004 | mg/L | <0.004 | 0.2 mg/L | 112 | 73.0 | 133 |
| EK055G: Ammonia as N by Discrete Analyser (QCLot: 5769017) | | | | | | | | |
| EK055G: Ammonia as N | 7664-41-7 | 0.01 | mg/L | <0.01 | 0.5 mg/L | 92.6 | 90.0 | 114 |
| EK057G: Nitrite as N by Discrete Analyser (QCLot: 5761468) | | | | | | | | |
| EK057G: Nitrite as N | 14797-65-0 | 0.01 | mg/L | <0.01 | 0.5 mg/L | 96.0 | 82.0 | 114 |
| EK057G: Nitrite as N by Discrete Analyser (QCLot: 5761472) | | | | | | | | |
| EK057G: Nitrite as N | 14797-65-0 | 0.01 | mg/L | <0.01 | 0.5 mg/L | 96.9 | 82.0 | 114 |
| EK059G: Nitrite plus Nitrate as N (NOx) by Discrete Analyser (QCLot: 5769019) | | | | | | | | |
| EK059G: Nitrite + Nitrate as N | ---- | 0.01 | mg/L | <0.01 | 0.5 mg/L | 102 | 91.0 | 113 |
| EK061G: Total Kjeldahl Nitrogen By Discrete Analyser (QCLot: 5769016) | | | | | | | | |
| EK061G: Total Kjeldahl Nitrogen as N | ---- | 0.1 | mg/L | <0.1 | 10 mg/L | 87.9 | 69.0 | 123 |
| | | | | <0.1 | 1 mg/L | 99.4 | 70.0 | 123 |
| | | | | <0.1 | 5 mg/L | 95.0 | 70.0 | 123 |
| EK067G: Total Phosphorus as P by Discrete Analyser (QCLot: 5769015) | | | | | | | | |
| EK067G: Total Phosphorus as P | ---- | 0.01 | mg/L | <0.01 | 4.42 mg/L | 89.0 | 71.3 | 126 |
| | | | | <0.01 | 0.442 mg/L | 86.4 | 71.3 | 126 |
| | | | | <0.01 | 1 mg/L | 92.7 | 70.0 | 130 |
| EK071G: Reactive Phosphorus as P by discrete analyser (QCLot: 5761471) | | | | | | | | |
| EK071G: Reactive Phosphorus as P | 14265-44-2 | 0.01 | mg/L | <0.01 | 0.5 mg/L | 101 | 85.0 | 117 |

Matrix Spike (MS) Report

The quality control term Matrix Spike (MS) refers to an intralaboratory split sample spiked with a representative set of target analytes. The purpose of this QC parameter is to monitor potential matrix effects on analyte recoveries. Static Recovery Limits as per laboratory Data Quality Objectives (DQOs). Ideal recovery ranges stated may be waived in the event of sample matrix interference.

Sub-Matrix: **WATER**

| Laboratory sample ID | Sample ID | Method: Compound | CAS Number | Matrix Spike (MS) Report | | | |
|--|-----------|---------------------|------------|--------------------------|-------------------|-----------------------|------|
| | | | | Spike Concentration | Spike Recovery(%) | Acceptable Limits (%) | |
| | | | | | MS | Low | High |
| EG020F: Dissolved Metals by ICP-MS (QCLot: 5766566) | | | | | | | |
| ES2413802-002 | Anonymous | EG020A-F: Arsenic | 7440-38-2 | 1 mg/L | 112 | 70.0 | 130 |
| | | EG020A-F: Cadmium | 7440-43-9 | 0.25 mg/L | 97.9 | 70.0 | 130 |
| | | EG020A-F: Chromium | 7440-47-3 | 1 mg/L | 102 | 70.0 | 130 |
| | | EG020A-F: Copper | 7440-50-8 | 1 mg/L | 74.5 | 70.0 | 130 |
| | | EG020A-F: Lead | 7439-92-1 | 1 mg/L | 118 | 70.0 | 130 |
| | | EG020A-F: Manganese | 7439-96-5 | 1 mg/L | 90.3 | 70.0 | 130 |
| | | EG020A-F: Nickel | 7440-02-0 | 1 mg/L | 102 | 70.0 | 130 |
| | | EG020A-F: Zinc | 7440-66-6 | 1 mg/L | 96.8 | 70.0 | 130 |



Sub-Matrix: WATER

| | | | | Matrix Spike (MS) Report | | | |
|--|-----------|------------------------|------------|--------------------------|------------------|-----------------------|------|
| | | | | Spike | SpikeRecovery(%) | Acceptable Limits (%) | |
| Laboratory sample ID | Sample ID | Method: Compound | CAS Number | Concentration | MS | Low | High |
| EG020F: Dissolved Metals by ICP-MS (QCLot: 5766571) | | | | | | | |
| ES2414062-009 | YK-IS | EG020A-F: Arsenic | 7440-38-2 | 1 mg/L | 95.6 | 70.0 | 130 |
| | | EG020A-F: Cadmium | 7440-43-9 | 0.25 mg/L | 98.0 | 70.0 | 130 |
| | | EG020A-F: Chromium | 7440-47-3 | 1 mg/L | 93.8 | 70.0 | 130 |
| | | EG020A-F: Copper | 7440-50-8 | 1 mg/L | 95.1 | 70.0 | 130 |
| | | EG020A-F: Lead | 7439-92-1 | 1 mg/L | 95.6 | 70.0 | 130 |
| | | EG020A-F: Manganese | 7439-96-5 | 1 mg/L | 94.0 | 70.0 | 130 |
| | | EG020A-F: Nickel | 7440-02-0 | 1 mg/L | 95.9 | 70.0 | 130 |
| | | EG020A-F: Zinc | 7440-66-6 | 1 mg/L | 94.8 | 70.0 | 130 |
| EG020F: Dissolved Metals by ICP-MS (QCLot: 5767309) | | | | | | | |
| ES2414016-001 | Anonymous | EG020A-F: Arsenic | 7440-38-2 | 2 mg/L | 99.0 | 70.0 | 130 |
| | | EG020A-F: Cadmium | 7440-43-9 | 0.5 mg/L | 103 | 70.0 | 130 |
| | | EG020A-F: Chromium | 7440-47-3 | 2 mg/L | 102 | 70.0 | 130 |
| | | EG020A-F: Copper | 7440-50-8 | 2 mg/L | 97.0 | 70.0 | 130 |
| | | EG020A-F: Lead | 7439-92-1 | 2 mg/L | 99.1 | 70.0 | 130 |
| | | EG020A-F: Manganese | 7439-96-5 | 2 mg/L | 104 | 70.0 | 130 |
| | | EG020A-F: Nickel | 7440-02-0 | 2 mg/L | 101 | 70.0 | 130 |
| | | EG020A-F: Zinc | 7440-66-6 | 2 mg/L | 102 | 70.0 | 130 |
| EG020T: Total Metals by ICP-MS (QCLot: 5765536) | | | | | | | |
| ES2414062-002 | WC-IS | EG020A-T: Arsenic | 7440-38-2 | 1 mg/L | 101 | 70.0 | 130 |
| | | EG020A-T: Cadmium | 7440-43-9 | 0.25 mg/L | 92.7 | 70.0 | 130 |
| | | EG020A-T: Chromium | 7440-47-3 | 1 mg/L | 97.7 | 70.0 | 130 |
| | | EG020A-T: Copper | 7440-50-8 | 1 mg/L | 101 | 70.0 | 130 |
| | | EG020A-T: Lead | 7439-92-1 | 1 mg/L | 99.1 | 70.0 | 130 |
| | | EG020A-T: Manganese | 7439-96-5 | 1 mg/L | 95.2 | 70.0 | 130 |
| | | EG020A-T: Nickel | 7440-02-0 | 1 mg/L | 94.5 | 70.0 | 130 |
| | | EG020A-T: Zinc | 7440-66-6 | 1 mg/L | 101 | 70.0 | 130 |
| EG035F: Dissolved Mercury by FIMS (QCLot: 5766569) | | | | | | | |
| ES2413802-001 | Anonymous | EG035F: Mercury | 7439-97-6 | 0.1 mg/L | 81.1 | 70.0 | 130 |
| EG035F: Dissolved Mercury by FIMS (QCLot: 5766573) | | | | | | | |
| ES2414062-008 | NZG-IS | EG035F: Mercury | 7439-97-6 | 0.01 mg/L | 92.0 | 70.0 | 130 |
| EG035F: Dissolved Mercury by FIMS (QCLot: 5767308) | | | | | | | |
| ES2414005-004 | Anonymous | EG035F: Mercury | 7439-97-6 | 0.01 mg/L | 78.9 | 70.0 | 130 |
| EG035T: Total Recoverable Mercury by FIMS (QCLot: 5766575) | | | | | | | |
| ES2414062-001 | WC-RS | EG035T: Mercury | 7439-97-6 | 0.01 mg/L | 91.2 | 70.0 | 130 |
| EK026SF: Total CN by Segmented Flow Analyser (QCLot: 5771645) | | | | | | | |
| ES2414014-001 | Anonymous | EK026SF: Total Cyanide | 57-12-5 | 1 mg/L | 89.2 | 70.0 | 130 |

Page : 11 of 11
 Work Order : ES2414062
 Client : UGL LIMITED
 Project : 3200-0645 TransGrid Maragle 500/330kV Station. (Event 25)



Sub-Matrix: WATER

| | | | | Matrix Spike (MS) Report | | | |
|--|-----------|--------------------------------------|------------|--------------------------|------------------|-----------------------|------|
| | | | | Spike | SpikeRecovery(%) | Acceptable Limits (%) | |
| Laboratory sample ID | Sample ID | Method: Compound | CAS Number | Concentration | MS | Low | High |
| EK057G: Nitrite as N by Discrete Analyser (QCLot: 5761468) | | | | | | | |
| ES2413955-001 | Anonymous | EK057G: Nitrite as N | 14797-65-0 | 0.5 mg/L | 98.3 | 70.0 | 130 |
| EK057G: Nitrite as N by Discrete Analyser (QCLot: 5761472) | | | | | | | |
| ES2414062-004 | LHG-IS | EK057G: Nitrite as N | 14797-65-0 | 0.5 mg/L | 101 | 70.0 | 130 |
| EK059G: Nitrite plus Nitrate as N (NOx) by Discrete Analyser (QCLot: 5769019) | | | | | | | |
| ES2413960-009 | Anonymous | EK059G: Nitrite + Nitrate as N | ---- | 0.5 mg/L | 101 | 70.0 | 130 |
| EK061G: Total Kjeldahl Nitrogen By Discrete Analyser (QCLot: 5769016) | | | | | | | |
| ES2413978-001 | Anonymous | EK061G: Total Kjeldahl Nitrogen as N | ---- | 100 mg/L | 87.9 | 70.0 | 130 |
| EK067G: Total Phosphorus as P by Discrete Analyser (QCLot: 5769015) | | | | | | | |
| ES2413978-001 | Anonymous | EK067G: Total Phosphorus as P | ---- | 20 mg/L | 90.0 | 70.0 | 130 |
| EK071G: Reactive Phosphorus as P by discrete analyser (QCLot: 5761471) | | | | | | | |
| ES2413992-004 | Anonymous | EK071G: Reactive Phosphorus as P | 14265-44-2 | 0.5 mg/L | 102 | 70.0 | 130 |

| Mandatory Fields | | | | CHAIN OF CUSTODY | | | | | | | | | | | | Page <u> </u> of <u> </u> | | | | | | | | | | | | | |
|--|------------|--|---------------|--|--------|--|------------------|---|------------------------|---|------------------|--|---------|--|-------------------------|---------------------------------|-------------------------------------|--|---|------------------------|--|---------|--|---------------------|--|-------------------------|--|-----------------|--|
| CLIENT CODE: UFLIM | | *PROJECT MANAGER: Tim McCarthy | | | | SAMPLER: Lachlan Whiteford | | | | | | | | | | | | | | | | | | | | | | | |
| *CLIENT: UGL Limited | | *PM MOBILE: 0455 087 248 | | | | SAMPLER MOBILE: 0475 369 909 | | | | | | | | | | | | | | | | | | | | | | | |
| OFFICE: (Invoiced Office) | | ALS QUOTE #: ES24UGLLIM0001_V2 (Client PL if blank) | | | | PURCHASE ORDER NO.: TBC | | | | | | | | | | | | | | | | | | | | | | | |
| PROJECT NO./PROJECT: 3200-0645 TransGrid Maragle 500/330kV Station. (Event 25) | | | | SITE: Maragle/Lobs Hole | | | | | | | | <input type="checkbox"/> CC Invoice to PM | | | | | | | | | | | | | | | | | |
| *INVOICE TO: (client default if nil) | | | | | | | | | | | | BIOSECURITY | | | | | | | | | | | | | | | | | |
| *EMAIL REPORTS TO: (default to PM if blank) | | | | *ANALYSIS REQUIRED <small>(NB: ALS Quote No. and/or Analysis Suite Codes must be listed to attract suite/quoted price) Where Metals are required, specify Total (unfiltered bottle required) or Dissolved (field filtered bottle required). Mark an X in the boxes below analysis to indicate the parameter listed above to be tested on that sample.</small> | | | | | | | | Country of Origin: <small>(if not Australia)</small> | | | | | | | | | | | | | | | | | |
| <p>* STORAGE REQUIREMENTS <input checked="" type="checkbox"/> Standard Storage <small>Please check box.</small></p> <p><input type="checkbox"/> Extended Storage <small>Standard Storage time from receipt of samples: Waters - 3 weeks Soils - 2 months</small></p> <p>Specify Disposal Date: <small>Note: Extended storage incurs a fee and requires a signed agreement.</small></p> | | | | <p>* TURNAROUND <input checked="" type="checkbox"/> 5+ days (no surcharge) <small>Please check box.</small></p> <p><input type="checkbox"/> 3 day (+15%) <input type="checkbox"/> 2 day (+30%) <input type="checkbox"/> 1 day (+50%)</p> <p><small>(Not all tests can be expedited, contact Client Services for more information)</small></p> | | | | | | | | | | Environmental Division Sydney Work Order Reference ES2414062 Telephone : + 61-2-8784 8555 | | | | | | | | | | | | | | | |
| PLEASE NOTE: The sampler misread the methodology and put additional blanks and duplicates in (marked with permanent marker). PLEASE DISREGARD! Only Account for 6 sample bottles per site, plus the duplicate taken at YR1-RS, the rest can be disregarded. Apologies for the confusion. | | | | | | MATRIX: Soil/Solids(S) Water(W) Sediments (SD) Dust (D), Product (P), Biota (B), Biosolid (BS) | | Total Nitrogen | | Total Phosphorus | | Cyanide | | Total Suspended Solids | | Total Metals | | Dissolved metals | | Total Hardness | | Ammonia | | Reactive Phosphorus | | Total Kjeldahl Nitrogen | | Nitrogen Oxides | |
| ALS Use Only | Sample ID | Depth | Date/Time | No. Bottles | MATRIX | Total Nitrogen | Total Phosphorus | Cyanide | Total Suspended Solids | Total Metals | Dissolved metals | Total Hardness | Ammonia | Reactive Phosphorus | Total Kjeldahl Nitrogen | Nitrogen Oxides | Lab QC (additional bottles req.) | Additional information (Comment on hazards - e.g., asbestos, known high contamination) | | | | | | | | | | | |
| Lab ID | | | | | | | | | | | | | | | | | Dup | MS | | | | | | | | | | | |
| 1 | WC-RS | 18cm | 4/29/24 14:55 | 6 | W | X | X | X | X | X | X | X | X | X | X | X | <input type="checkbox"/> | <input type="checkbox"/> | | | | | | | | | | | |
| 2 | WC-IS | 31cm | 4/29/24 14:10 | 6 | W | X | X | X | X | X | X | X | X | X | X | X | <input type="checkbox"/> | <input type="checkbox"/> | | | | | | | | | | | |
| 3 | YR1-RS | 25cm | 4/29/24 13:25 | 7 | W | X | X | X | X | X | X | X | X | X | X | X | <input checked="" type="checkbox"/> | <input type="checkbox"/> | Duplicate sample supplied, labelled on bottle with marker | | | | | | | | | | |
| 4 | LHG-IS | 15cm | 4/29/24 15:10 | 6 | W | X | X | X | X | X | X | X | X | X | X | X | <input type="checkbox"/> | <input type="checkbox"/> | | | | | | | | | | | |
| 5 | YR2-RS | 24cm | 4/29/24 15:50 | 6 | W | X | X | X | X | X | X | X | X | X | X | X | <input type="checkbox"/> | <input type="checkbox"/> | | | | | | | | | | | |
| 6 | TR-RS | 35cm | 4/29/24 10:15 | 6 | W | X | X | X | X | X | X | X | X | X | X | X | <input type="checkbox"/> | <input type="checkbox"/> | | | | | | | | | | | |
| 7 | YK-IS(d/s) | 12cm | 4/29/24 9:31 | 6 | W | X | X | X | X | X | X | X | X | X | X | X | <input type="checkbox"/> | <input type="checkbox"/> | | | | | | | | | | | |
| 8 | NZG-IS | 27cm | 4/29/24 7:40 | 6 | W | X | X | X | X | X | X | X | X | X | X | X | <input type="checkbox"/> | <input type="checkbox"/> | | | | | | | | | | | |
| 9 | YK-IS | 25cm | 4/29/24 8:58 | 6 | W | X | X | X | X | X | X | X | X | X | X | X | <input type="checkbox"/> | <input type="checkbox"/> | | | | | | | | | | | |
| 10 | YK-RS | 32cm | 4/29/24 8:23 | 6 | W | X | X | X | X | X | X | X | X | X | X | X | <input type="checkbox"/> | <input type="checkbox"/> | | | | | | | | | | | |
| 11 | DUP01 | | 4/29/24 0:00 | | W | | | | | X | X | | | | | | <input type="checkbox"/> | <input type="checkbox"/> | NOTE: This has been accounted for in quantity for YR1-RS | | | | | | | | | | |
| 12 | WATERBLANK | | 4/29/24 0:00 | | W | X | X | X | X | X | X | X | X | X | X | X | <input type="checkbox"/> | <input type="checkbox"/> | NOTE: This has been accounted for in quantities for each location | | | | | | | | | | |
| Receipt Detail (Lab Use ONLY) | | Chilling Method: <input checked="" type="radio"/> Ice / Melted | | Ice Bricks: <input type="checkbox"/> Frozen / Thawed | | None | | Sample Temp at Receipt: °C °C °C | | Security Seal Intact (circle) Yes / No / NA(None) | | Carrier Details: <input type="checkbox"/> Courier/Post <input type="checkbox"/> Client | | Packaging: (Circle) <input checked="" type="radio"/> Hard Esky <input type="radio"/> Foam Esky <input type="radio"/> Box/Bag/Other | | Count: # 2 Eslys # # | | | | | | | | | | | | | |
| Relinquished by: Lachlan Whiteford | | | | Signature: | | | | Date/Time: 01.05.25, 10:15 am | | | | Received by: | | | | Signature: | | | | Date/Time: 1/5/24 1440 | | | | | | | | | |
| Relinquished by: | | | | Signature: | | | | Date/Time: | | | | Received by: | | | | Signature: | | | | Date/Time: | | | | | | | | | |



Appendix C: April 2024 SWQ Monitoring Results

| Parameter | Sheen/ oil/ grease | Temp. (°C) | Dissolved Oxygen (DO %) | | Specific EC | | | Redox (mV) | Turbidity (NTU) | Dissolved Al (mg/L) | Dissolved As (mg/L) | Dissolved Cd (mg/L) | Dissolved Cr (mg/L) | Dissolved Cu (mg/L) | Cyanide (mg/L) | Dissolved Fe (mg/L) | Dissolved Pb (mg/L) | Dissolved Mn (mg/L) | Dissolved Hg (mg/L) | Dissolved Ni (mg/L) | TN (mg/L) | TP (mg/L) | |
|--|--|------------|-------------------------|----------|-------------|------------|-------|------------|-----------------|---------------------|---------------------|---------------------|---------------------|---------------------|----------------|---------------------|---------------------|---------------------|---------------------|---------------------|-----------|-----------|------|
| | | | Oxygen (DO %) | DO (ppm) | (SPC uS/cm) | EC (uS/cm) | pH | | | | | | | | | | | | | | | | |
| YARRANGOBILLY CATCHMENT | | | | | | | | | | | | | | | | | | | | | | | |
| Default Guideline Value (DGV) | No | - | 90-110 | - | 30-350 | 30-350 | 6.5-8 | - | 2-25 | 0.027 | 0.0008 | 0.0006 | 0.00001 | 0.001 | 0.004 | 0.3 | 0.001 | 1.2 | 0.00006 | 0.008 | 0.25 | 0.02 | |
| Limit of Reporting (LOR) | - | - | - | - | - | - | - | - | 0.1 | 0.01 | 0.001 | 0.0001 | 0.001 | 0.002 | 0.05 | 0.001 | 0.001 | 0.0001 | 0.001 | 0.1 | 0.01 | | |
| Dec - May Site Specific Guideline Value (SSGV) | | | 90-110 | 9.08 | 115 | 93.2 | 6.5-8 | 79.1 | 0.37 | 0.03 | 0.0003 | 0.00002 | 0.00001 | 0.0002 | 0.03 | 0.001 | 0.002 | 0.00003 | 0.001 | 0.2 | 0.02 | | |
| June - Nov SSGV | | | 90-110 | 10.28 | 88 | 60.85 | 6.5-8 | 98.4 | 5.12 | 0.04 | 0.0003 | 0.00002 | 0.00001 | 0.0002 | 0.02 | 0.001 | 0.002 | 0.00003 | 0.001 | 0.2 | 0.02 | | |
| WC-RS | Mar-24 | No | 10.7 | 87.5 | 9.72 | 143.6 | 104.3 | 7.8 | 25.9 | 0.1 | 0.02 | 0.00015 | 0.00001 | 0.00001 | 0.002 | 0.03 | 0.002 | 0.003 | 0.00002 | 0.001 | 0.1 | 0.03 | |
| | Apr-24 | No | 10.7 | 94.8 | - | 145.6 | - | 8.44 | - | 1.05 | 0.01 | 0.001 | 0.0001 | 0.001 | 0.002 | 0.11 | 0.001 | 0.007 | 0.0001 | 0.001 | 0.1 | 0.02 | |
| WC-IS | Mar-24 | No | 10.7 | 87.1 | 9.68 | 145.9 | 105.9 | 7.83 | 41.9 | 0.1 | 0.03 | 0.00015 | 0.00001 | 0.00001 | 0.002 | 0.03 | 0.002 | 0.003 | 0.00002 | 0.0005 | 0.1 | 0.005 | |
| | Apr-24 | No | 10.7 | 95.0 | - | 145.2 | - | 8.45 | - | 0.9 | 0.01 | 0.001 | 0.0001 | 0.001 | 0.002 | 0.07 | 0.001 | 0.006 | 0.0001 | 0.001 | 2.7 | 0.02 | |
| CG-IS | Mar-24 | No Flow | - | - | - | - | - | - | - | - | - | - | - | - | - | - | - | - | - | - | - | - | |
| | Apr-24 | No Flow | - | - | - | - | - | - | - | - | - | - | - | - | - | - | - | - | - | - | - | - | |
| YR1-IS | Mar-24 | No | 12.2 | 88.2 | 9.47 | 129.4 | 97.7 | 7.81 | 53.8 | 0.1 | 0.05 | 0.00015 | 0.00001 | 0.000005 | 0.002 | 0.03 | 0.0005 | 0.002 | 0.000015 | 0.001 | 0.1 | 0.005 | |
| | Apr-24 | No | 11.3 | 97.4 | - | 136.1 | - | 8.49 | - | 1.23 | 0.01 | 0.001 | 0.0001 | 0.001 | 0.002 | 0.05 | 0.001 | 0.002 | 0.0001 | 0.001 | 0.1 | 0.01 | |
| LHG-IS | Mar-24 | Yes | 11.9 | 59.2 | 6.38 | 596 | 447.2 | 7.35 | -17.2 | 408.5 | 0.2 | 0.00015 | 0.00001 | 0.001 | 0.003 | 0.01 | 0.18 | 0.005 | 0.04 | 0.000015 | 0.003 | 0.1 | 0.01 |
| | Apr-24 | No | 12.5 | 60.1 | - | 658 | - | 7.69 | - | 69.72 | 0.01 | 0.001 | 0.0001 | 0.001 | 0.002 | 0.34 | 0.001 | 0.184 | 0.0001 | 0.001 | 0.5 | 0.09 | |
| YR2-IS | Mar-24 | No | 12.3 | 88.5 | 9.47 | 130.8 | 99.1 | 7.93 | 43.2 | 0.1 | 0.03 | 0.00015 | 0.00001 | 0.000005 | 0.001 | 0.02 | 0.005 | 0.001 | 0.000015 | 0.001 | 0.1 | 0.005 | |
| | Apr-24 | No | 11.8 | 97.1 | - | 139.7 | - | 8.52 | - | 1.16 | 0.01 | 0.001 | 0.0001 | 0.001 | 0.002 | 0.05 | 0.001 | 0.003 | 0.0001 | 0.001 | 0.1 | 0.01 | |
| SSC-IS | Mar-24 | No Flow | - | - | - | - | - | - | - | - | - | - | - | - | - | - | - | - | - | - | - | - | |
| | Apr-24 | No Flow | - | - | - | - | - | - | - | - | - | - | - | - | - | - | - | - | - | - | - | - | |
| TALBINGO RESERVOIR | | | | | | | | | | | | | | | | | | | | | | | |
| DGV | No | - | 90-110 | - | 30-350 | 30-350 | 6.5-8 | - | 2-25 | 0.027 | 0.0008 | 0.0006 | 0.00001 | 0.001 | 0.004 | 0.3 | 0.001 | 1.2 | 0.00006 | 0.008 | 0.25 | 0.02 | |
| LOR | - | - | - | - | - | - | - | - | - | 0.1 | 0.01 | 0.001 | 0.0001 | 0.001 | 0.002 | 0.05 | 0.001 | 0.001 | 0.0001 | 0.001 | 0.1 | 0.01 | |
| Dec - May SSGV | | | 90-100 | 8.79 | 24.0 | 20.3 | 6.5-8 | 91.2 | 0.09 | 0.03 | 0.003 | 0.00002 | 0.00001 | 0.0002 | 0.02 | 0.04 | 0.001 | 0.003 | 0.00003 | 0.001 | 0.2 | 0.02 | |
| June - Nov SSGV | | | 90-100 | 11.53 | 38.7 | 26.2 | 6.5-8 | 95.4 | 1.56 | 0.015 | 0.0003 | 0.00002 | 0.00001 | 0.0002 | 0.02 | 0.02 | 0.001 | 0.002 | 0.00003 | 0.001 | 0.2 | 0.02 | |
| TR-RS | Mar-24 | No | 13.4 | 72.5 | 7.57 | 24 | 18.7 | 7.1 | 55 | 0.1 | 0.015 | 0.00015 | 0.00001 | 0.000005 | 0.001 | 0.05 | 0.005 | 0.005 | 0.000015 | 0.0005 | 0.1 | 0.01 | |
| | Apr-24 | No | 12.2 | 85.9 | - | 25.9 | - | 7.17 | - | 0.02 | 0.01 | 0.001 | 0.0001 | 0.001 | 0.005 | 0.02 | 0.001 | 0.026 | 0.0001 | 0.001 | 1.3 | 0.02 | |
| YORKERS CREEK CATCHMENT | | | | | | | | | | | | | | | | | | | | | | | |
| DGV | No | - | 90-110 | - | 30-350 | 30-350 | 6.5-8 | - | 2-25 | 0.027 | 0.0008 | 0.0006 | 0.00001 | 0.001 | 0.004 | 0.3 | 0.001 | 1.2 | 0.00006 | 0.008 | 0.25 | 0.02 | |
| LOR | - | - | - | - | - | - | - | - | - | 0.1 | 0.01 | 0.001 | 0.0001 | 0.001 | 0.002 | 0.05 | 0.001 | 0.001 | 0.0001 | 0.001 | 0.1 | 0.01 | |
| Dec - May SSGV | | | 90-110 | 8.35 | 31 | 24 | 6.5-8 | 94.6 | 9 | 0.36 | 0.003 | 0.00002 | 0.00001 | 0.0002 | 0.02 | 0.41 | 0.001 | 0.005 | 0.00003 | 0.001 | 0.2 | 0.02 | |
| June - Nov SSGV | | | 90-110 | 10.2 | 27.9 | 20.5 | 6.5-8 | 106.1 | 7.87 | 0.32 | 0.0003 | 0.00002 | 0.00001 | 0.0002 | 0.02 | 0.23 | 0.001 | 0.003 | 0.00003 | 0.001 | 0.2 | 0.02 | |
| YK-RS | Mar-24 | Yes | 16.3 | 82.5 | 8.09 | 31.5 | 26.2 | 6.69 | 64.5 | 12.24 | 0.6 | 0.00015 | 0.00001 | 0.000005 | 0.001 | 0.001 | 0.66 | 0.002 | 0.013 | 0.000015 | 0.0005 | 0.1 | 0.03 |
| | Apr-24 | No | 6.8 | 80.7 | - | 36.5 | - | 7.04 | - | 17.27 | 0.10 | - | 0.0001 | 0.001 | 0.001 | 0.002 | 0.12 | 0.001 | 0.014 | 0.0001 | 0.001 | 0.6 | 0.04 |
| YK-IS (D/S) | Mar-24 | No | 10 | 81.6 | 9.21 | 39.1 | 27.9 | 7.02 | 63.2 | 0.1 | 0.0065 | 0.00015 | 0.00001 | 0.000005 | 0.0001 | 0.001 | 0.26 | 0.0005 | 0.006 | 0.000015 | 0.0005 | 0.1 | 0.02 |
| | Apr-24 | No | 5.9 | 86.0 | - | 39.4 | - | 7.33 | - | 221.78 | 0.05 | 0.001 | 0.0001 | 0.001 | 0.001 | 0.002 | 0.11 | 0.001 | 0.014 | 0.0001 | 0.001 | 0.1 | 0.02 |
| NZG-IS | Mar-24 | No | 9.6 | 80.2 | 9.13 | 64.2 | 45.3 | 7.45 | 31.1 | 0.1 | 0.14 | 0.00015 | 0.00001 | 0.000005 | 0.0001 | 0.001 | 0.18 | 0.0005 | 0.004 | 0.000015 | 0.0005 | 0.1 | 0.01 |
| | Apr-24 | No | 6.4 | 84.9 | - | 67.1 | - | 7.38 | - | 0.96 | 0.03 | - | 0.0001 | 0.001 | 0.002 | 0.08 | 0.001 | 0.006 | 0.0001 | 0.001 | 0.1 | 0.02 | |
| YK-IS | Mar-24 | No | 11.4 | 78.0 | 8.53 | 35 | 25.9 | 6.7 | 41.1 | 21.44 | 0.45 | 0.00015 | 0.00001 | 0.000005 | 0.001 | 0.001 | 0.4 | 0.0005 | 0.018 | 0.000015 | 0.0005 | 0.1 | 0.01 |
| | Apr-24 | No | 6.8 | 80.7 | - | 36.5 | - | 7.04 | - | 12.37 | 0.09 | 0.001 | 0.0001 | 0.001 | 0.001 | 0.002 | 0.15 | 0.001 | 0.016 | 0.0001 | 0.001 | 0.3 | 0.02 |
| | May-24 | No | 4.7 | 82.7 | - | 35.8 | - | 6.43 | - | 0.2 | 0.06 | 0.001 | 0.0001 | 0.001 | 0.001 | 0.004 | 0.1 | 0.001 | 0.015 | 0.0001 | 0.001 | 0.2 | 0.03 |
| | Reference Site exceeds SSGV | | | | | | | | | | | | | | | | | | | | | | |
| | Impact Site Result exceeds SSGV or DGV | | | | | | | | | | | | | | | | | | | | | | |
| <i>italics</i> | Result exceeds the Limit of Reporting | | | | | | | | | | | | | | | | | | | | | | |



Appendix D: Calibration Certificate

