



FEBRUARY 2026

MONTHLY CONSTRUCTION WATER QUALITY MONITORING REPORT

February 2026

Project No.: 3200-0645

Project: Transgrid Maragle 500/330 kV Substation

Private & Confidential

CONTENTS

1	BACKGROUND	7
2	INTRODUCTION	9
3	METHODOLOGY	10
4	BASELINE WATER QUALITY	16
4.1	WATER QUALITY OBJECTIVES	16
4.2	SITE SPECIFIC GUIDELINE VALUES	16
5	FEBRUARY 2026 MONITORING	17
5.1	OBSERVATIONS	18
5.2	RESULTS	25
5.2.1	KEY PHYSICAL AND CHEMICAL PARAMETERS	25
5.2.1.1	TEMPERATURE	26
5.2.1.2	PH	27
5.2.1.3	DISSOLVED OXYGEN	28
5.2.1.4	SPECIFIC CONDUCTANCE	29
5.2.1.5	ELECTRICAL CONDUCTIVITY	30
5.2.1.6	TURBIDITY	31
5.2.1.7	TOTAL SUSPENDED SOLIDS	32
5.2.1.8	TOTAL DISSOLVED SOLIDS	33
5.2.1.9	REDOX	34
5.2.1.10	NITROGEN OXIDES	35
5.2.1.11	AMMONIA	36
5.2.1.12	CYANIDE	37
5.2.1.13	TOTAL HARDNESS	38
5.2.1.14	TOTAL KJELDAHL NITROGEN	39
5.2.1.15	TOTAL NITROGEN	40
5.2.1.16	TOTAL PHOSPHORUS	41
5.2.1.17	REACTIVE PHOSPHORUS	42
5.2.2	DISSOLVED METALS	43
5.2.3	TOTAL METALS	44
6	DISCUSSION	45
7	CONCLUSION	47
	REFERENCES	48

TABLES

TABLE 1 SWQ MONITORING LOCATIONS OUTLINED IN THE METHODOLOGY (NGH, 2022).....	10
TABLE 2 SEASONAL SSGV (NGH, 2024) AND DGV (ANZG, 2018) FOR WATER QUALITY PARAMETERS.....	13
TABLE 3 FIELD OBSERVATIONS DURING SAMPLING.....	18
TABLE 4: RESULTS FOR DISSOLVED METALS.....	43
TABLE 5: RESULTS FOR TOTAL METALS.....	44

FIGURES

FIGURE 1 LOCALITY OF THE PROJECT AND SWQ MONITORING LOCATIONS.....	8
FIGURE 2 WATER QUALITY MONITORING LOCATIONS ASSOCIATED WITH REFERENCE SITE YR-RS AND TR-RS IN RELATION TO THE PROJECT.....	11
FIGURE 3 WATER QUALITY MONITORING LOCATIONS ASSOCIATED WITH REFERENCE SITE WC-RS IN RELATION TO THE PROJECT.....	12
FIGURE 4 : TEMPERATURE FOR YARRANGOBILLY RIVER CATCHMENT.....	26
FIGURE 5: TEMPERATURE FOR TALBINGO RESERVOIR.....	26
FIGURE 6: TEMPERATURE FOR YORKERS CREEK CATCHMENT.....	26
FIGURE 7: PH FOR YARRANGOBILLY RIVER CATCHMENT.....	27
FIGURE 8: PH FOR TALBINGO RESERVOIR.....	27
FIGURE 9: PH FOR YORKERS CREEK CATCHMENT.....	27
FIGURE 10: DO FOR YARRANGOBILLY RIVER CATCHMENT.....	28
FIGURE 11: DO FOR TALBINGO RESERVOIR.....	28
FIGURE 12: DO FOR YORKERS CREEK CATCHMENT.....	28
FIGURE 13: SPC FOR YARRANGOBILLY RIVER CATCHMENT.....	29
FIGURE 14: SPC FOR TALBINGO RESERVOIR.....	29
FIGURE 15: SPC FOR YORKERS CREEK CATCHMENT.....	29
FIGURE 16: EC FOR YARRANGOBILLY RIVER CATCHMENT.....	30
FIGURE 17: EC FOR TALBINGO RESERVOIR.....	30
FIGURE 18: EC FOR YORKERS CREEK CATCHMENT.....	30
FIGURE 19: TURBIDITY FOR YARRANGOBILLY RIVER CATCHMENT.....	31
FIGURE 20: TURBIDITY FOR TALBINGO RESERVOIR.....	31
FIGURE 21: TURBIDITY FOR YORKERS CREEK CATCHMENT.....	31
FIGURE 22: TSS FOR YARRANGOBILLY RIVER CATCHMENT.....	32
FIGURE 23: TSS FOR TALBINGO RESERVOIR.....	32
FIGURE 24: TSS FOR YORKERS CREEK CATCHMENT.....	32
FIGURE 25 TDS FOR YARRANGOBILLY RIVER CATCHMENT.....	33
FIGURE 26 TDS FOR TALBINGO RESERVOIR.....	33

FIGURE 27 TDS FOR YORKERS CREEK CATCHMENT	33
FIGURE 28: REDOX FOR YARRANGOBILLY RIVER CATCHMENT	34
FIGURE 29: REDOX FOR TALBINGO RESERVOIR	34
FIGURE 30: REDOX FOR YORKERS CREEK CATCHMENT	34
FIGURE 31: NITROGEN OXIDES FOR YARRANGOBILLY RIVER CATCHMENT	35
FIGURE 32: NITROGEN OXIDES FOR TALBINGO RESERVOIR.....	35
FIGURE 33: NITROGEN OXIDES FOR YORKERS CREEK CATCHMENT	35
FIGURE 34: AMMONIA FOR YARRANGOBILLY RIVER CATCHMENT	36
FIGURE 35: AMMONIA FOR TALBINGO RESERVOIR	36
FIGURE 36: AMMONIA FOR YORKERS CREEK CATCHMENT	36
FIGURE 37: CYANIDE FOR YARRANGOBILLY RIVER CATCHMENT	37
FIGURE 38: CYANIDE FOR TALBINGO RESERVOIR	37
FIGURE 39: CYANIDE FOR YORKERS CREEK CATCHMENT	37
FIGURE 40: CACO ₃ FOR YARRANGOBILLY RIVER CATCHMENT	38
FIGURE 41: CACO ₃ FOR TALBINGO RESERVOIR	38
FIGURE 42: CACO ₃ FOR YORKERS CREEK CATCHMENT	38
FIGURE 43: TKN FOR YARRANGOBILLY RIVER CATCHMENT	39
FIGURE 44: TKN FOR TALBINGO RESERVOIR	39
FIGURE 45: TKN FOR YORKERS CREEK CATCHMENT	39
FIGURE 46: TN FOR YARRANGOBILLY RIVER CATCHMENT	40
FIGURE 47: TN FOR TALBINGO RESERVOIR	40
FIGURE 48: TN FOR YORKERS CREEK CATCHMENT	40
FIGURE 49: TP FOR YARRANGOBILLY RIVER CATCHMENT	41
FIGURE 50: TP FOR TALBINGO RESERVOIR.....	41
FIGURE 51: TP FOR YORKERS CREEK CATCHMENT	41
FIGURE 52: RP FOR YARRANGOBILLY RIVER CATCHMENT	42
FIGURE 53: RP FOR TALBINGO RESERVOIR	42
FIGURE 54: RP FOR YORKERS CREEK CATCHMENT	42

APPENDICES

APPENDIX A: FIELD SHEET (UGL, 2025)

APPENDIX B: COA (ALS, 2025A), QA/QC ASSESSMENT (ALS, 2025B) AND QCR (ALS, 2025C)

APPENDIX C: FEBRUARY 2026 WQ MONITORING RESULTS

APPENDIX D: CALIBRATION CERTIFICATE

ABBREVIATIONS

Acronym	Full Form
°C	degrees Celsius
µS/cm	micro Siemens per centimetre
%	percent
4WD	Four wheel drive
Ag	Silver
Al	Aluminium
ALS	ALS Limited
ANZECC	Australian and New Zealand Environment and Conservation Council
ANZG	Australian and New Zealand Guidelines
ARMCANZ	Agriculture and Resource Management Council of Australia and New Zealand
As	Arsenic
Baseline Report	'Baseline Water Quality Report' (NGH, 2024)
CaCO ₃	Total Hardness
Cd	Cadmium
COA	'Certificate of Analysis' (ALS, 2025a)
COC	Chain of Custody
Cr	Chromium
Cu	Copper
DGV	Default Guideline Values
DO	Dissolved Oxygen
EC	Electrical Conductivity
EIS	Environmental Impact Statement
EPL	Environmental Protection Licence
Fe	Iron
Field Sheet	'Water Quality Monitoring Field Data Sheet' (UGL, 2025)
Hg	Mercury
km	kilometres
KNP	Kosciuszko National Park
kV	kilovolt
LOR	limit of reporting
mg/L	milligram per litre
mm	millimetre
Mn	Manganese
mV	millivolt
NATA	National Association of Testing Authorities, Australia

ABBREVIATIONS

Acronym	Full Form
NEM	National Energy Market
NGH	NGH Pty Ltd
Ni	Nickel
NSW	New South Wales
NTU	Nephelometric Turbidity Unit
Pb	Lead
ppm	parts per million
Pty Ltd	Proprietary Limited
QA/QC Assessment	'QA/QC Compliance Assessment to assist with Quality Review' (ALS, 2025b)
QCR	'Quality Control Report' (ALS, 2025c)
RP	reactive phosphorus
RS	Reference Site
Snowy 2.0	Snowy Scheme expansion project (EPBC 2018/8322)
Snowy Hydro	Snowy Hydro Limited
Snowy Scheme	Snowy Mountains Hydro-electric Scheme
SPC	specific conductance
SSGV	Site Specific Guideline Values
SW	surface water
SWQ	surface water quality
TDS	Total Dissolved Solids
The Methodology	'Pre-construction Water Quality Monitoring Program and Methodology' (NGH, 2022)
The Project	Construction of a 330 kV substation and overhead transmission lines between Nurenmerenmong, NSW and Cabramurra, NSW
TKN	Total Kjeldahl Nitrogen
TN	Total Nitrogen
TP	Total Phosphorus
Transgrid	The Trustee for the NSW Electricity Operations Trust
TSS	Total Suspended Solids
UGL	UGL Limited
WQO	water quality objectives
Zn	Zinc

1 BACKGROUND

In 2020 Snowy Hydro Limited (Snowy Hydro) obtained approval (EPBC 2018/8322) to expand the existing Snowy Mountains Hydro-electric Scheme (Snowy Scheme), by linking the existing Tantangara and Talbingo reservoirs through a series of underground tunnels and constructing a new underground hydro-electric power station (Snowy 2.0).

To connect Snowy 2.0 to the National Energy Market (NEM), a new transmission connection was required. The Trustee for the New South Wales (NSW) Electricity Operations Trust (TransGrid) is constructing a 330 kilovolt (kV) substation and overhead transmission lines (the Project) to facilitate the connection of Snowy 2.0 to the existing electrical transmission network. The Project is located within Kosciuszko National Park (KNP) between Nurenmerenmong and Cabramurra, NSW, approximately 27 kilometres (km) east of Tumbarumba, NSW (Figure 1). UGL Limited (UGL) has been engaged on behalf of Transgrid to undertake the Project.

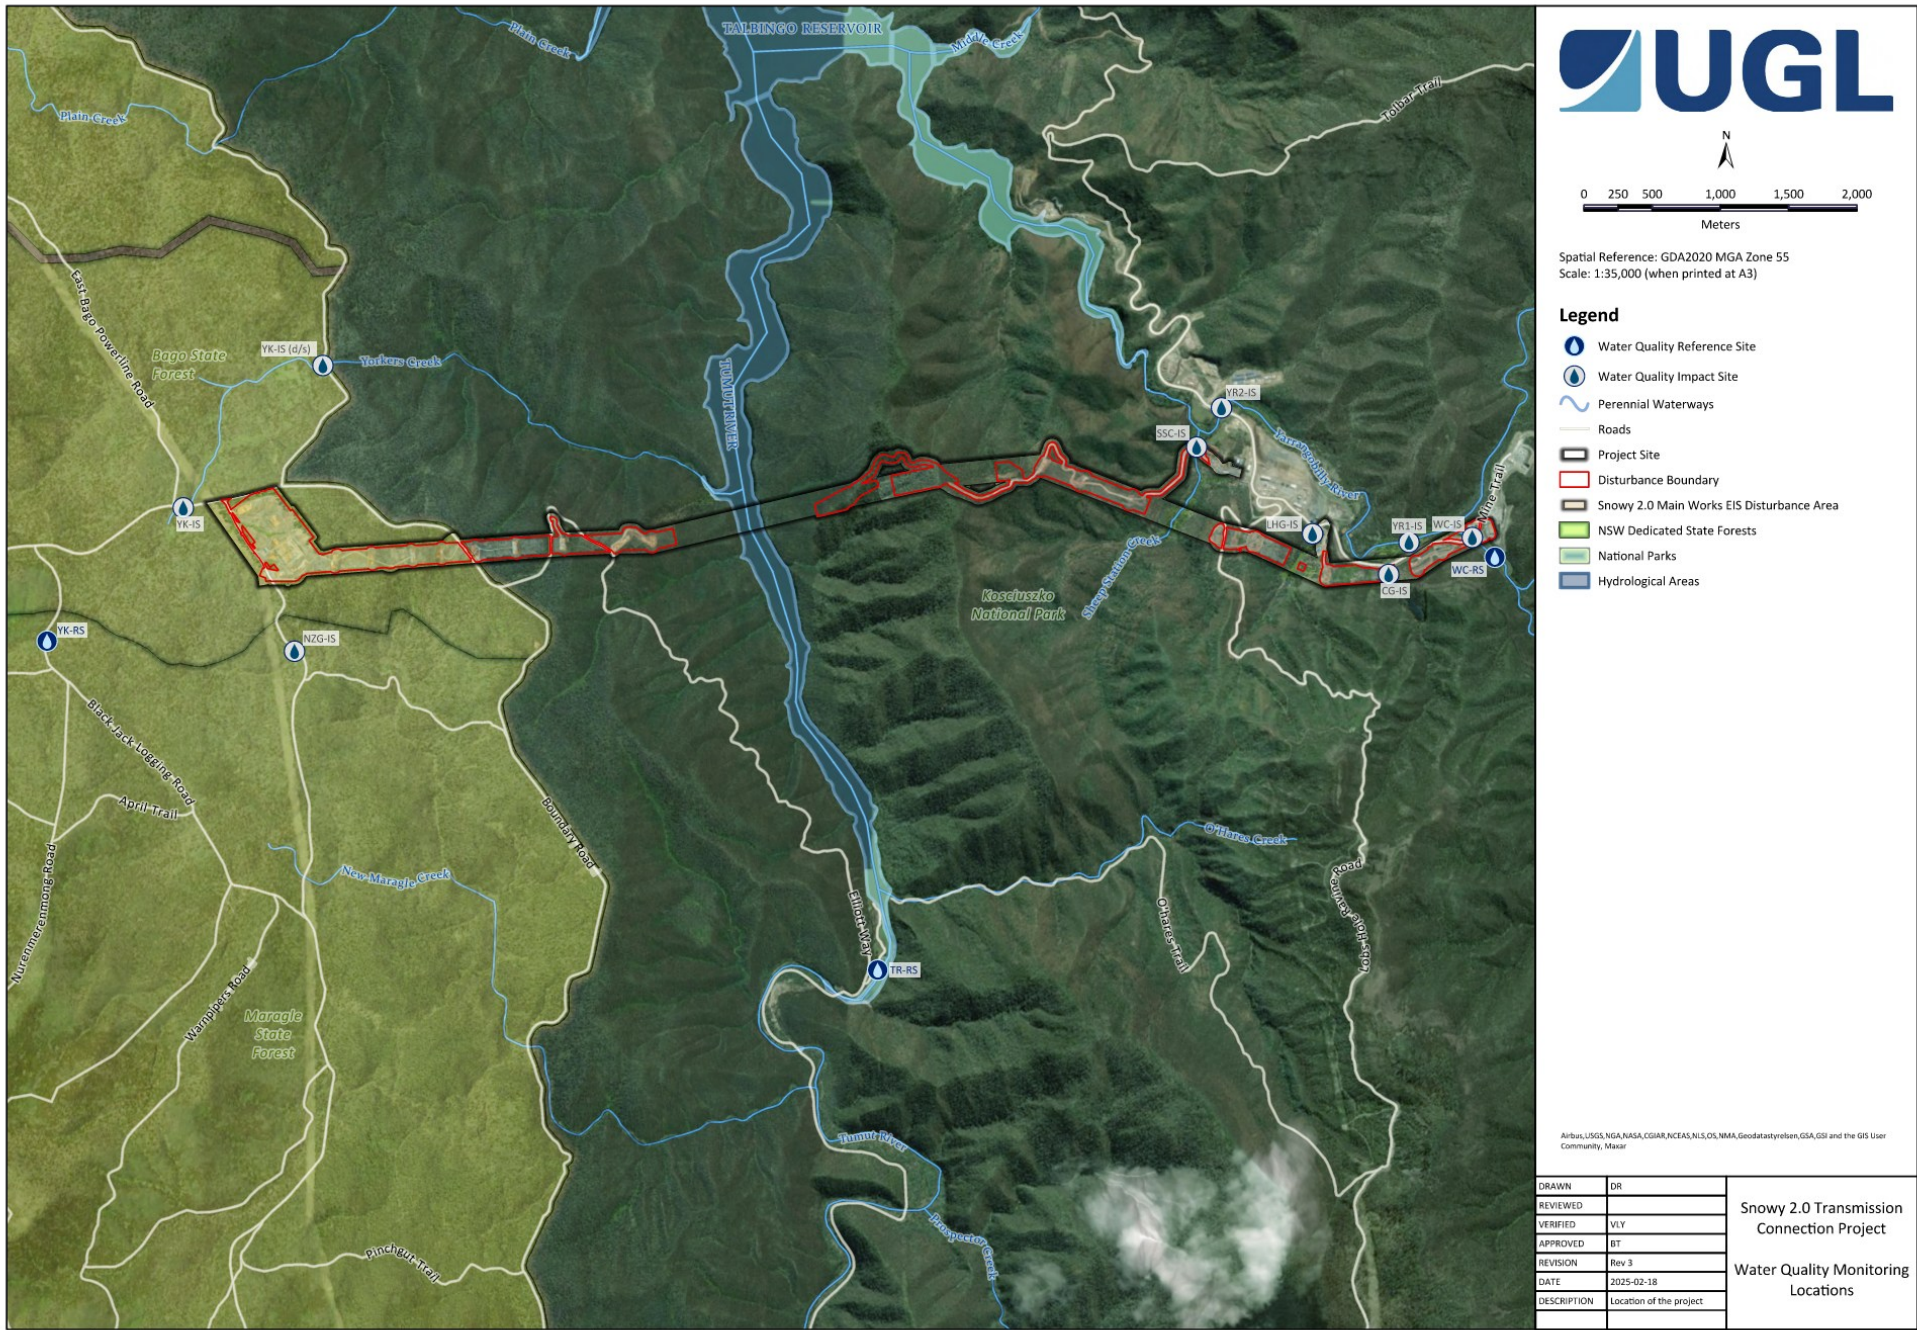


FIGURE 1 LOCALITY OF THE PROJECT AND SWQ MONITORING LOCATIONS

2 INTRODUCTION

The Project is adjacent to, and forms part of, the Snowy 2.0 project area and is located within KNP, an area of high conservation value. A total of 22 mapped waterways, tributaries of Yarrangobilly River and Tumut River, transect the Project Boundary (Figure 1).

One of the conditions of approval to meet the requirements outlined in the 'Environmental Impact Statement' (EIS) (Jacobs, 2020) and the Project's Environmental Protection Licence (EPL 21753) is to undertake regular surface water quality (SWQ) monitoring to mitigate environmental impacts on SWQ.

Pre-construction SWQ monitoring was undertaken by NGH Pty Ltd (NGH) between March 2022 and February 2024 to determine site specific baseline values for SWQ parameters prior to Project construction works. The pre-construction SWQ monitoring was undertaken using the 'Pre-construction Water Quality Monitoring Program and Methodology' (the Methodology) developed by NGH in 2022 (refer Section 3). Two years of pre-construction SWQ monitoring was analysed and summarised in the 'Baseline Water Quality Report' (Baseline Report) (NGH, 2024). The results were used to determine seasonal Site Specific Guideline Values (SSGV) for ongoing SWQ monitoring during the construction phase.

Construction for the Project commenced in March 2024. Construction SWQ monitoring will be undertaken by UGL on a monthly basis as per the revised methodology outlined in Section 3 to identify potential changes to SWQ that may be associated with the Project. SW samples from the construction SWQ monitoring would be analysed and presented in monthly Construction Water Quality Monitoring Reports.

3 METHODOLOGY

The Methodology was prepared by NGH in 2022 to support the pre-construction SWQ monitoring for the Project. The Methodology detailed the water quality objectives (WQO) for the Project, identified the monitoring locations and outlined the methodology for surface water (SW) sampling during the pre-construction phase. The Methodology (NGH, 2022) took into account the Project location within an area of high conservation value where the WQO for physical and chemical stressors, as outlined in the ‘Australian and New Zealand Guidelines for Fresh and Marine Water Quality’ (ANZG) (ANZG, 2018), includes no change in biodiversity beyond natural variability and where possible, there should also be no change in water/sediment chemical and physical properties, including toxicants.


Monitoring locations are outlined in Table 1. Figure 2 and Figure 3 show the water quality monitoring locations in relation to the Project and Snowy 2.0.

The Methodology (NGH, 2022) has been revised for construction SWQ monitoring by taking into account the seasonal SSGV set out in the Baseline Report (NGH, 2024) (refer to Section 4.2).

Construction SWQ monitoring would be analysed against the seasonal SSGV where available and appropriate. The Default Guideline Values (DGV) for Upland Rivers (ANZG, 2018) would be applied to water quality parameters that were not assessed in the Baseline Report (NGH, 2024) or where a guideline range is more appropriate. Table 2 outlines the seasonal SSGV and DGV used to compare construction SWQ to pre-construction SWQ.

Table 1 SWQ monitoring locations outlined in the Methodology (NGH, 2022)

WATER QUALITY MONITORING LOCATIONS					
ID	Waterway	Site Type	Catchment	Latitude	Longitude
WC-RS	Wallace Creek	Reference	Yarrangobilly River	-35.794258	148.415253
WC-IS	Wallace Creek	Impact		-35.792982	148.413404
CG-IS	Cave Gully	Impact		-35.795495	148.406665
YR1-IS	Yarrangobilly River	Impact		-35.793358	148.408277
LHG-IS	Lick Hole Gully	Impact		-35.792890	148.400445
YR2-IS	Yarrangobilly River	Impact		-35.784656	148.392921
SSC-IS	Sheep Station Creek	Impact		-35.793243	148.391046
TR-RS	Talbingo Reservoir	Reference	Talbingo Reservoir	-35.822094	148.365690
YK-RS	Yorkers Creek	Reference	Yorkers Creek	-35.801126	148.297979
YK-IS (D/S)	Yorkers Creek	Impact		-35.782684	148.320040
NZG-IS	New Zealand Gully	Impact		-35.801575	148.318051
YK-IS	Yorkers Creek	Impact		-35.792209	148.308878

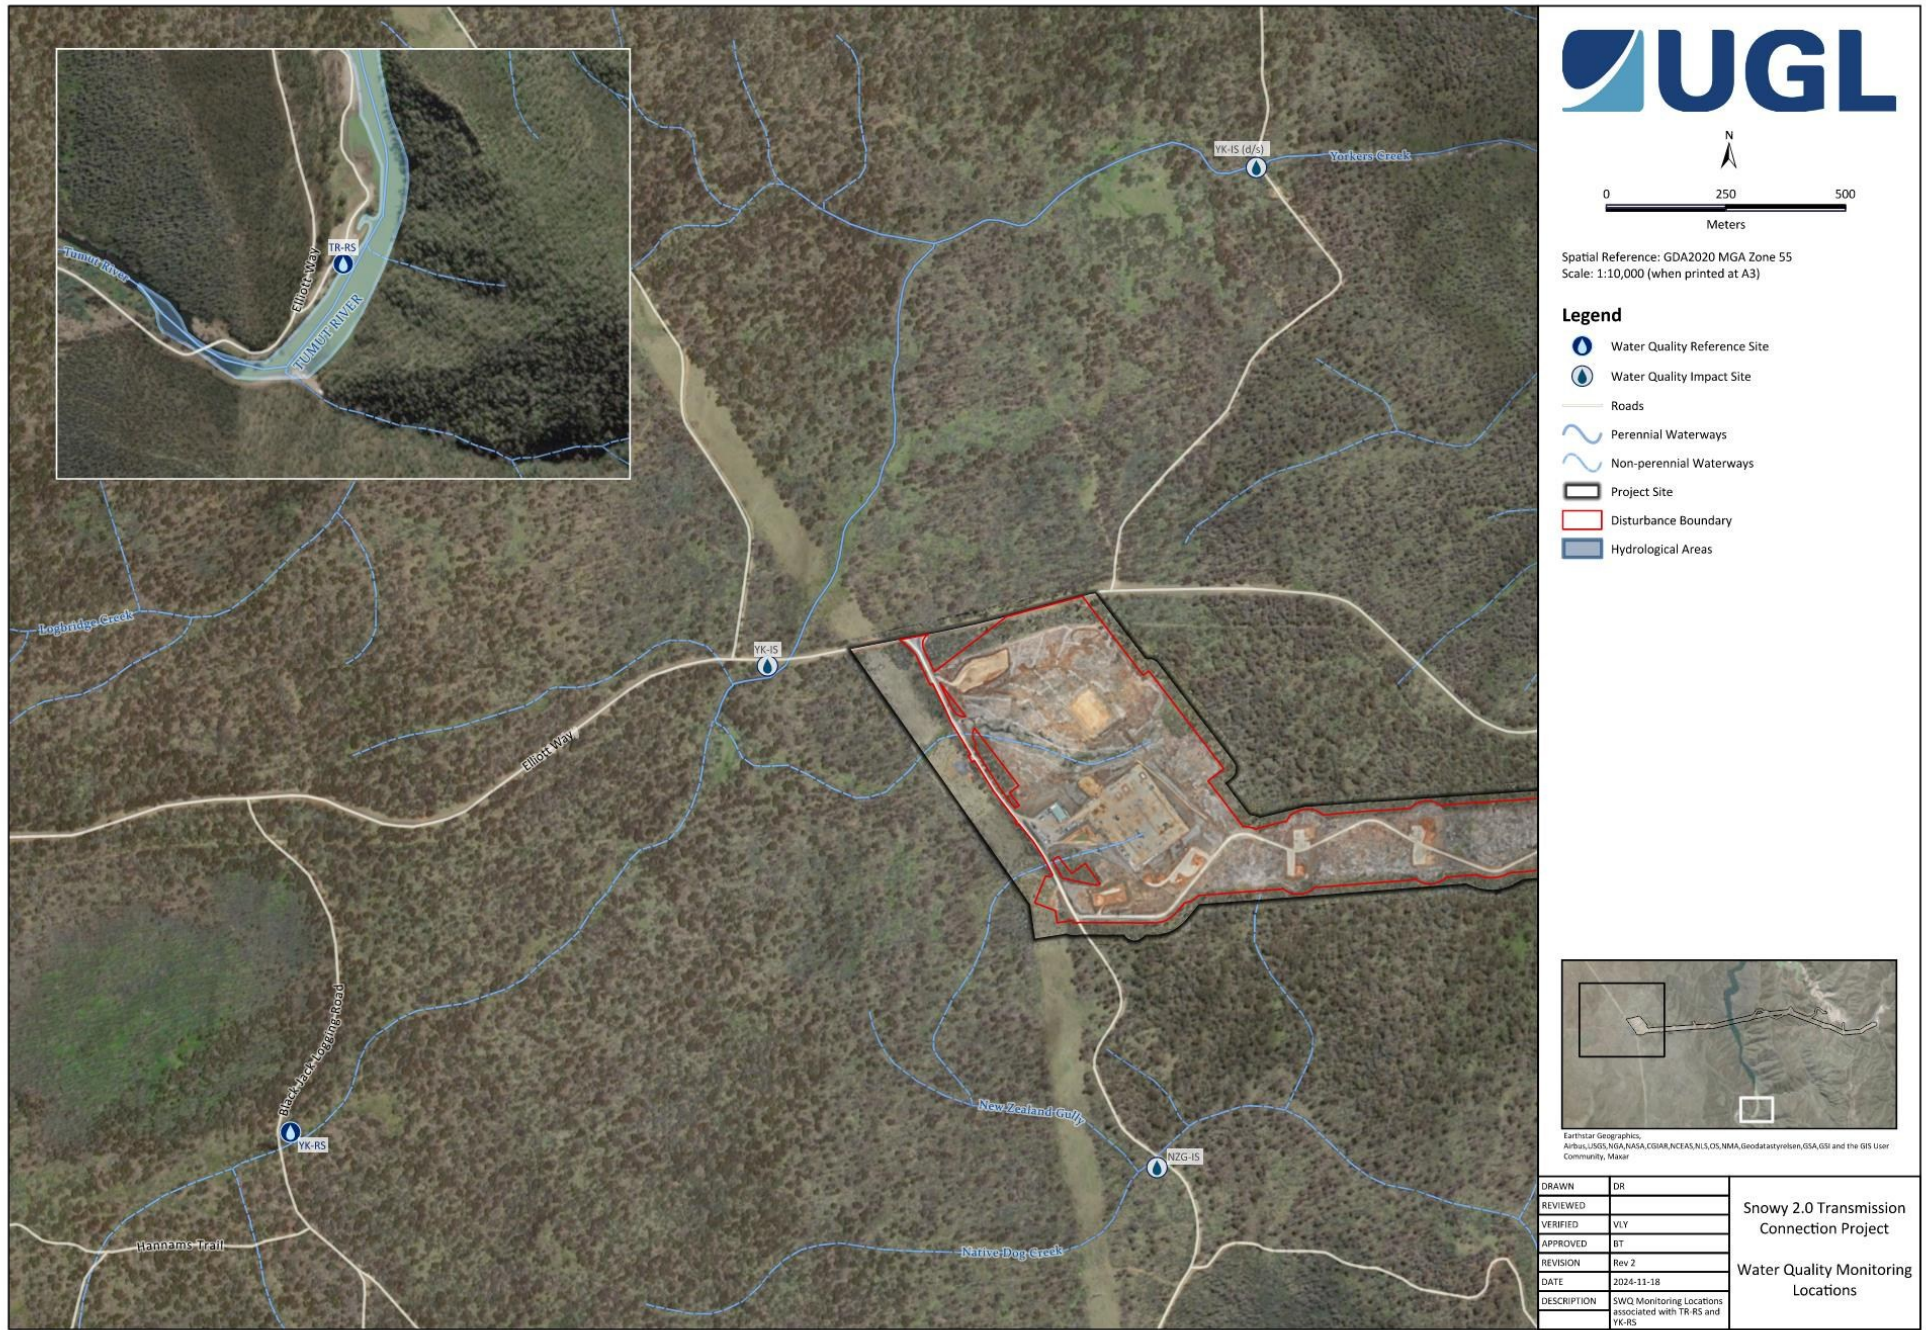

G:\Projects\Manage\20_Maps\Water Quality Monitoring Locations Map\Water Quality Monitoring Locations Map.aprx (A3) (WQM) (West) Date Saved: 2024-11-18 User Name: donovan.rynne

FIGURE 2 WATER QUALITY MONITORING LOCATIONS ASSOCIATED WITH REFERENCE SITE YR-RS AND TR-RS IN RELATION TO THE PROJECT

Table 2 Seasonal SSGV (NGH, 2024) and DGV (ANZG, 2018) for water quality parameters

SURFACE WATER QUALITY GUIDELINE VALUES								
Parameter	Unit	WC-RS		TR-RS		YK-RS		DGV
		SSGV (Summer/Autumn)	SSGV (Winter/Spring)	SSGV (Summer/Autumn)	SSGV (Winter/Spring)	SSGV (Summer/Autumn)	SSGV (Winter/Spring)	
Temperature	°C*	-	-	-	-	-	-	-
Dissolved Oxygen (DO) ***	%#	96.2	89.7	91.3	95.5	89.6	88.7	90-110
DO	ppm ⁺	9.08	10.28	8.79	11.53	8.35	10.2	-
Specific Electrical Conductivity (EC)***	SPC [^] μS/cm ^{^^}	115	88	24	38.7	31	27.9	30-350
EC***	μS/cm	93.2	60.85	20.3	26.2	24	20.5	30-350
pH***	-	7.85	7.62	7.59	7.59	6.79	6.61	6.5-8
Redox	mV ^{##}	79.1	98.4	91.2	95.4	94.6	106.1	-
Turbidity***	NTU ^{**}	0.37	5.12	0.09	1.56	9	7.87	2-25
Dissolved Aluminium (Al)	mg/L ⁺⁺	0.03	0.04	0.03	0.015	0.36	0.32	0.027
Dissolved Arsenic (As)	mg/L	0.003	0.0003	0.003	0.0003	0.003	0.0003	0.0008
Dissolved Cadmium (Cd)	mg/L	0.00002	0.00002	0.00002	0.00002	0.00002	0.00002	0.0006
Dissolved Chromium (Cr)	mg/L	0.00001	0.00001	0.00001	0.00001	0.00001	0.00001	0.00001
Dissolved Copper (Cu)	mg/L	0.0002	0.0002	0.0002	0.0002	0.0002	0.0002	0.001
Cyanide	mg/L	0.002	0.002	0.002	0.002	0.002	0.002	0.004
Dissolved Iron (Fe)	mg/L	0.03	0.02	0.04	0.02	0.41	0.23	0.3
Dissolved Lead (Pb)	mg/L	0.001	0.001	0.001	0.001	0.001	0.001	0.001
Dissolved Manganese (Mn)	mg/L	0.002	0.002	0.003	0.002	0.005	0.003	1.2
Dissolved Mercury (Hg)	mg/L	0.00003	0.00003	0.00003	0.00003	0.00003	0.00003	0.00006

SURFACE WATER QUALITY GUIDELINE VALUES

Parameter	Unit	WC-RS		TR-RS		YK-RS		DGV
		SSGV (Summer/Autumn)	SSGV (Winter/Spring)	SSGV (Summer/Autumn)	SSGV (Winter/Spring)	SSGV (Summer/Autumn)	SSGV (Winter/Spring)	
Dissolved Nickel (Ni)	mg/L	0.001	0.001	0.001	0.001	0.001	0.001	0.008
Total Nitrogen (TN)	mg/L	0.2	0.2	0.2	0.2	0.2	0.2	0.25
Total Phosphorus (TP)	mg/L	0.02	0.02	0.02	0.02	0.02	0.02	0.02
Dissolved Silver (Ag)	mg/L	0.00002	0.00002	0.00002	0.00002	0.00002	0.00002	0.00002
Dissolved Zinc (Zn)	mg/L	0.002	0.002	0.002	0.002	0.002	0.002	0.0024
Ammonia	mg/L	0.013	0.013	0.013	0.013	0.013	0.013	0.013
Nitrogen Oxides	mg/L	0.015	0.015	0.015	0.015	0.015	0.015	0.015
Reactive Phosphorus (RP)	mg/L	0.02	0.015	0.02	0.015	0.02	0.02	0.015
Total Hardness (CaCO ₃)	mg/L	47	30	7.5	8	1	7	-
Total Kjeldahl Nitrogen (TKN)	mg/L	0.2	0.2	0.1	0.2	0.1	0.2	-
Total Dissolved Solids (TDS)	mg/L	52	39	12.5	15	30	10	-
Total Suspended Solids (TSS)	mg/L	0.2	1	0.2	0.2	3	0.2	0.2
Total Al [@]	mg/L	-	-	-	-	-	-	0.027
Total As [@]	mg/L	-	-	-	-	-	-	0.0008
Total Cd [@]	mg/L	-	-	-	-	-	-	0.0006
Total Cr [@]	mg/L	-	-	-	-	-	-	0.00001
Total Cu [@]	mg/L	-	-	-	-	-	-	0.001
Total Pb [@]	mg/L	-	-	-	-	-	-	0.001
Total Mn [@]	mg/L	-	-	-	-	-	-	1.2
Total Ni [@]	mg/L	-	-	-	-	-	-	0.008

SURFACE WATER QUALITY GUIDELINE VALUES

Parameter	Unit	WC-RS		TR-RS		YK-RS		DGV
		SSGV (Summer/Autumn)	SSGV (Winter/Spring)	SSGV (Summer/Autumn)	SSGV (Winter/Spring)	SSGV (Summer/Autumn)	SSGV (Winter/Spring)	
Total Ag [@]	mg/L	-	-	-	-	-	-	0.00002
Total Zn [@]	mg/L	-	-	-	-	-	-	0.0024
Total Fe [@]	mg/L	-	-	-	-	-	-	0.3
Total Hg [@]	mg/L	-	-	-	-	-	-	0.00006

* °C = degrees Celsius

% = percent

mV = millivolt

+ ppm = parts per million

^ SPC = specific conductance

** mg/L = milligram per litre

** NTU = Nephelometric Turbidity Unit

^^ μS/cm = micro Siemens per centimetre

@ parameter not analysed by NGH

*** assessed against DGV where guideline range is more appropriate for the parameter

4 BASELINE WATER QUALITY

4.1 Water Quality Objectives

Water quality objectives are outlined in Section 2.1 of the Baseline Report (NGH, 2024).

4.2 Site Specific Guideline Values

In accordance with the ANZG (ANZG, 2018), SSGV for the three Reference Sites (RS) (WC-RS, TR-RS and YK-RS) were derived from the results collected during the 24-month pre-construction SWQ monitoring period. The SSGV reflect the seasonality observed in the baseline data and are characterised by the drier months of Summer/Autumn (December to May) and wetter months of Winter/Spring (June to November) in accordance with the 'Australian and New Zealand Environment and Conservation Council (ANZECC) and Agriculture and Resource Management Council of Australia and New Zealand (ARMCANZ) (2000) methodology and derivatives developed to 2018 of the ANZG (ANZG, 2018).

Table 2 outlines the seasonal SSGV provided in the Baseline Report (NGH, 2024).

5 FEBRUARY 2026 MONITORING

SW sampling was undertaken at 6 monitoring locations on 7 February 2026. SSC-IS, CG-IS, LHG-IS, YK-RS, YK-IS (D/S), YK-IS were dry or had no flow at the time of monitoring.


In accordance with the methodology outlined in Section 3, SW samples were either measured in situ using a calibrated YSI ProDSS Sonde Multiparameter Digital Water Quality Meter (refer to Appendix D) or analysed by National Association of Testing Authorities, Australia (NATA) accredited ALS Limited (ALS) laboratory.

The 'Water Quality Monitoring Field Data Sheet' (Field Sheet) (UGL, 2025) is provided in Appendix A. The 'Certificate of Analysis' (COA) (ALS, 2025a), 'QA/QC Compliance Assessment to assist with Quality Review' (QA/QC Assessment) (ALS, 2025b) and 'Quality Control Report' (QCR) (ALS, 2025c) are attached in Appendix B.

5.1 Observations

Field observations during sampling are summarised in Table 3.

Table 3 Field observations during sampling

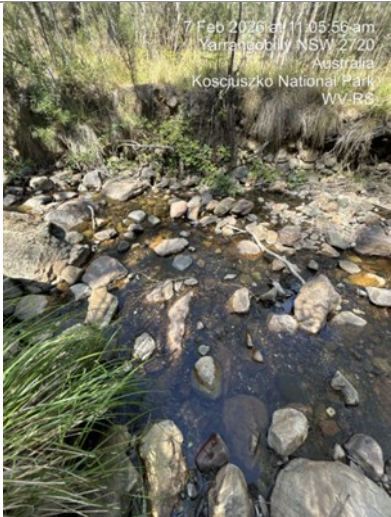FIELD OBSERVATIONS		
Date	7 February 2026	
Weather	The weather forecast for 7 February was 26 degrees Celsius (°C) with 5 percent of <1 millimetres (mm) of rain. The previous 48 hours was cloudy and experienced a total of 0.0mm of rainfall across 06 to 05 February. At the time of sampling, the weather was fine and sunny.	
ID	Observations	Photo
WC-RS	<ul style="list-style-type: none"> • Low volume and flow • Rocky and eroded banks including exposed roots from a large tree • Presence of aquatic vegetation • Presence of oily sheen from organic decomposition • No discolouration to water • Riparian vegetation consisted of groundcover, shrubs and trees <p>Moderate weed density including of Blackberry (<i>Rubus fruticosus</i>)</p>	



FIELD OBSERVATIONS

ID	Observations	Photo
WC-IS	<ul style="list-style-type: none"> • Very low volume and flow • Presence of vegetative detritus • Presence of aquatic vegetation • No discolouration to water • Riparian vegetation predominantly trees and grass • High weed density including Blackberry (<i>Rubus fruticosus</i>) • Rocky banks and undercut banks • Monitoring location is adjacent to bridge and Mine Trail Road which is frequently used by Snowy 2.0 vehicles, plant and machinery 	
CG-IS	<ul style="list-style-type: none"> • Dry, no flow at the time of sampling 	



FIELD OBSERVATIONS

ID	Observations	Photo
YR1-IS	<ul style="list-style-type: none"> • No discolouration to water • Very low volume and flow • Moderate weed density including Thistle and Blackberry (<i>Rubus fruticosus</i>) • Riparian vegetation consisted of groundcover, shrubs and trees • Rocky banks with sections of exposed soil higher up the bank • Presence of aquatic vegetation • Monitoring location is adjacent to bridge and electrical transmission tower on top of rocky cliff and Snowy 2.0 laydown area 	
LHG-IS	<ul style="list-style-type: none"> • No flow, dry at the time of sampling 	

FIELD OBSERVATIONS

ID	Observations	Photo
YR2-IS	<ul style="list-style-type: none"> • Presence of aquatic vegetation • Rocky bed and banks • Moderate volume and flow • Riparian vegetation predominantly groundcover • Moderate weed density including Blackberry (<i>Rubus fruticosus</i>) • Presence of vegetative detritus • Presence of road washout from mine trail road in vegetation adjacent to river 	
SSC-IS	<ul style="list-style-type: none"> • Dry; no flow at the time of sampling. 	

FIELD OBSERVATIONS

ID	Observations	Photo
TR-RS	<ul style="list-style-type: none"> Rocky banks and sandy bed Monitoring location is adjacent to publicly accessible O'Hares Campground and Talbingo Reservoir ancillary infrastructure Presence of aquatic invertebrates and vegetation Very low volume and flow Presence of vegetative detritus Riparian vegetation consisted of groundcover and trees Presence of landslips Presence of recreational activities in water and active campers Presence of bubbles on waters surface 	
YK-RS	<ul style="list-style-type: none"> Dry, no flow at the time of sampling 	

FIELD OBSERVATIONS

ID	Observations	Photo
YK-IS (D/S)	<ul style="list-style-type: none"> • Dry, no flow at the time of sampling 	
NZG-IS	<ul style="list-style-type: none"> • Presence of aquatic vegetation including algae • Presence of organic detritus • Suspended sediment throughout water • Overhanging vegetation • Slight yellow tinge to water • High weed density including Blackberry (<i>Rubus fruticosus</i>) • Monitoring location is adjacent to publicly accessible 4WD track • Very low volume and flow • Eroded and undermined banks and pebbly bed • Riparian vegetation consisted of groundcover and trees 	

FIELD OBSERVATIONS

ID	Observations	Photo
YK-IS	<ul style="list-style-type: none"> • Dry, no flow at the time of sampling 	

5.2 Results

The results from the construction SWQ monitoring program have been reported for each respective catchment: Yarrangobilly River, Talbingo Reservoir, and Yorkers Creek.

- **Yarrangobilly River catchment** monitoring includes the reference site at Wallace Creek and impact sites at Yarrangobilly River, Wallace Creek, Cave Gully, Lick Hole Gully, and Sheep Station Creek.
- **Yorkers Creek catchment** monitoring includes the reference site at Yorkers Creek and impact sites at Yorkers Creek and New Zealand Gully.
- **Talbingo Reservoir** features a reference site located upstream within the reservoir, serving as an overall reference for monitoring sites in the Yarrangobilly River and Yorkers Creek catchments.

This reference site provides a baseline for the SWQ monitoring program.

The SWQ monitoring results for key physical and chemical parameters, along with site-specific trigger values, are detailed in Section 5.2.1. Results for dissolved and total metals, including site-specific trigger values, are covered in Sections 5.2.2 and 5.2.3. Upon review of the data, observations were noted between the reference and impact sites.

The complete table of results is attached in Appendix C.

5.2.1 Key Physical and Chemical Parameters

See below for results of key physical and chemical parameters.

5.2.1.1 Temperature

During February 2026, all three sampling locations (Yarrangobilly River Catchment, Talbingo Reservoir and Yorkers Creek Catchment) exhibited a decrease in temperature (°C), refer Figure 4—Figure 6. In Yarrangobilly River Catchment, mean temperatures decreased to ≈22°C, with a notable decrease at the reference site (WC-RS) to ≈19°C (Figure 4). Talbingo Reservoir temperature decreased to ≈18°C (Figure 5). Temperatures at Yorkers Creek Catchment decreased to ≈13°C (Figure 6).

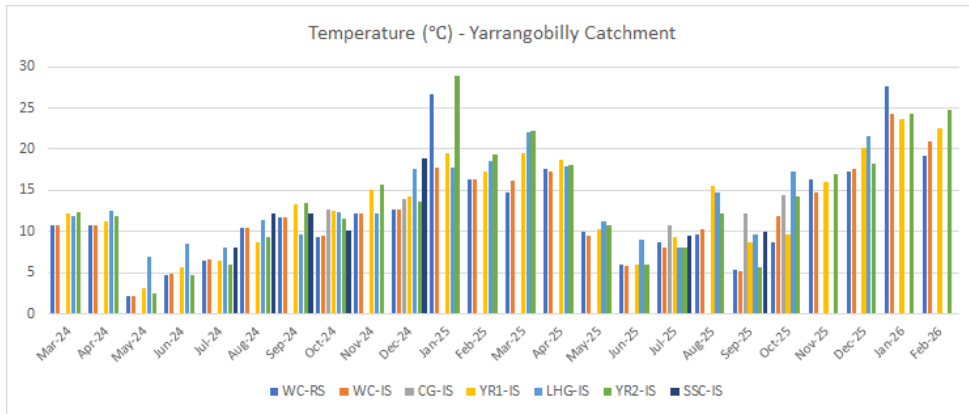


FIGURE 4 : TEMPERATURE FOR YARRANGOBILLY RIVER CATCHMENT

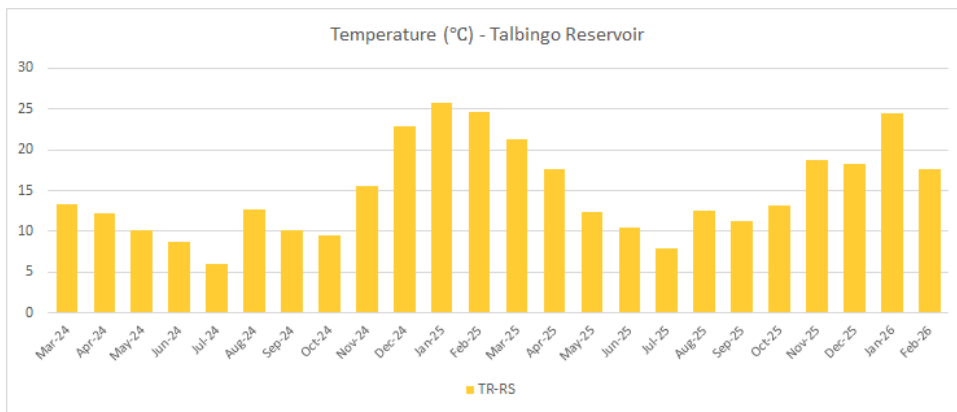


FIGURE 5: TEMPERATURE FOR TALBINGO RESERVOIR

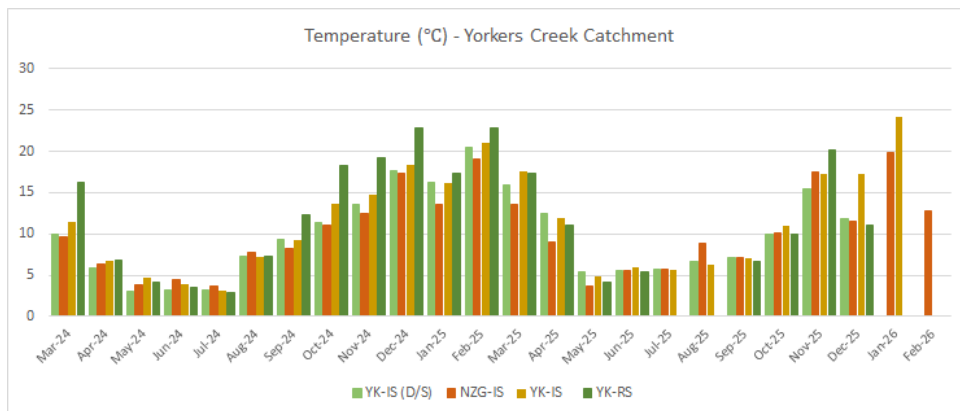


FIGURE 6: TEMPERATURE FOR YORKERS CREEK CATCHMENT

5.2.1.2 pH

During the February 2026 sampling period, all sites across all three catchments recorded pH values more than the respective December-May SSGV, except TR-RS at Talbingo Reservoir, which was below the SSGV. (Figure 7 – Figure 9).

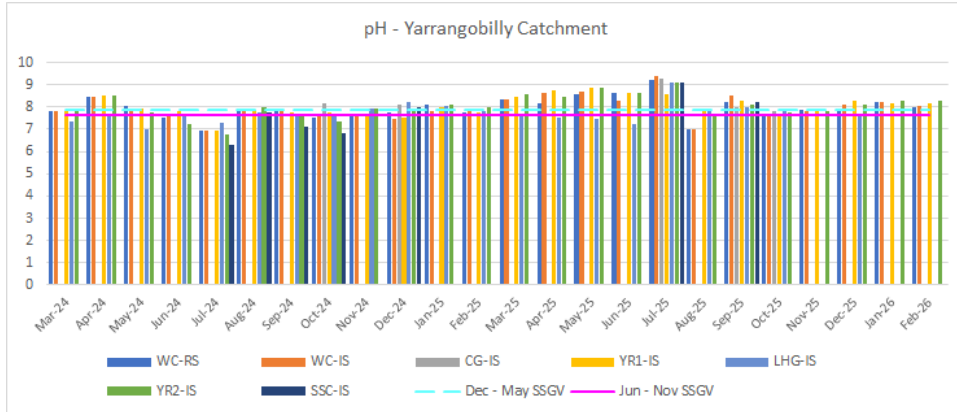


FIGURE 7: PH FOR YARRANGOBILLY RIVER CATCHMENT

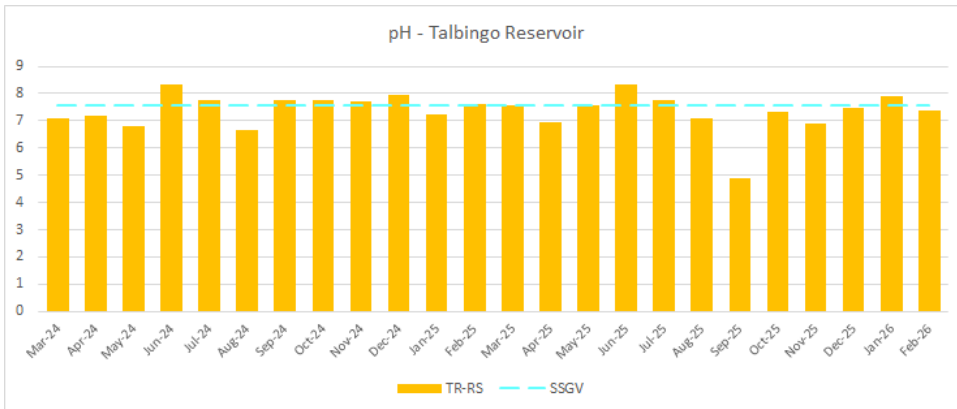


FIGURE 8: PH FOR TALBINGO RESERVOIR

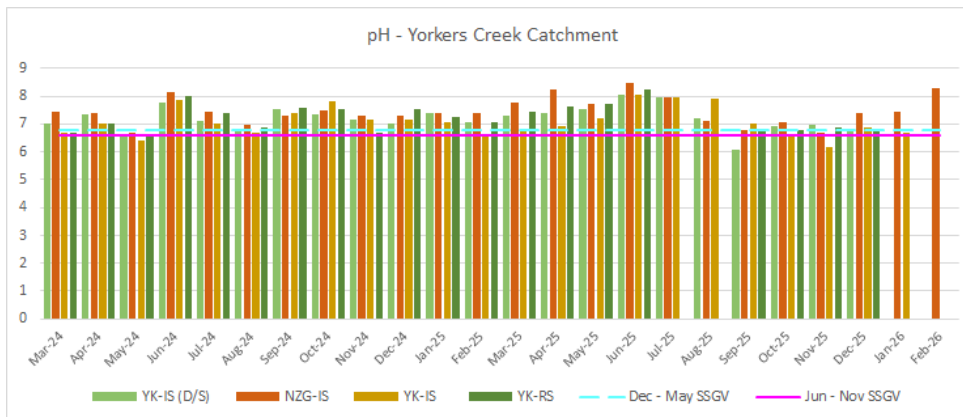


FIGURE 9: PH FOR YORKERS CREEK CATCHMENT

5.2.1.3 Dissolved Oxygen

During the February 2026 sampling period, Dissolved Oxygen (DO, %) improved across all sites within Yarrangobilly River Catchment (Figure 10). In contrast, at Talbingo Reservoir and Yorkers Creek Catchment, DO values reduced compared to January values (Figure 11-Figure 12). All sampled locations recorded values below the December-May SSGV.

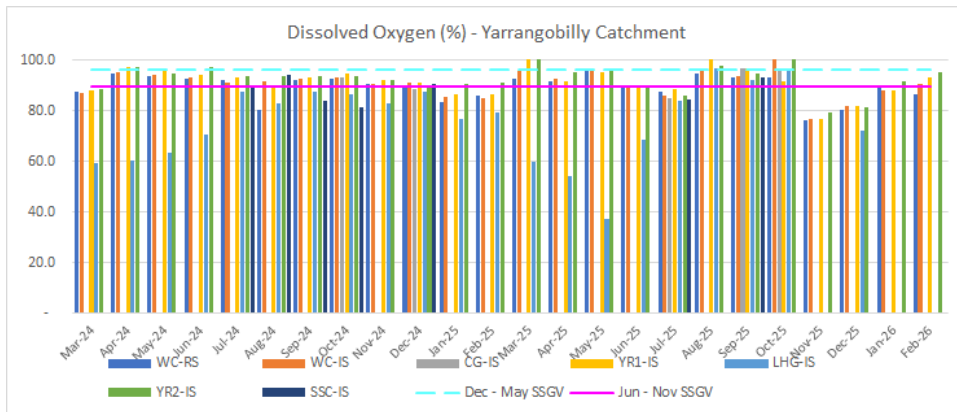


FIGURE 10: DO FOR YARRANGOBILLY RIVER CATCHMENT

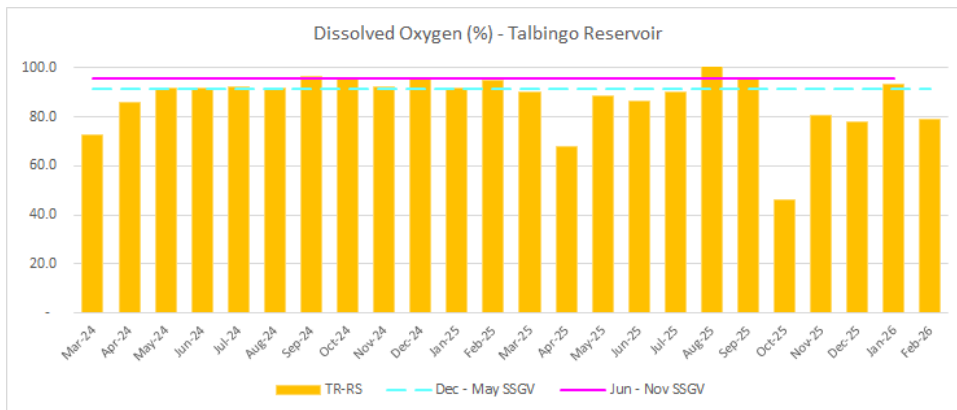


FIGURE 11: DO FOR TALBINGO RESERVOIR

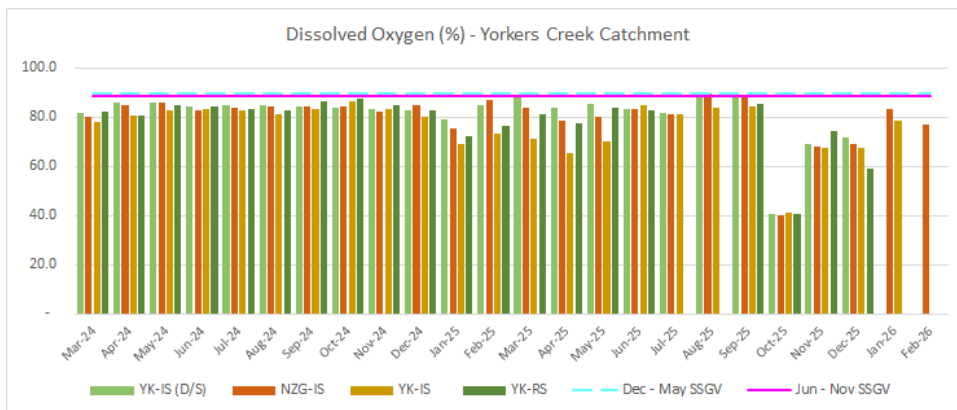


FIGURE 12: DO FOR YORKERS CREEK CATCHMENT

5.2.1.4 Specific Conductance

February 2026 specific conductance ($\mu\text{S}/\text{cm}$) values generally increased across the three catchments (Figure 13-Figure 15). All sites exceeded the December-May SSGV.

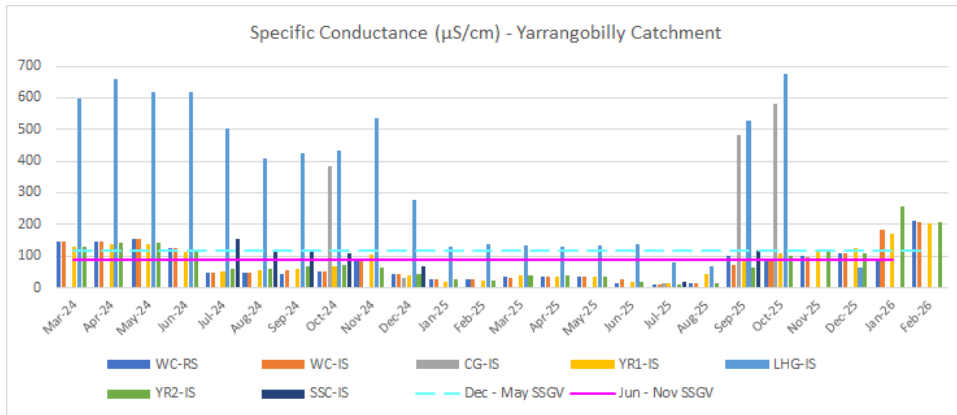


FIGURE 13: SPC FOR YARRANGOBILLY RIVER CATCHMENT

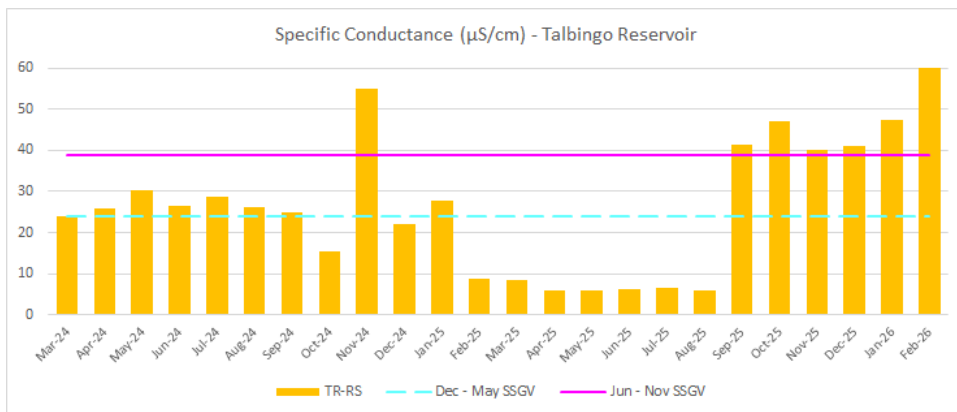


FIGURE 14: SPC FOR TALBINGO RESERVOIR

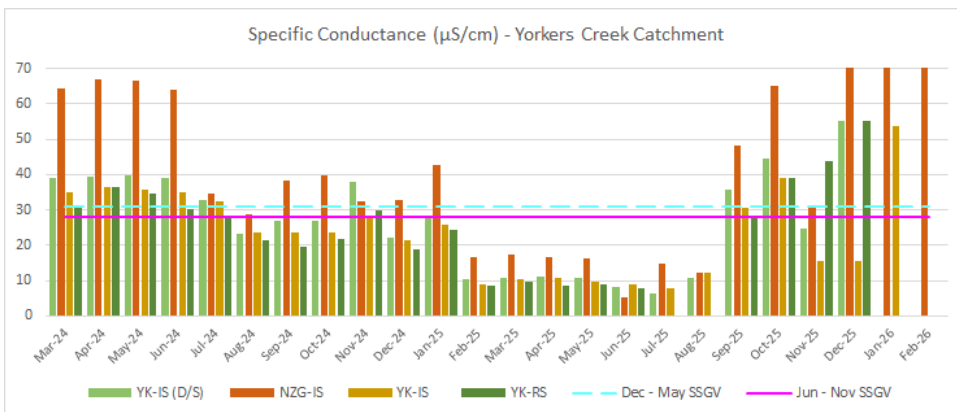


FIGURE 15: SPC FOR YORKERS CREEK CATCHMENT

5.2.1.5 Electrical Conductivity

In February 2026, Electrical Conductivity (EC, $\mu\text{S}/\text{cm}$) exhibited a general increase across all three catchments (Yarrangobilly River Catchment, Talbingo Reservoir, Yorkers Creek Catchment) compared with January 2026 (Figure 16-Figure 18). All sites exceeded the December-May SSGV.

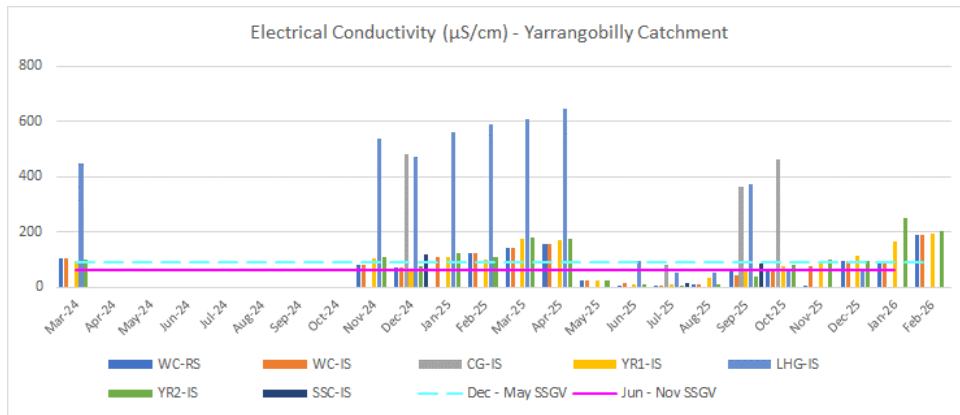


FIGURE 16: EC FOR YARRANGOBILLY RIVER CATCHMENT

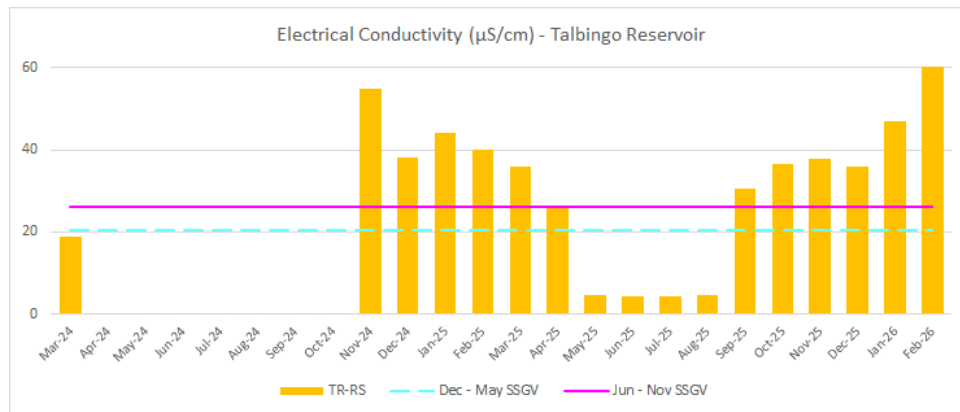


FIGURE 17: EC FOR TALBINGO RESERVOIR

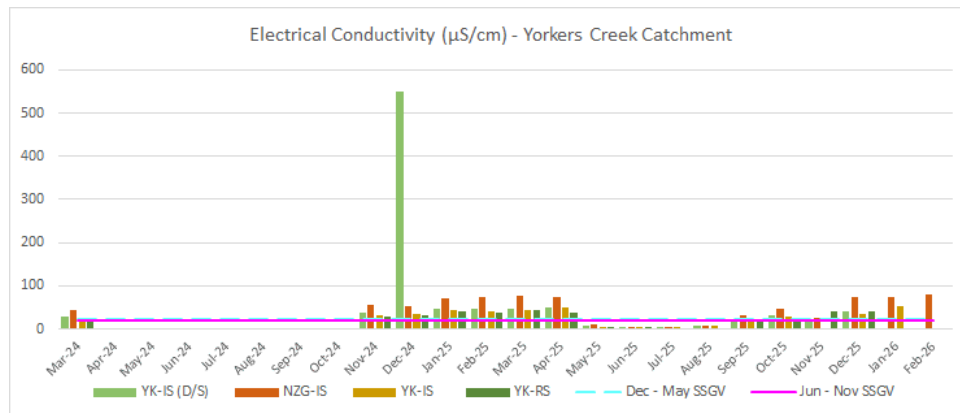


FIGURE 18: EC FOR YORKERS CREEK CATCHMENT

5.2.1.6 Turbidity

In February 2026, results for turbidity generally increased at sites within Yarrangobilly River Catchment and Talbingo Reservoir, where values exceeded the December-May SSGV (Figure 19—Figure 20). In contrast, in Yorkers Creek Catchment, NTU values at NZG-IS exhibited a reduction compared with January 2026 values and were within the December-May SSGV (Figure 21).

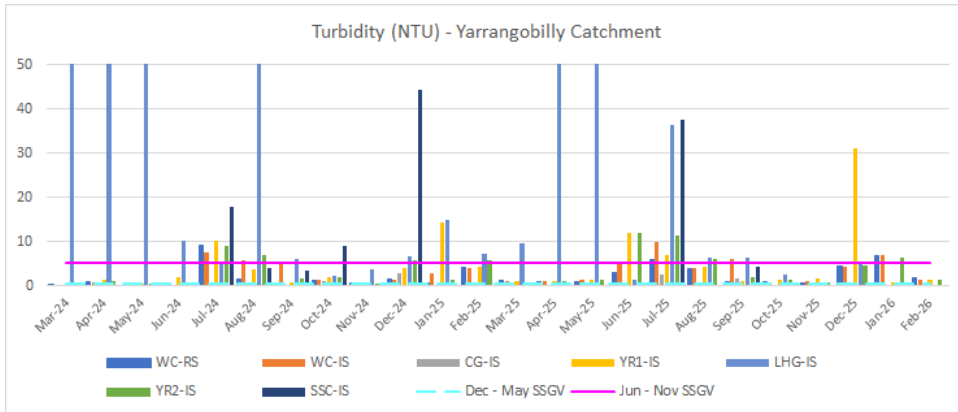


FIGURE 19: TURBIDITY FOR YARRANGOBILLY RIVER CATCHMENT

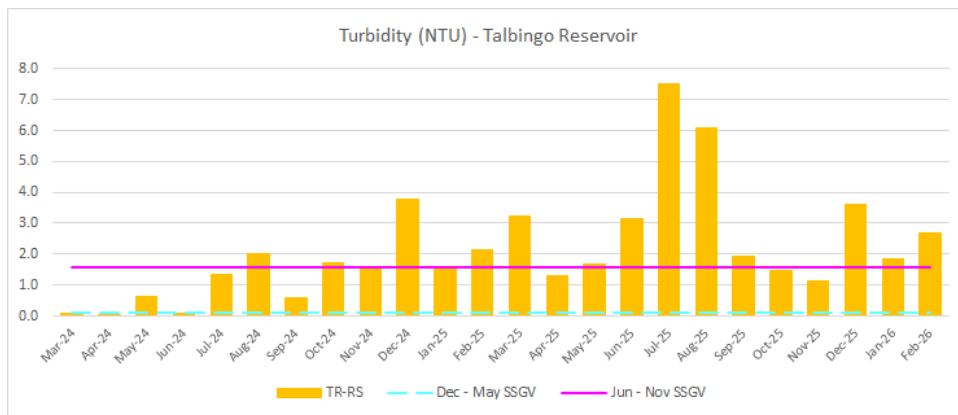


FIGURE 20: TURBIDITY FOR TALBINGO RESERVOIR

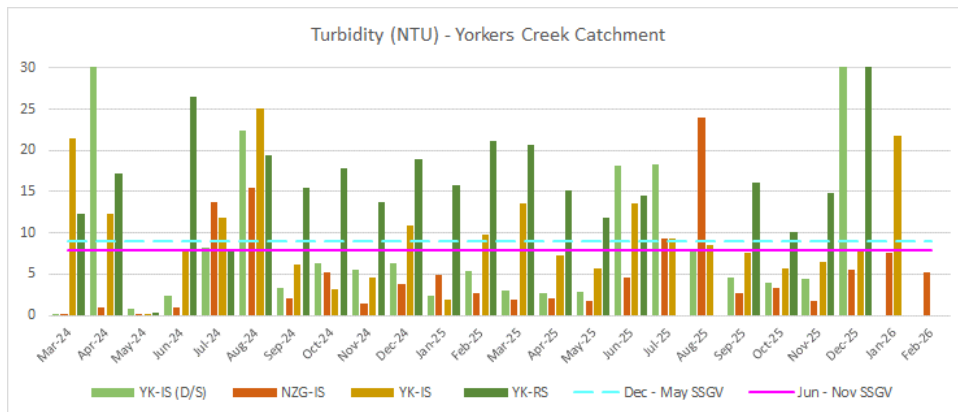


FIGURE 21: TURBIDITY FOR YORKERS CREEK CATCHMENT

5.2.1.7 Total Suspended Solids

Total Suspended Solids (TSS, mg/L) values were below the LOR at all sites in the February 2026 sampling period (Figure 22- Figure 24).

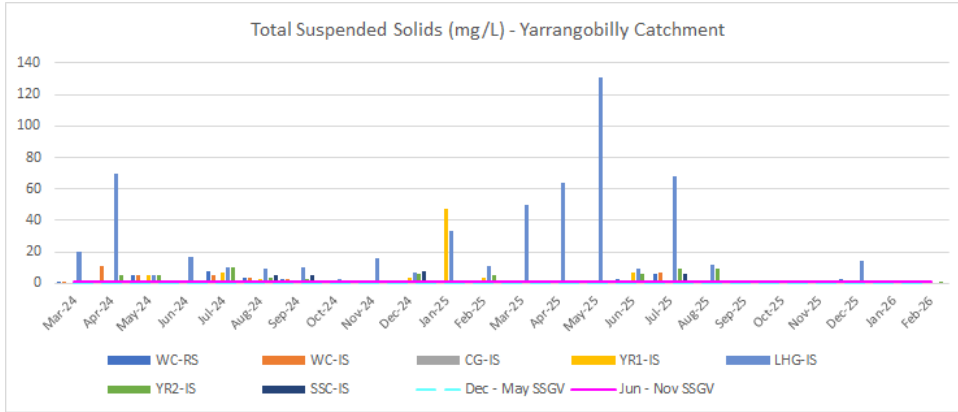


FIGURE 22: TSS FOR YARRANGOBILLY RIVER CATCHMENT

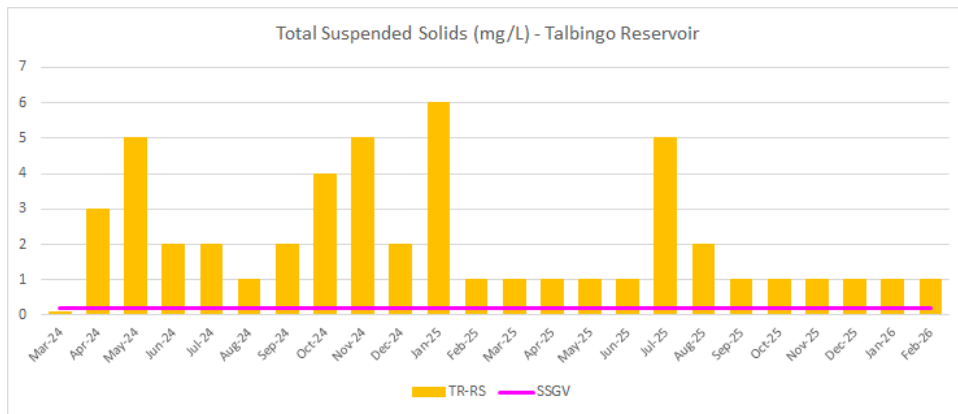


FIGURE 23: TSS FOR TALBINGO RESERVOIR

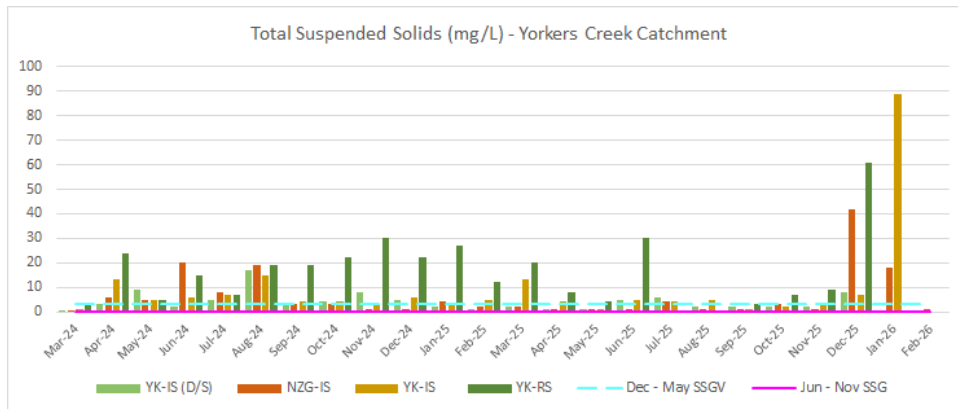


FIGURE 24: TSS FOR YORKERS CREEK CATCHMENT

5.2.1.8 Total Dissolved Solids

Total Dissolved Solids (mg/L) values during the February 2026 sampling period exceeded the December-May SSGV at all sites (Figure 25-Figure 27).

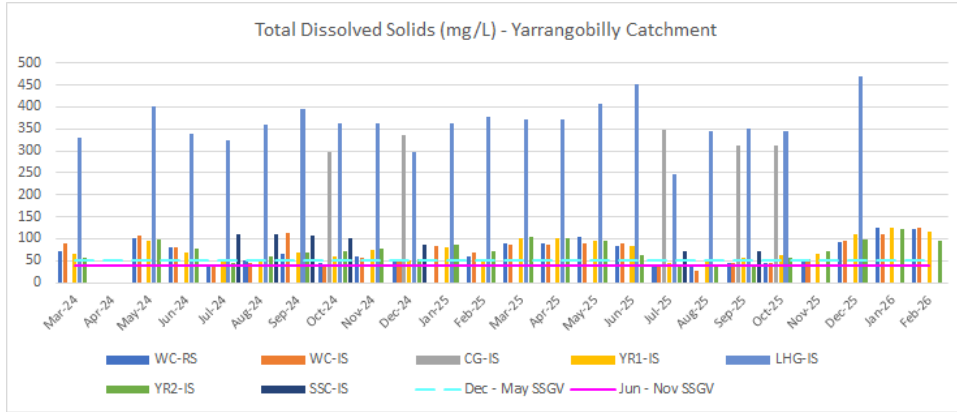


FIGURE 25: TDS FOR YARRANGOBILLY RIVER CATCHMENT

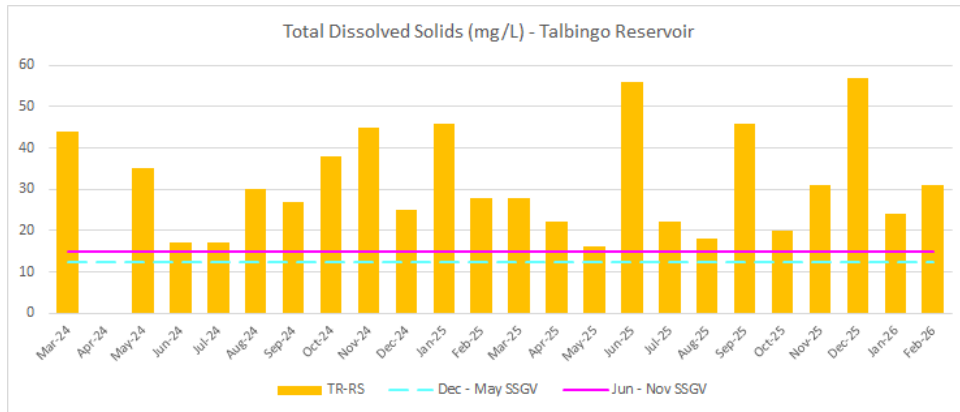


FIGURE 26: TDS FOR TALBINGO RESERVOIR

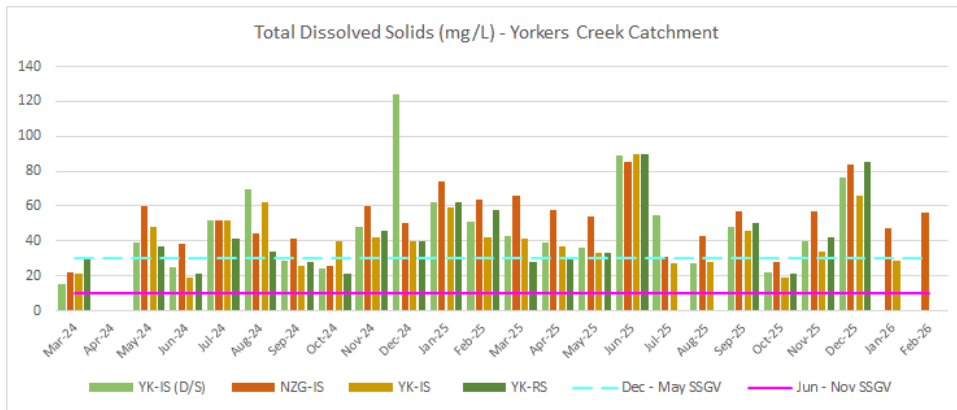


FIGURE 27: TDS FOR YORKERS CREEK CATCHMENT

5.2.1.9 Redox

Redox (mV) results for the February 2026 sampling period were higher compared with January 2026 at all sites within Yarrangobilly River Catchment (Figure 28). In contrast, Redox (mV) values recorded at Talbingo Reservoir (TR-RS) and Yorkers Creek Catchment (NZG-IS) exhibited a reduction in February 2026 (Figure 29-Figure 30). All sites across all catchments exceeded the December-May SSGV.

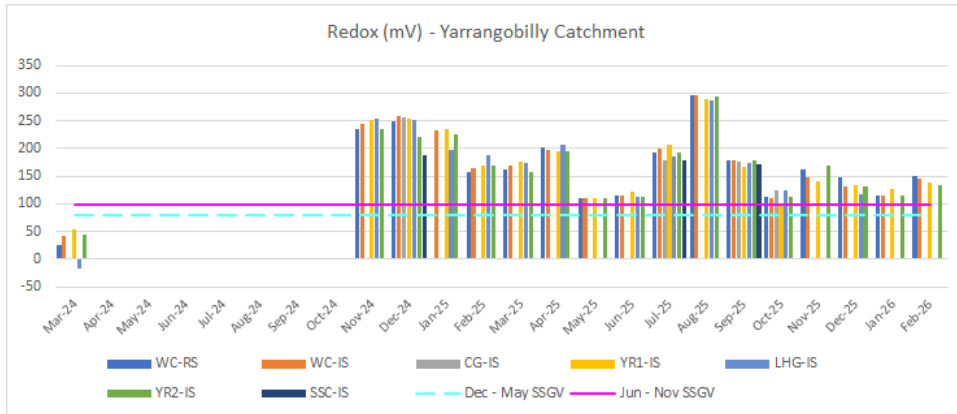


FIGURE 28: REDOX FOR YARRANGOBILLY RIVER CATCHMENT

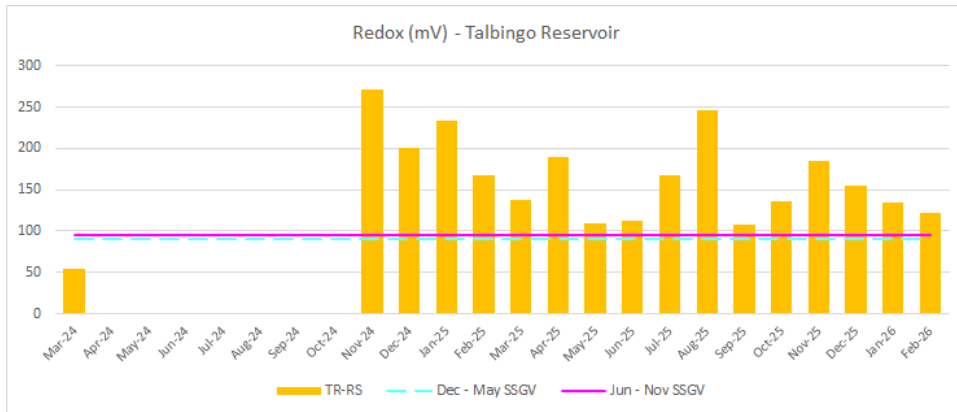


FIGURE 29: REDOX FOR TALBINGO RESERVOIR

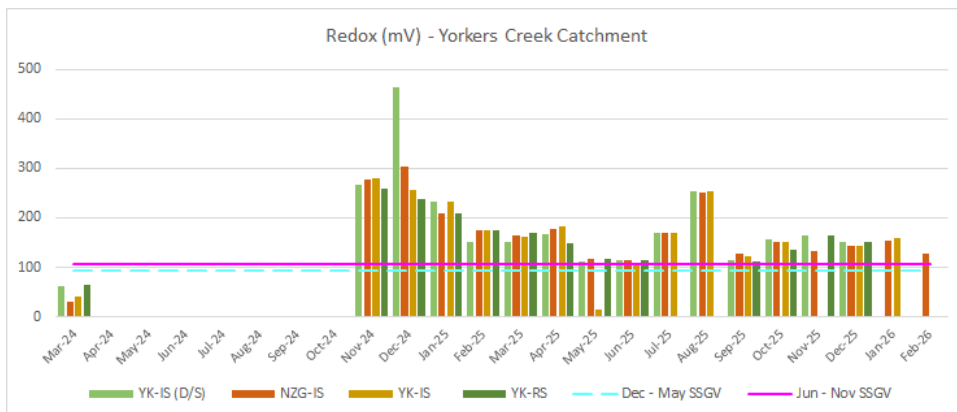


FIGURE 30: REDOX FOR YORKERS CREEK CATCHMENT

5.2.1.10 Nitrogen Oxides

Nitrogen Oxides (mg/L) levels were below the LOR at all sites during the February 2026 sampling period, except the reference site at Talbingo Reservoir (TR-RS) and one impact site (NZG-IS) in Yorkers Creek Catchment. Both sites exceeded the December-May SSGV, refer Figure 31 — 33.

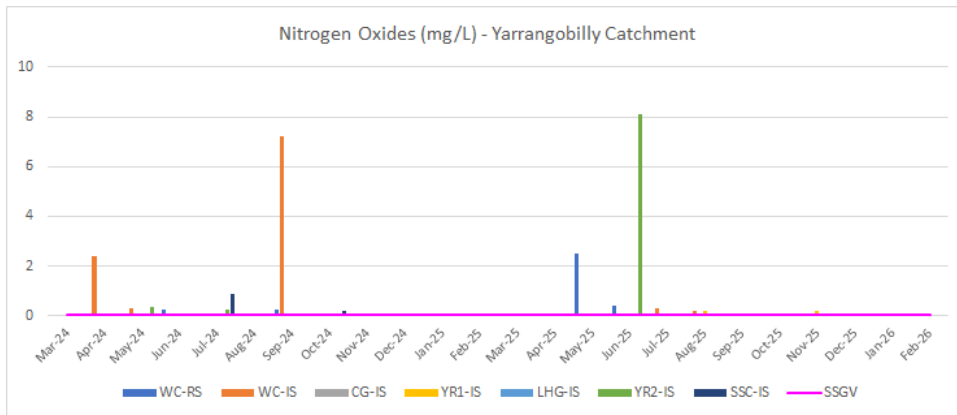


FIGURE 31: NITROGEN OXIDES FOR YARRANGOBILLY RIVER CATCHMENT

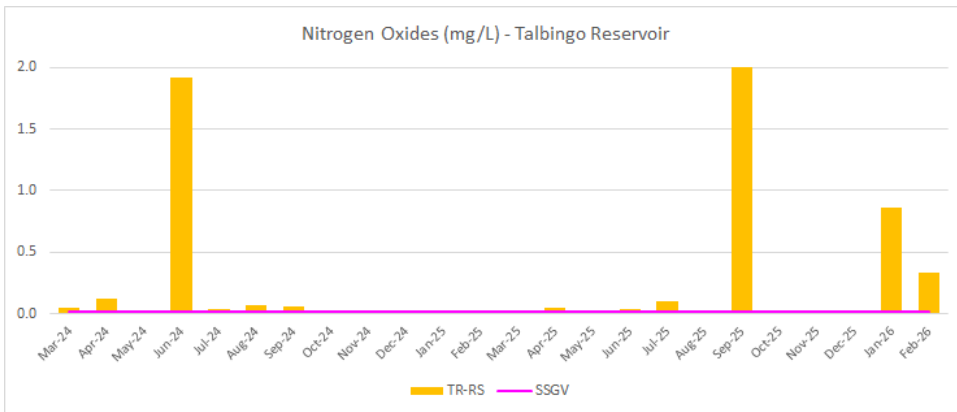


FIGURE 32: NITROGEN OXIDES FOR TALBINGO RESERVOIR

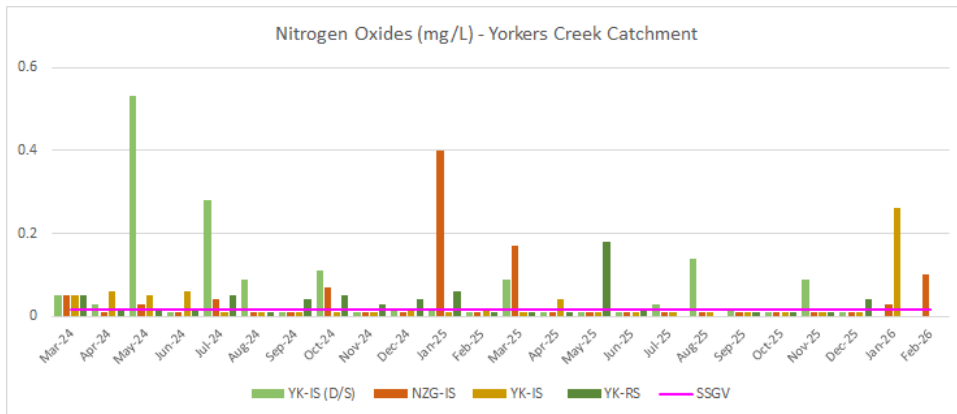


FIGURE 33: NITROGEN OXIDES FOR YORKERS CREEK CATCHMENT

5.2.1.11 Ammonia

Ammonia (mg/L) concentrations for the February 2026 sampling period exceeded the December-May SSGV at several sites including WC-IS, YR1-IS and YR2-IS in Yarrangobilly River Catchment. Notable excesses were recorded at the reference site at Talbingo Reservoir (TR-RS) and NZG-IS in Yorkers Creek Catchment. All other sites were below the LOR (Figure 34-Figure36).

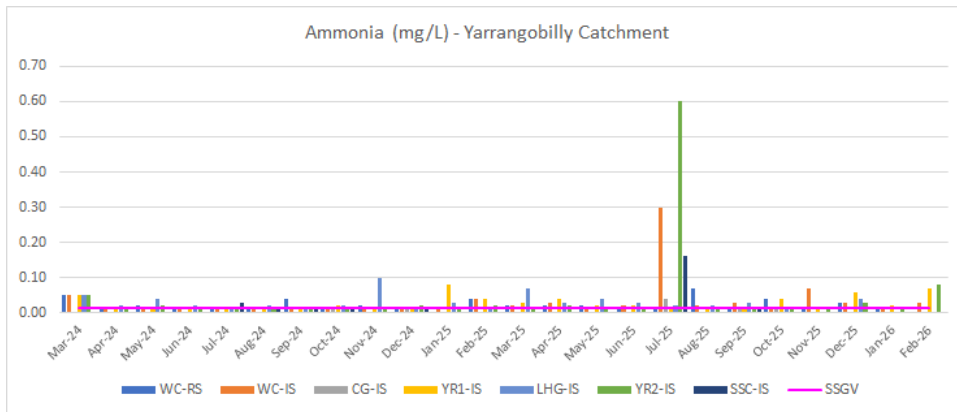


FIGURE 34: AMMONIA FOR YARRANGOBILLY RIVER CATCHMENT

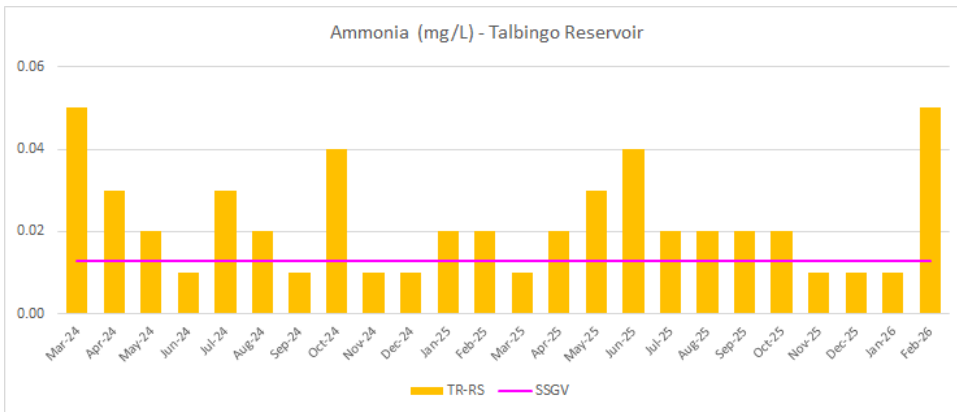


FIGURE 35: AMMONIA FOR TALBINGO RESERVOIR

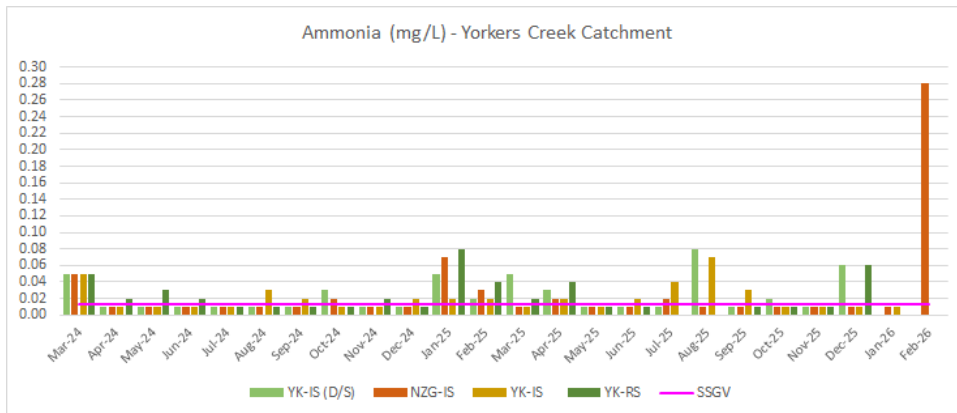


FIGURE 36: AMMONIA FOR YORKERS CREEK CATCHMENT

5.2.1.12 Cyanide

Cyanide (mg/L) concentrations were below the LOR at all sites across all three catchments, refer Figure 37 to Figure 38.

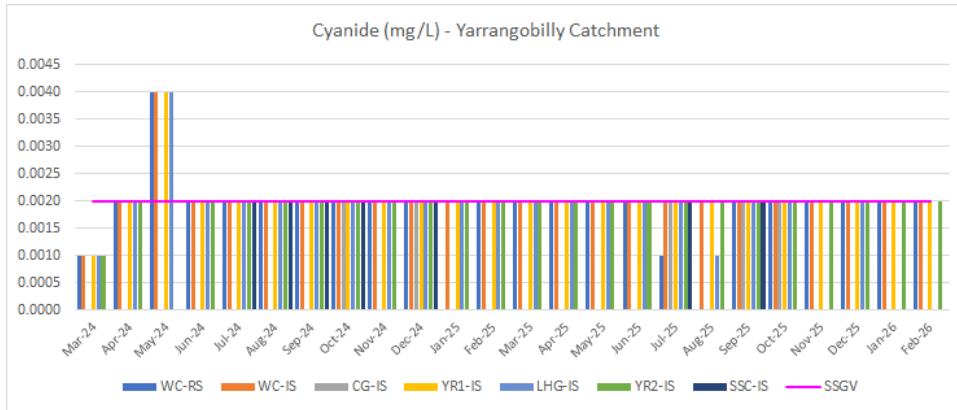


FIGURE 37: CYANIDE FOR YARRANGOBILLY RIVER CATCHMENT

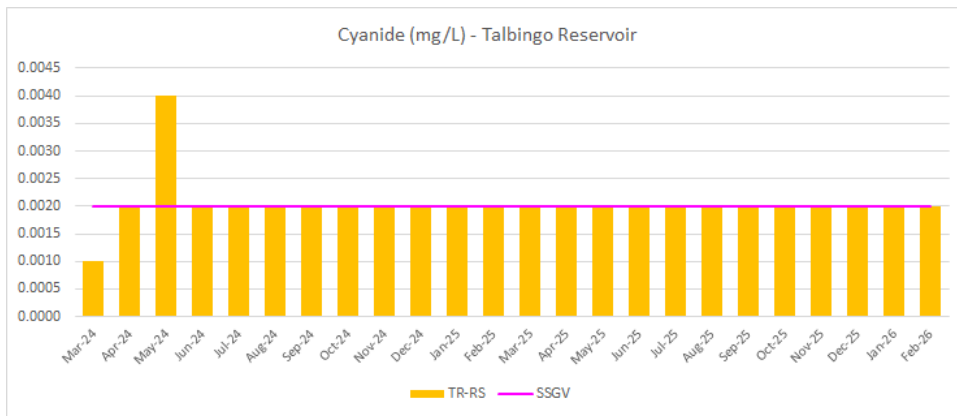


FIGURE 38: CYANIDE FOR TALBINGO RESERVOIR

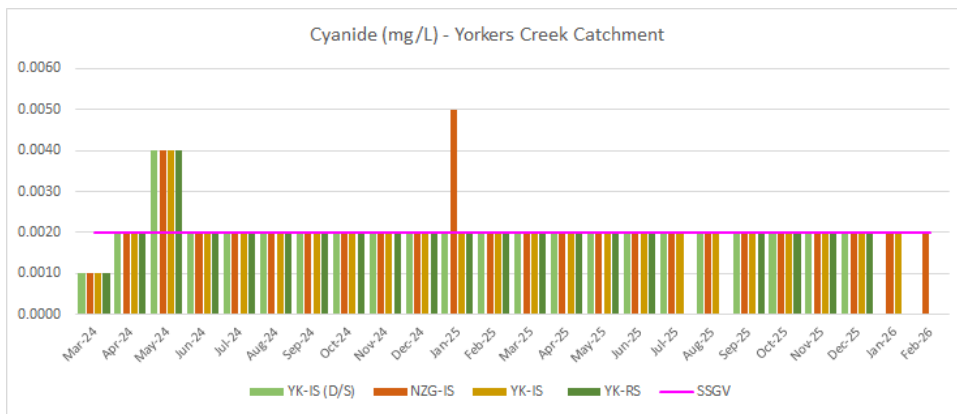


FIGURE 38: CYANIDE FOR YORKERS CREEK CATCHMENT

5.2.1.13 Total Hardness

February 2026 Total Hardness (mg/L) values generally increased compared with January 2026 (Figure 40-Figure 42), except at Talbingo Reservoir (TR-RS), where values were on-par with the prior month. All sampled sites exceeded the December-May SSGV.

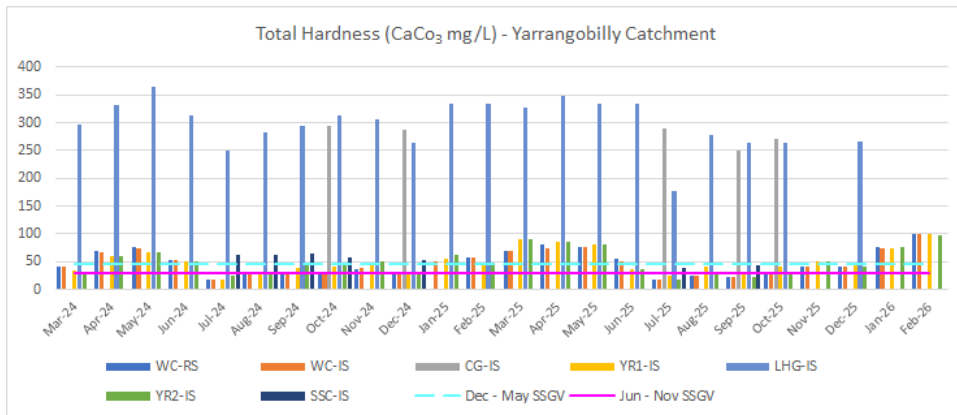


FIGURE 39: CaCO₃ FOR YARRANGOBILLY RIVER CATCHMENT

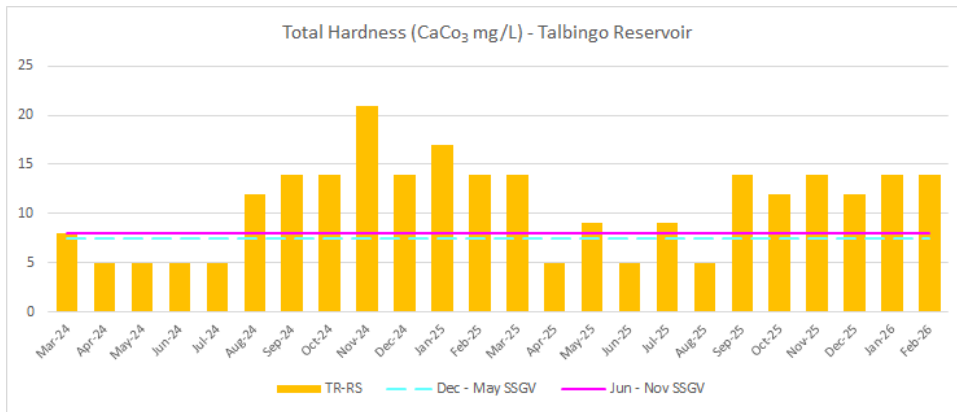


FIGURE 40: CaCO₃ FOR TALBINGO RESERVOIR

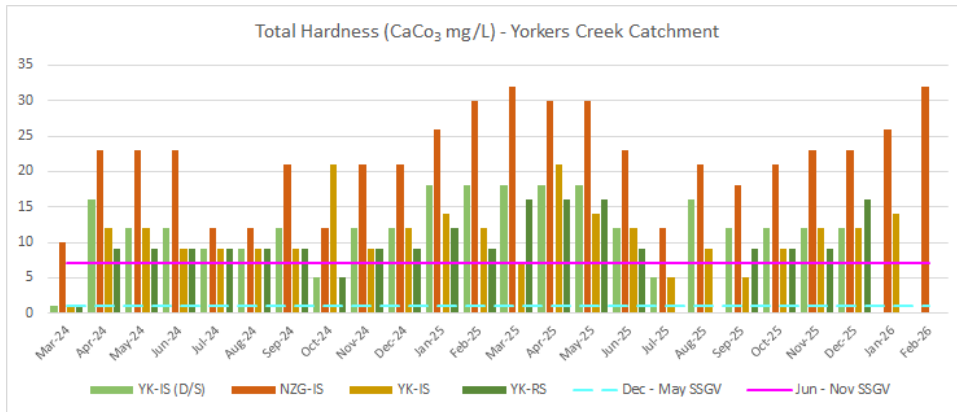


FIGURE 41: CaCO₃ FOR YORKERS CREEK CATCHMENT

5.2.1.14 Total Kjeldahl Nitrogen

During the February 2026 sampling period, Total Kjeldahl (mg/L) exceeded the December-May SSGV at YR1-IS in Yarrangobilly River Catchment, and NZG-IS in Yorkers Creek Catchment. A notable exceedance was recorded at Talbingo Reservoir (TR-RS). All other sites were below the LOR or below the SSGV (Figure 44-Figure 45).

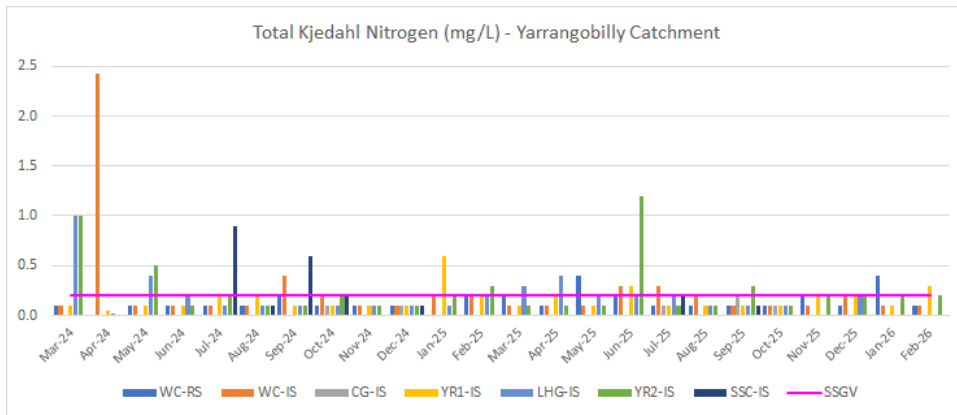


FIGURE 42: TKN FOR YARRANGOBILLY RIVER CATCHMENT

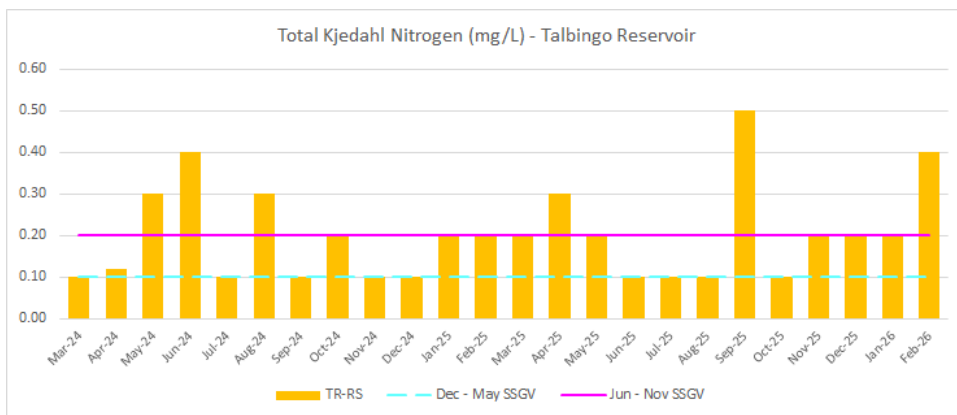


FIGURE 43: TKN FOR TALBINGO RESERVOIR

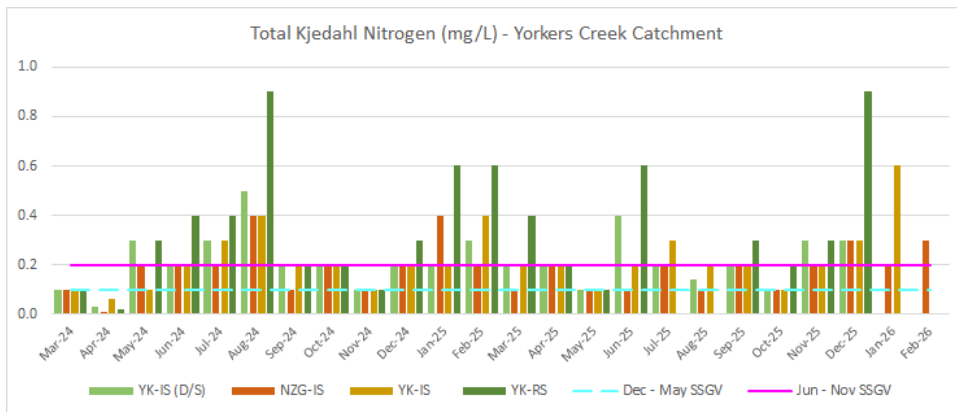


FIGURE 44: TKN FOR YORKERS CREEK CATCHMENT

5.2.1.15 Total Nitrogen

TN (mg/L) results for the February sampling period recorded exceedances of the December-May SSGV at YR1-IS in Yarrangobilly River Catchment, TR-RS at Talbingo Reservoir and NZG-IS and YK-IS in Yorkers Creek Catchment (Figure 46- Figure 48). All other sites were below the LOR or below the SSGV.

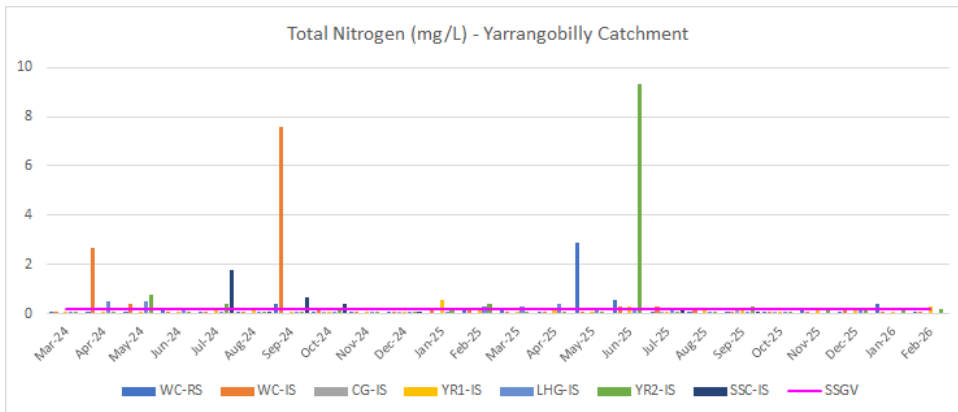


FIGURE 45: TN FOR YARRANGOBILLY RIVER CATCHMENT

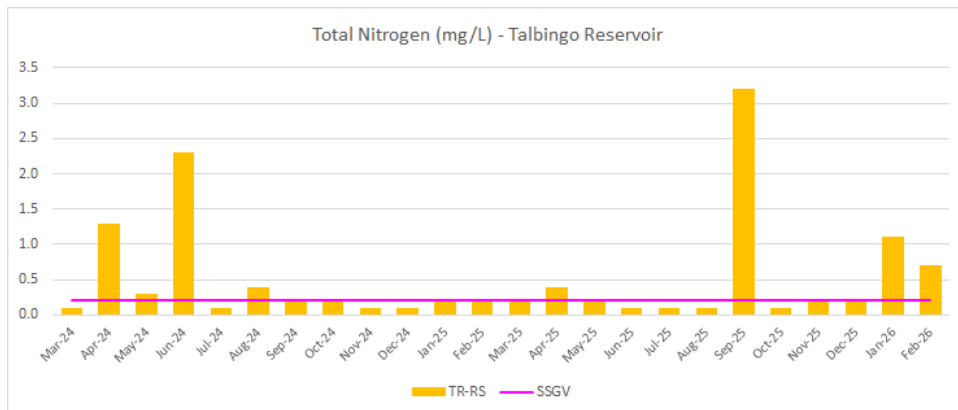


FIGURE 46: TN FOR TALBINGO RESERVOIR

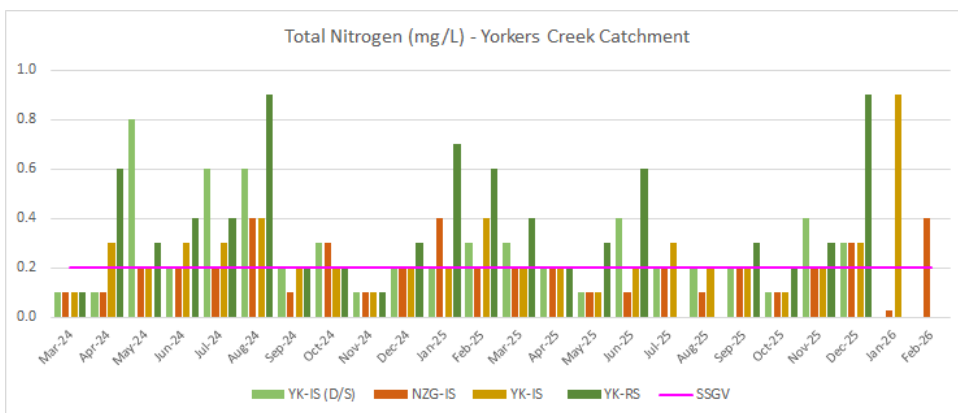


FIGURE 47: TN FOR YORKERS CREEK CATCHMENT

5.2.1.16 Total Phosphorus

During the February 2026 sampling period, Total Phosphorus (mg/L) marginally exceeded the December-May SSGV at WC-RS in Yarrangobilly River Catchment (Figure 49). All other sites were below the LOR or SSGV (Figure 50-Figure 51).

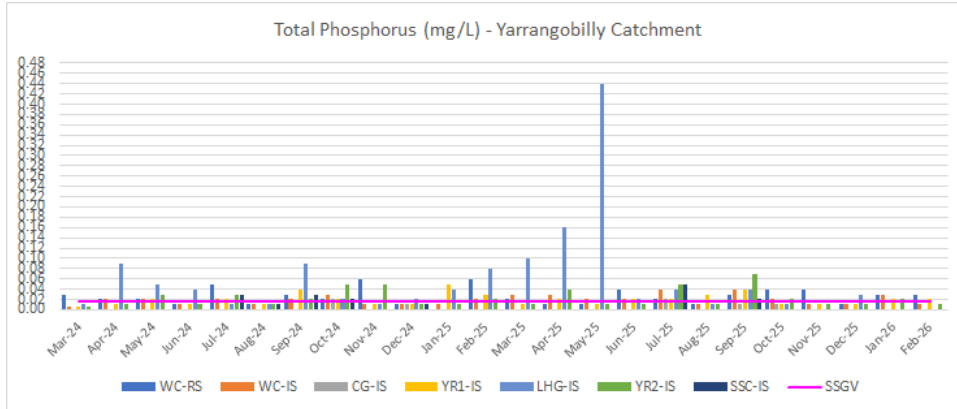


FIGURE 48: TP FOR YARRANGOBILLY RIVER CATCHMENT

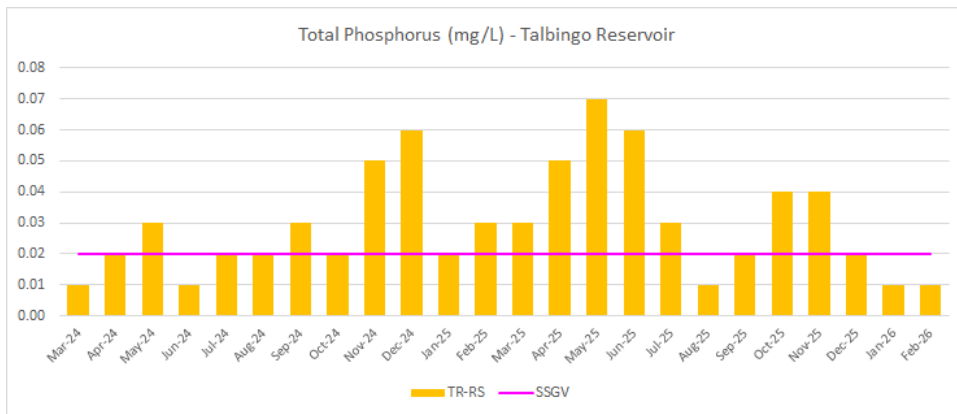


FIGURE 49: TP FOR TALBINGO RESERVOIR

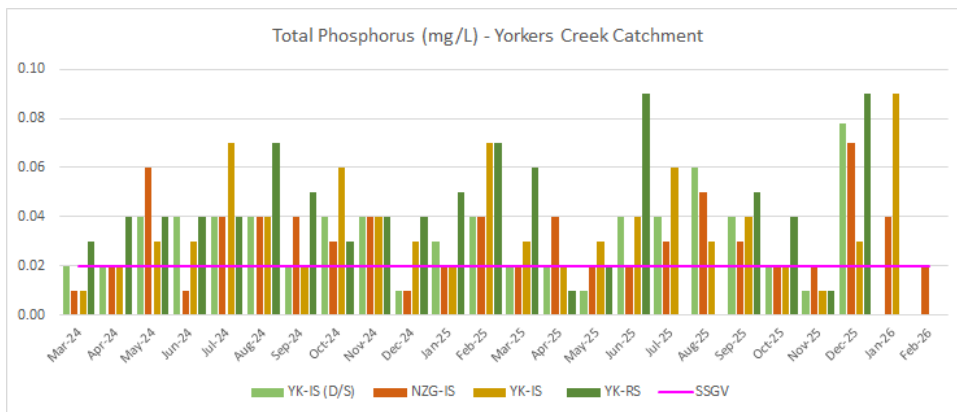


FIGURE 50: TP FOR YORKERS CREEK CATCHMENT

5.2.1.17 Reactive Phosphorus

All sites measured below the LOR for RP (mg/L), refer to Figure 51 - Figure 53.

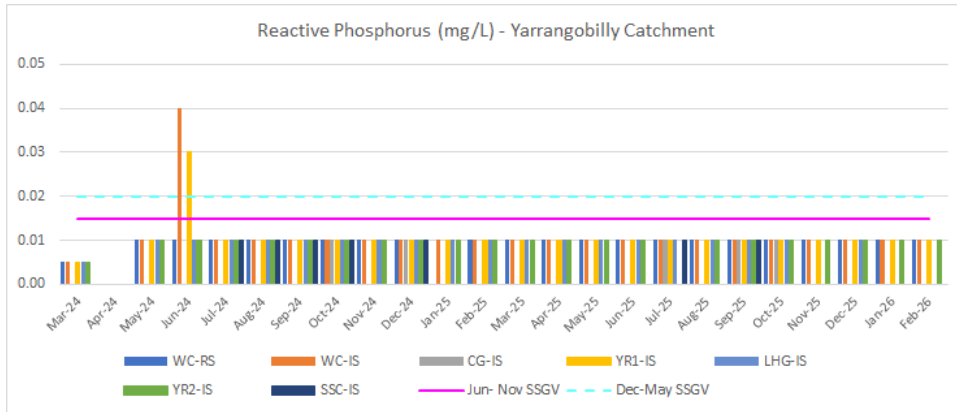


FIGURE 51: RP FOR YARRANGOBILLY RIVER CATCHMENT

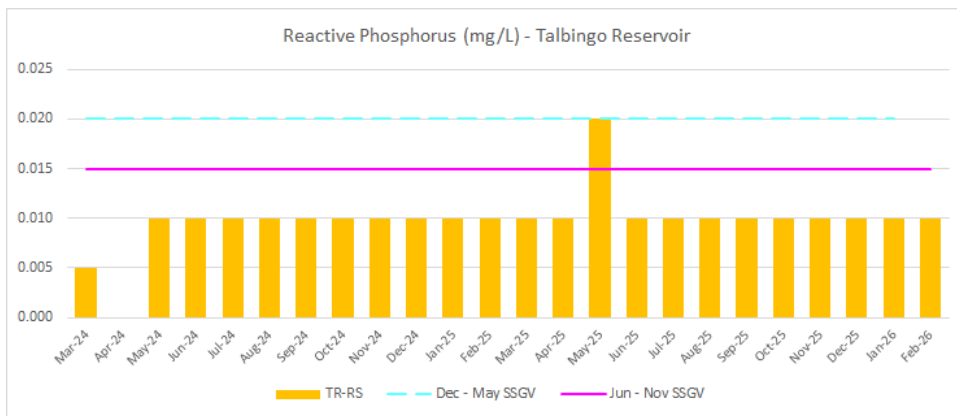


FIGURE 52: RP FOR TALBINGO RESERVOIR

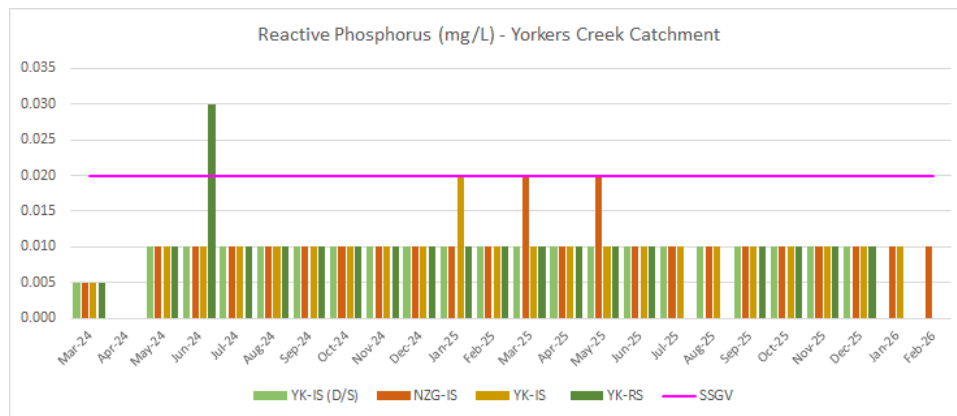


FIGURE 53: RP FOR YORKERS CREEK CATCHMENT

5.2.2 Dissolved Metals

Dissolved metals exceeding the relevant SSGV are listed in Table 4.

Table 4: Results for Dissolved Metals

DISSOLVED METALS RESULTS				
Analyte	Site	Result (mg/L)	SSGV (mg/L)	Comment
Mn	WC-RS	0.011	0.002	During the February 2026 sampling period, the December-May SSGV for Dissolved Mn (mg/L) was exceeded at several sites across all three catchments (Yarrangobilly River Catchment, Talbingo Reservoir, Yorkers Creek Catchment).
	WC-IS	0.008		
	YR1-IS	0.010		
	YR2-IS	0.004		
	TR-RS	0.007	0.003	
	NZG-IS	0.008	0.005	
Zn	WC-RS	0.012	0.002	The December-May SSGV value for Zn of 0.002mg/L was exceeded at several sites across all three catchments. A notable exceedance was exhibited at Talbingo Reservoir (TR-RS) where a value of 0.127 mg/L was recorded.
	WC-IS	0.006		
	YR1-IS	0.010		
	TR-RS	0.127		
	NZG-IS	0.031		

5.2.3 Total Metals

Total metals exceeding the DGV are listed in Table 5.

Table 5: Results for Total Metals

TOTAL METALS RESULTS				
Analyte	Site	Result (mg/L)	DGV (mg/L)	Comment
Al	NZG-IS	0.33	0.027	The Total Al DGV value (0.027 mg/L) was exceeded at one site, being NZG-IS in Yorkers Creek Catchment.
Zn	WC-RS	0.010	0.0024	The DGV value for Zn (0.0024mg/L) was exceeded at several locations across all three catchments (Yarrangobilly River Catchment, Talbingo Reservoir, Yorkers Creek Catchment).
	WC-IS	0.009		
	YR1-IS	0.011		
	TR-RS	0.087		
	NZG-IS	0.023		

6 DISCUSSION

Below is a summary of key observations and discussion points from the February 2026 monitoring results:

- Potential impacts to SWQ:
 - » Transmission line clearing and bulk earthworks activities were ongoing within the Yarrangobilly and Yorkers Creek catchment areas
 - » Impact sites within the Yarrangobilly River catchment are influenced by other activities associated with the Snowy 2.0
 - » TR-RS is located in O'Hares Campground, a popular public recreational area for water based activities including boating. It is also located adjacent to ancillary infrastructure associated with Talbingo Reservoir
 - » Many reference sites and impact sites are located adjacent to publicly accessible tracks used for maintenance and recreational activities
 - » Hoof marks, fauna scats and aquatic fauna indicate presence of fauna in and around waterways increasing potential for erosion of banks and sedimentation into waterways
 - » Vegetative debris and materials in the water have potential to leach nutrients into waterways
 - » Existing eroded banks increase potential for sedimentation into waterways
 - » Waterways with shallow water depth are more prone to SWQ impacts due to lack of volume
 - » Overhanging vegetation has potential to fall into waterways and influence water parameters
 - » Vegetation cover along the riparian zone can influence the stability of the banks and groundwater which in turn may influence the waterways
 - » Several waterways exhibited very low or no flow conditions, reducing dilution capacity and increasing sensitivity of water quality parameters to localised inputs.
 - » Evidence of road washouts and disturbed soils adjacent to waterways (e.g. YR2-IS) indicates potential pathways for sediment transport into receiving waters.
- Sampling and analysis:
 - » A number of sites (SSC-IS, CG-IS, LHG-IS, YK-RS, YK-IS (D/S), YK-IS) were dry or had no flow, limiting the spatial representativeness of sampling during this monitoring period
 - » Many of the results were recorded as below (<) the LOR
 - » Analysis of some parameters were inconclusive as the SSGV/DGV for a number of parameters was lower than the LOR from the laboratory
 - » Shallow water depth at sampling sites increased difficulty of sampling without disturbing bed
 - » Redox (mV), RP (mg/L) and DO (ppm) were analysed outside their respective holding times which may have decreased reliability of results

- SWQ parameters:
 - » Compared to January 2026, several parameters exhibited increases, including:
 - Specific conductance (SPC)
 - Electrical conductivity (EC)
 - Turbidity (in Yarrangobilly River and Talbingo Reservoir)
 - Total Dissolved Solids (TDS)
 - Total Hardness (CaCO₃)
 - These increases were observed across both reference and impact sites, indicating broader catchment influences rather than site-specific impacts alone.
 - » Temperatures decreased across all catchments compared to January 2026.
 - » pH values exceeded the December–May SSGV at most sites, except TR-RS.
 - » DO (%) increased within the Yarrangobilly River catchment but decreased at Talbingo Reservoir and Yorkers Creek catchments.
 - » All sites recorded DO values below the SSGV, consistent with previous monitoring trends.
 - » Reduced DO may be influenced by the low flow conditions
 - » SPC and EC exceeded the December–May SSGV at all sites and this trend is consistent with historical monitoring data.
 - » Turbidity increased at Yarrangobilly River and Talbingo Reservoir sites, with exceedances of SSGV recorded.
 - » TDS and CaCO₃ exceeded SSGV at all sites. These exceedances were observed across reference and impact sites, indicating regional influences.
 - » Redox values exceeded SSGV across all sites.
 - » Nitrogen oxides were generally below the LOR, with exceedances at TR-RS.
 - » Ammonia exceeded SSGV at several sites (unlikely to be associated with project works), including:
 - WC-IS, YR1-IS, YR2-IS
 - TR-RS (notable exceedance, as has previously occurred on regular occasions throughout 2024/25)
 - » TKN and TN recorded exceedances at selected sites, particularly:
 - YR1-IS, TR-RS
 - » Total phosphorus remained largely below SSGV, with only a marginal exceedance at WC-RS.
 - » Reactive phosphorus was below the LOR at all sites.
 - » Exceedances of dissolved Mn and Zn were recorded across multiple sites and catchments.
 - » A significant exceedance of dissolved Zn was observed at TR-RS.
 - » Total Zn exceeded DGV across multiple sites.

- » Presence of aquatic vegetation, algae and invertebrates at several sites indicates that Waterways continue to support aquatic ecosystems

7 CONCLUSION

Monthly construction SWQ monitoring was undertaken on 7 February 2026 in accordance with EPL 21753 and the revised methodology outlined in Section 3. Monitoring was completed at the available flowing locations within the Yarrangobilly River, Talbingo Reservoir and Yorkers Creek catchments.

A number of monitoring locations were dry or had no flow at the time of sampling, limiting the spatial coverage of the monitoring program during this period. Where sampling was possible, key physical and chemical parameters and metals (both dissolved and total) were analysed and compared against the relevant SSGV and DGV.

Overall, the February 2026 monitoring results indicate that several parameters exceeded the applicable SSGV and DGV, including specific conductance (SPC), electrical conductivity (EC), turbidity (at selected sites), total dissolved solids (TDS), total hardness (CaCO_3), redox, ammonia, nitrogen species and selected dissolved and total metals (notably Mn, Zn and Al at isolated locations).

Exceedances of SPC, EC, TDS and CaCO_3 were consistently observed across both reference and impact sites, indicating these results are likely influenced by broader catchment conditions, including low flow environments and natural geochemical processes, rather than direct construction-related impacts.

Elevated turbidity at sites within the Yarrangobilly River catchment and Talbingo Reservoir, along with the exceedance of total aluminium at NZG-IS, are consistent with field observations of eroded and unstable banks and the presence of suspended sediment. However, total suspended solids (TSS) were below the LOR at all sites, suggesting limited transport of coarse sediment at the time of sampling.

Nutrient variability, including exceedances of ammonia, TKN and total nitrogen at selected sites, is likely associated with organic matter decomposition, low flow conditions and external catchment influences such as recreational activities and fauna presence.

Dissolved metal exceedances (Mn and Zn) were recorded across multiple sites, including reference locations, indicating a strong influence from natural background conditions. A notable exceedance of dissolved zinc at Talbingo Reservoir (TR-RS) was observed and is considered consistent with broader catchment influences rather than a localised source.

Despite the exceedances observed, the presence of aquatic vegetation, algae and invertebrates across several monitoring locations indicates that the waterways continue to support aquatic ecosystems.

In summary, the February 2026 monitoring results reflect a combination of seasonal conditions, low flow environments and natural catchment influences. While some localised impacts associated with disturbed ground and bank instability were identified, there is no clear evidence to suggest that construction activities are the primary driver of the observed water quality trends during this monitoring period.

REFERENCES

- ALS. (2025a). ES2504313. *Certificate of Analysis*. NSW, Australia: ALS Limited.
- ALS. (2025b). ES2504313. *QA/QC Compliance Assessment to assist with Quality Review*. NSW, Australia: ALS Limited.
- ALS. (2025c). ES2504313. *Quality Control Report*. NSW, Australia: ALS Limited.
- ANZG. (2018). *Australian and New Zealand Guidelines for Fresh and Marine Water Quality*. ACT, Australia: Australian and New Zealand Governments and Australian state and territory governments.
- Jacobs. (2020). *Environmental Impact Statement*. NSW: Transgrid.
- NGH. (2022). *Pre-construction Water Quality Monitoring Program and Methodology*. NSW: NGH Pty Ltd.
- NGH. (2024). *Baseline Water Quality Report*. NSW: NGH Pty Ltd.
- UGL. (2025). October 2025. *Water Quality Monitoring Field Data Sheet*. NSW, Australia: UGL Limited.

Appendix A: Field Sheet (UGL, 2025)

**WATER QUALITY MONITORING
FIELD SHEET**

Date: ^{07 09} 12/09/26		Personnel: EH ⁸⁴⁰ LL					Sampling Purpose: ^{Feb} January Monthly WQM 2026				
Site	Time	Temp (°C)	Water Pressure (mmHg)	DO (%)	SPC (µS/cm)	pH	Turbidity (NTU)	TSS (mg/L)	EC (µS/cm)	Redox (mV)	Observations
DGV:		-	-	90 - 110	30 - 350	6.5 - 8	2 - 25	0.2	30-350	-	Weather Pre 24 hrs: 0.00mm
Dec - May SSGV:		-	-	96.2	115	7.85	0.37	0.2	93.2	79.1	Weather Forecast: 5% <1mm
Jun - Nov SSGV:		-	-	89.7	88	7.62	5.12	1	60.85	98.4	Weather Time of Sampling: Fine & Sunny
WC-RS Wallace Creek	11:05	19.2	712.9	86.3	212.0	7.99	1.69	0.00	188.4	151.1	<ul style="list-style-type: none"> • Exposed roots ^{• Sheen from organic detcom} • Low level of flow • Rocky bed • no discoloration • algae & aquatic veg
WC-IS Wallace Creek	11:21	21.0	713.1	90.4	206.9	8.05	1.28	0.00	191.7	145.6	<ul style="list-style-type: none"> • Very low level of flow • clear visibility • organic detritus • overhanging veg • rocky bed ^{• under mine trail bridge}
CG-IS Cave Gully											• DRY, NO FLOW

WATER QUALITY MONITORING FIELD SHEET

Date: ^{07/02} 12/04/26 Personnel: EH ~~830~~ LL Sampling Purpose: ^{FPO} Monthly WQM 2026

Site	Time	Temp (°C)	Water Pressure (mmHg)	DO (%)	SPC (µS/cm)	pH	Turbidity (NTU)	TSS (mg/L)	EC (µS/cm)	Redox (mV)	Observations
				90 - 110	30 - 350	6.5 - 8	2 - 25	0.2	30-350	-	Weather Pre 24 hrs: 0.00mm
				96.2	115	7.85	0.37	0.2	93.2	79.1	Weather Forecast: 5% <1mm
				89.7	88	7.62	5.12	1	60.85	98.4	Weather Time of Sampling: Fine & Sunny
YR1-IS Yarrangobilly River	11:40	22.6	713.0	93.4	204.1	8.19	1.37	0.00	1946	138.5	<ul style="list-style-type: none"> • very low level of flow • no discoloration • clear visibility • rocky bed
LHG-IS Lick Hole Gully											<ul style="list-style-type: none"> • NO FLOW; DRY
YR2-IS Yarrangobilly River	12:08	24.7	714.8	95.1	205.5	8.29	1.37	0.00	204.2	134.0	<ul style="list-style-type: none"> • clear visibility • rocky bed • under bridge vegetation • overhanging vegetation • no discoloration to water

WATER QUALITY MONITORING FIELD SHEET

Date: <u>Feb 26</u>		Personnel: <u>EH, LL</u>				Sampling Purpose: <u>Feb</u> Monthly WQM 2026					
Site	Time	Temp (°C)	Water Pressure (mmhg)	DO (%)	SPC (µS/cm)	pH	Turbidity (NTU)	TSS (mg/L)	EC (µS/cm)	Redox (mV)	Observations
DGV:		-	-	90 - 110	30 - 350	6.5 - 8	2 - 25	0.2	30-350	-	Weather Pre 24 hrs: <u>Dry</u>
Dec - May SSGV:		-	-	96.2	115	7.85	0.37	0.2	93.2	79.1	Weather Forecast: <u>5% rain</u>
Jun - Nov SSGV:		-	-	89.7	88	7.62	5.12	1	60.85	98.4	Weather Time of Sampling: Fine & Sunny
SSC-IS Sheep Station Creek											• DRY, NO FLOW
TR-RS Talbingo Reservoir	8:09	17.6	718.5	100% 79.1	122.3	7.40	2.67	0.00	105.0	122.1	<ul style="list-style-type: none"> • Very low level of flow • sandy bed • presence of aquatic invertebrates • presence of boat vessel & active campers • aquatic veg • bubbles on surface.
YK-RS Yorkers Creek											• DRY, NO FLOW

WATER QUALITY MONITORING FIELD SHEET

WATER QUALITY MONITORING FIELD SHEET											
Date: ^{7/02} 7/01/26		Personnel: EH <input checked="" type="checkbox"/> SQ					Sampling Purpose: ^{Fcb} January Monthly WQM 2026				
Site	Time	Temp (°C)	Water Pressure (mmhg)	DO (%)	SPC (µS/cm)	pH	Turbidity (NTU)	TSS (mg/L)	EC (µS/cm)	Redox (mV)	Observations
DGV:		-	-	90 - 110	30 - 350	6.5 - 8	2 - 25	0.2	30-350	-	Weather Pre 24 hrs: 0.0mm
Dec - May SSGV:		-	-	96.2	115	7.85	0.37	0.2	93.2	79.1	Weather Forecast: 5% chance
Jun - Nov SSGV:		-	-	89.7	88	7.62	5.12	1	60.85	98.4	Weather Time of Sampling: Fine & Sunny
YK-IS (D/S) Yorkers Creek											*NO FLOW, TOO LOW
NZG-IS New Zealand Gully	8:33	12.8	674.1	76.8	106.0	8.29	5.29	0.00	81.2	127.9	<ul style="list-style-type: none"> • Very low level of flow - slight yellow • eroded & muddy banks - dispersed • presence of horse hoof marks ^{sed} • Overhanging veg - organic detritus • High weed presence • sandy & fine rocky bed
YK-IS Yorkers Creek											*DRY, NO FLOW

Appendix B: COA (ALS, 2025a), QA/QC Assessment (ALS, 2025b) and QCR (ALS, 2025c)



CERTIFICATE OF ANALYSIS

Work Order	: ES2603998	Page	: 1 of 6
Client	: UGL LIMITED	Laboratory	: Environmental Division Sydney
Contact	: EBONY HAMES	Contact	: Customer Services ES
Address	: Cnr Hill Rd & Pondage Link Rd HOMEBUSH BAY 2127	Address	: 277-289 Woodpark Road Smithfield NSW Australia 2164
Telephone	: ----	Telephone	: +61-2-8784 8555
Project	: UGL Maragle Monthly WQM Feb	Date Samples Received	: 11-Feb-2026 15:25
Order number	: 4501837828	Date Analysis Commenced	: 12-Feb-2026
C-O-C number	: 93607	Issue Date	: 18-Feb-2026 16:17
Sampler	: EBONY HAMES, LAUREN LOGUE		
Site	: Maragle / Lobs Hole		
Quote number	: ES24UGLLIM001_V4		
No. of samples received	: 7		
No. of samples analysed	: 7		



This report supersedes any previous report(s) with this reference. Results apply to the sample(s) as submitted, unless the sampling was conducted by ALS. This document shall not be reproduced, except in full.

This Certificate of Analysis contains the following information:

- General Comments
- Analytical Results

Additional information pertinent to this report will be found in the following separate attachments: [Quality Control Report](#), [QA/QC Compliance Assessment](#) to assist with [Quality Review and Sample Receipt Notification](#).

Signatories

This document has been electronically signed by the authorized signatories below. Electronic signing is carried out in compliance with procedures specified in 21 CFR Part 11.

Signatories	Position	Accreditation Category
Ankit Joshi	Senior Chemist - Inorganics	Sydney Inorganics, Smithfield, NSW

right solutions. right partner.



Page : 2 of 6
Work Order : ES2603998
Client : UGL LIMITED
Project : UGL Maragle Monthly WQM Feb

General Comments

The analytical procedures used by ALS have been developed from established internationally recognised procedures such as those published by the USEPA, APHA, AS and NEPM. In house developed procedures are fully validated and are often at the client request.

Where moisture determination has been performed, results are reported on a dry weight basis.

Where a reported less than (<) result is higher than the LOR, this may be due to primary sample extract/digestate dilution and/or insufficient sample for analysis.

Where the LOR of a reported result differs from standard LOR, this may be due to high moisture content, insufficient sample (reduced weight employed) or matrix interference.

When sampling time information is not provided by the client, sampling dates are shown without a time component. In these instances, the time component has been assumed by the laboratory for processing purposes.

Where a result is required to meet compliance limits the associated uncertainty must be considered. Refer to the ALS Contract for details.

Key : CAS Number = CAS registry number from database maintained by Chemical Abstracts Services. The Chemical Abstracts Service is a division of the American Chemical Society.

LOR = Limit of reporting

^ = This result is computed from individual analyte detections at or above the level of reporting

e = ALS is not NATA accredited for these tests.

- = Indicates an estimated value.

- EG020: It has been confirmed by re-digestion and re-analysis that dissolved concentration for Zinc is higher than total concentration for sample ES2603998-#002 and #003. For all other elements where filtered results are greater than total results, the difference is within experimental variation of the methods.
- EG020: Zinc results for samples ES2603998-#002 and #003 have been confirmed by redigestion and reanalysis.
- Sodium Adsorption Ratio (where reported): Where results for Na, Ca or Mg are <LOR, a concentration at half the reported LOR is incorporated into the SAR calculation. This represents a conservative approach for Na relative to the assumption that <LOR = zero concentration and a conservative approach for Ca & Mg relative to the assumption that <LOR is equivalent to the LOR concentration.

Page : 3 of 6
 Work Order : ES2603998
 Client : UGL LIMITED
 Project : UGL Maragle Monthly WQM Feb

Analytical Results

Sub-Matrix: SURFACE WATER (Matrix: WATER)				Sample ID	NZG-IS	TR-RS	TR-RS (Duplicate)	YR1-IS	YR2-IS
Compound	CAS Number	LOR	Unit	Sampling date / time	ES2603998-001	ES2603998-002	ES2603998-003	ES2603998-004	ES2603998-005
				08-Feb-2026 10:11	08-Feb-2026 10:13	08-Feb-2026 10:18	08-Feb-2026 10:18	08-Feb-2026 10:19	
				Result	Result	Result	Result	Result	
EA015: Total Dissolved Solids dried at 180 ± 5 °C									
Total Dissolved Solids @180°C	---	10	mg/L		56	31	28	116	96
EA025: Total Suspended Solids dried at 104 ± 2 °C									
Suspended Solids (SS)	---	1	mg/L		<1	<1	<1	<1	<1
ED093F: SAR and Hardness Calculations									
Total Hardness as CaCO3	---	1	mg/L		32	14	14	99	97
EG020F: Dissolved Metals by ICP-MS									
Aluminium	7429-90-5	0.01	mg/L		0.03	0.01	0.02	<0.01	<0.01
Arsenic	7440-38-2	0.001	mg/L		<0.001	<0.001	<0.001	<0.001	<0.001
Cadmium	7440-43-9	0.0001	mg/L		<0.0001	<0.0001	<0.0001	<0.0001	<0.0001
Chromium	7440-47-3	0.001	mg/L		<0.001	<0.001	<0.001	<0.001	<0.001
Copper	7440-50-8	0.001	mg/L		<0.001	<0.001	<0.001	<0.001	<0.001
Nickel	7440-02-0	0.001	mg/L		<0.001	<0.001	<0.001	<0.001	<0.001
Lead	7439-92-1	0.001	mg/L		<0.001	<0.001	<0.001	<0.001	<0.001
Zinc	7440-66-6	0.005	mg/L		0.031	0.127	0.072	0.010	<0.005
Manganese	7439-96-5	0.001	mg/L		0.008	0.007	0.004	0.010	0.004
Silver	7440-22-4	0.001	mg/L		<0.001	<0.001	<0.001	<0.001	<0.001
Iron	7439-89-6	0.05	mg/L		0.05	<0.05	<0.05	<0.05	<0.05
EG020T: Total Metals by ICP-MS									
Aluminium	7429-90-5	0.01	mg/L		0.05	0.02	0.03	<0.01	<0.01
Arsenic	7440-38-2	0.001	mg/L		<0.001	<0.001	<0.001	<0.001	<0.001
Cadmium	7440-43-9	0.0001	mg/L		<0.0001	<0.0001	<0.0001	<0.0001	<0.0001
Chromium	7440-47-3	0.001	mg/L		<0.001	<0.001	<0.001	<0.001	<0.001
Copper	7440-50-8	0.001	mg/L		<0.001	0.001	<0.001	<0.001	<0.001
Nickel	7440-02-0	0.001	mg/L		<0.001	<0.001	<0.001	<0.001	<0.001
Lead	7439-92-1	0.001	mg/L		<0.001	<0.001	<0.001	<0.001	<0.001
Zinc	7440-66-6	0.005	mg/L		0.023	0.087	0.016	0.011	<0.005
Manganese	7439-96-5	0.001	mg/L		0.012	0.015	0.014	0.011	0.005

Page : 4 of 6
 Work Order : ES2603998
 Client : UGL LIMITED
 Project : UGL Maragle Monthly WQM Feb

Analytical Results

Sub-Matrix: SURFACE WATER (Matrix: WATER)				Sample ID	NZG-IS	TR-RS	TR-RS (Duplicate)	YR1-IS	YR2-IS
Compound	CAS Number	LOR	Unit	Sampling date / time	ES2603998-001	ES2603998-002	ES2603998-003	ES2603998-004	ES2603998-005
				08-Feb-2026 10:11	08-Feb-2026 10:13	08-Feb-2026 10:18	08-Feb-2026 10:18	08-Feb-2026 10:19	
				Result	Result	Result	Result	Result	
EG020T: Total Metals by ICP-MS - Continued									
Silver	7440-22-4	0.001	mg/L		<0.001	<0.001	<0.001	<0.001	<0.001
Iron	7439-89-6	0.05	mg/L		0.11	0.08	0.09	0.05	<0.05
EG035F: Dissolved Mercury by FIMS									
Mercury	7439-97-6	0.0001	mg/L		<0.0001	<0.0001	<0.0001	<0.0001	<0.0001
EG035T: Total Recoverable Mercury by FIMS									
Mercury	7439-97-6	0.0001	mg/L		<0.0001	<0.0001	<0.0001	<0.0001	<0.0001
EK026SF: Total CN by Segmented Flow Analyser									
Total Cyanide	57-12-5	0.002	mg/L		<0.002	<0.002	<0.002	<0.002	<0.002
EK055G: Ammonia as N by Discrete Analyser									
Ammonia as N	7664-41-7	0.01	mg/L		0.28	0.05	0.03	0.07	0.08
EK057G: Nitrite as N by Discrete Analyser									
Nitrite as N	14797-85-0	0.01	mg/L		<0.01	<0.01	<0.01	<0.01	<0.01
EK058G: Nitrate as N by Discrete Analyser									
Nitrate as N	14797-55-8	0.01	mg/L		0.10	0.33	0.28	<0.01	<0.01
EK059G: Nitrite plus Nitrate as N (NOx) by Discrete Analyser									
Nitrite + Nitrate as N	----	0.01	mg/L		0.10	0.33	0.28	<0.01	<0.01
EK061G: Total Kjeldahl Nitrogen By Discrete Analyser									
Total Kjeldahl Nitrogen as N	----	0.1	mg/L		0.3	0.4	0.2	0.3	0.2
EK062G: Total Nitrogen as N (TKN + NOx) by Discrete Analyser									
Total Nitrogen as N	----	0.1	mg/L		0.4	0.7	0.5	0.3	0.2
EK067G: Total Phosphorus as P by Discrete Analyser									
Total Phosphorus as P	----	0.01	mg/L		0.02	<0.01	0.04	0.02	<0.01
EK071G: Reactive Phosphorus as P by discrete analyser									
Reactive Phosphorus as P	14265-44-2	0.01	mg/L		0.01	<0.01	<0.01	<0.01	<0.01

Page : 5 of 6
 Work Order : ES2603998
 Client : UGL LIMITED
 Project : UGL Maragle Monthly WQM Feb

Analytical Results

Sub-Matrix: SURFACE WATER (Matrix: WATER)		Sample ID		WC-IS	WC-RS	----	----	----
		Sampling date / time		08-Feb-2026 10:19	08-Feb-2026 10:20	----	----	----
Compound	CAS Number	LOR	Unit	ES2603998-006	ES2603998-007	-----	-----	-----
				Result	Result	----	----	----
EA015: Total Dissolved Solids dried at 180 ± 5 °C								
Total Dissolved Solids @180°C	----	10	mg/L	124	121	----	----	----
EA025: Total Suspended Solids dried at 104 ± 2°C								
Suspended Solids (SS)	----	1	mg/L	<1	<1	----	----	----
ED093F: SAR and Hardness Calculations								
Total Hardness as CaCO3	----	1	mg/L	101	101	----	----	----
EG020F: Dissolved Metals by ICP-MS								
Aluminium	7429-90-5	0.01	mg/L	<0.01	<0.01	----	----	----
Arsenic	7440-38-2	0.001	mg/L	<0.001	<0.001	----	----	----
Cadmium	7440-43-9	0.0001	mg/L	<0.0001	<0.0001	----	----	----
Chromium	7440-47-3	0.001	mg/L	<0.001	<0.001	----	----	----
Copper	7440-50-8	0.001	mg/L	<0.001	<0.001	----	----	----
Nickel	7440-02-0	0.001	mg/L	<0.001	<0.001	----	----	----
Lead	7439-92-1	0.001	mg/L	<0.001	<0.001	----	----	----
Zinc	7440-66-6	0.005	mg/L	0.006	0.012	----	----	----
Manganese	7439-96-5	0.001	mg/L	0.008	0.011	----	----	----
Silver	7440-22-4	0.001	mg/L	<0.001	<0.001	----	----	----
Iron	7439-89-6	0.05	mg/L	<0.05	0.05	----	----	----
EG020T: Total Metals by ICP-MS								
Aluminium	7429-90-5	0.01	mg/L	<0.01	<0.01	----	----	----
Arsenic	7440-38-2	0.001	mg/L	<0.001	<0.001	----	----	----
Cadmium	7440-43-9	0.0001	mg/L	<0.0001	<0.0001	----	----	----
Chromium	7440-47-3	0.001	mg/L	<0.001	<0.001	----	----	----
Copper	7440-50-8	0.001	mg/L	<0.001	<0.001	----	----	----
Nickel	7440-02-0	0.001	mg/L	<0.001	<0.001	----	----	----
Lead	7439-92-1	0.001	mg/L	<0.001	<0.001	----	----	----
Zinc	7440-66-6	0.005	mg/L	0.009	0.010	----	----	----
Manganese	7439-96-5	0.001	mg/L	0.011	0.013	----	----	----



Analytical Results

Sub-Matrix: SURFACE WATER (Matrix: WATER)				Sample ID	WC-IS	WC-RS	----	----	----
Sampling date / time				08-Feb-2026 10:19	08-Feb-2026 10:20	----	----	----	
Compound	CAS Number	LOR	Unit	ES2603998-006	ES2603998-007	-----	-----	-----	
				Result	Result	----	----	----	
EG020T: Total Metals by ICP-MS - Continued									
Silver	7440-22-4	0.001	mg/L	<0.001	<0.001	----	----	----	
Iron	7439-89-6	0.05	mg/L	0.06	0.08	----	----	----	
EG035F: Dissolved Mercury by FIMS									
Mercury	7439-97-6	0.0001	mg/L	<0.0001	<0.0001	----	----	----	
EG035T: Total Recoverable Mercury by FIMS									
Mercury	7439-97-6	0.0001	mg/L	<0.0001	<0.0001	----	----	----	
EK026SF: Total CN by Segmented Flow Analyser									
Total Cyanide	57-12-5	0.002	mg/L	<0.002	<0.002	----	----	----	
EK055G: Ammonia as N by Discrete Analyser									
Ammonia as N	7664-41-7	0.01	mg/L	0.03	0.03	----	----	----	
EK057G: Nitrite as N by Discrete Analyser									
Nitrite as N	14797-65-0	0.01	mg/L	<0.01	<0.01	----	----	----	
EK058G: Nitrate as N by Discrete Analyser									
Nitrate as N	14797-55-8	0.01	mg/L	<0.01	<0.01	----	----	----	
EK059G: Nitrite plus Nitrate as N (NOx) by Discrete Analyser									
Nitrite + Nitrate as N	----	0.01	mg/L	<0.01	<0.01	----	----	----	
EK061G: Total Kjeldahl Nitrogen By Discrete Analyser									
Total Kjeldahl Nitrogen as N	----	0.1	mg/L	0.1	0.1	----	----	----	
EK062G: Total Nitrogen as N (TKN + NOx) by Discrete Analyser									
Total Nitrogen as N	----	0.1	mg/L	0.1	0.1	----	----	----	
EK067G: Total Phosphorus as P by Discrete Analyser									
Total Phosphorus as P	----	0.01	mg/L	0.01	0.03	----	----	----	
EK071G: Reactive Phosphorus as P by discrete analyser									
Reactive Phosphorus as P	14265-44-2	0.01	mg/L	<0.01	<0.01	----	----	----	



Appendix C: February 2026 WQ Monitoring Results

Parameter	Sheen/ oil/ grease	Temp. (°C)	Dissolved Oxygen (DO %)	DO (ppm)	Specific EC (SPC uS/cm)	EC (uS/cm)	pH	Redox (mV)	Turbidity (NTU)	Dissolved Al (mg/L)	Dissolved As (mg/L)	Dissolved Cd (mg/L)	Dissolved Cr (mg/L)	Dissolved Cu (mg/L)	Cyanide (mg/L)	Dissolved Fe (mg/L)	Dissolved Pb (mg/L)	Dissolved Mn (mg/L)	Dissolved Hg (mg/L)	
YARRANGOBILLY CATCHMENT																				
Default Guideline Value (DGV)	No	-	90-110	-	30-350	30-350	6.5-8	-	2-25	0.027	0.0008	0.0006	0.00001	0.001	0.004	0.3	0.001	1.2	0.00006	
Limit of Reporting (LOR)									0.1	0.01	0.001	0.0001	0.001	0.001	0.002	0.05	0.001	0.001	0.0001	
Dec - May Site Specific Guideline Value (SSGV)			96.2	9.08	115	93.2	7.85	79.1	0.37	0.03	0.0003	0.00002	0.00001	0.0002	0.002	0.03	0.001	0.002	0.00003	
June - Nov SSGV			89.7	10.28	88	60.85	7.62	98.4	5.12	0.04	0.0003	0.00002	0.00001	0.0002	0.002	0.02	0.001	0.002	0.00003	
WC-RS	Mar-24	No	10.7	87.5	9.72	143.6	104.3	7.80	25.9	0.1	0.02	0.00015	0.00001	0.00001	0.002	0.01	0.03	0.002	0.003	0.00002
	Apr-24	No	10.7	94.8	-	145.6	-	8.44	-	1.05	0.01	0.001	0.0001	0.001	0.001	0.02	0.11	0.001	0.007	0.0001
	May-24	No	2.1	93.8	-	155	-	8.05	-	0.39	0.01	0.001	0.0001	0.001	0.001	0.004	0.05	0.001	0.009	0.0001
	Jun-24	No	4.7	92.9	-	126.8	-	7.51	-	0.56	0.01	0.001	0.0001	0.001	0.001	0.002	0.05	0.001	0.005	0.0001
	Jul-24	No	6.4	91.9	-	46.6	-	6.96	-	9.24	0.07	0.001	0.0001	0.001	0.001	0.002	0.05	0.001	0.002	0.0001
	Aug-24	No	10.4	80.6	-	47.1	-	7.80	-	1.6	0.02	0.001	0.0001	0.001	0.001	0.002	0.05	0.001	0.002	0.0001
	Sep-24	No	11.7	92.0	-	43	-	7.86	-	0.5	0.01	0.001	0.0001	0.001	0.001	0.002	0.05	0.001	0.002	0.0001
	Oct-24	No	9.3	92.7	-	52	-	7.55	-	1.3	0.02	0.001	0.0001	0.001	0.001	0.002	0.05	0.001	0.002	0.0001
	Nov-24	No	12.2	90.6	9.7	82	82	7.63	235	0.6	0.02	0.001	0.0001	0.001	0.001	0.002	0.05	0.001	0.004	0.0001
	Dec-24	Yes	12.7	90.0	10.0	41.8	71.0	7.75	250	1.4	0.01	0.001	0.0001	0.001	0.001	0.002	0.05	0.001	0.001	0.0001
*sample not an	Jan-25	No	26.6	83.2	-	27.3	-	8.13	-	0.65	-	-	-	-	-	-	-	-	-	-
	Feb-25	No	16.3	86.0	9.2	26.3	123	7.76	158	4.01	0.06	0.001	0.0001	0.001	0.001	0.002	0.08	0.001	0.008	0.0001
	Mar-25	Yes	14.7	92.7	9.8	34.6	145	8.32	162	1.16	0.01	0.001	0.0001	0.001	0.001	0.002	0.05	0.001	0.008	0.0001
	Apr-25	No	17.6	91.8	10.5	34	155	8.19	202	0.9	0.01	0.001	0.0001	0.001	0.001	0.002	0.05	0.001	0.007	0.0001
	May-25	Yes	9.9	96.0	-	33.7	24	8.59	110.8	1.04	0.01	0.001	0.0001	0.001	0.001	0.002	0.05	0.001	0.007	0.0001
	Jun-25	No	5.9	89.1	-	12.4	7.9	8.63	113.9	2.87	0.02	0.001	0.0001	0.001	0.001	0.002	0.05	0.001	0.005	0.0001
	Jul-25	No	8.6	87.6	-	11.3	7.7	9.20	193.5	5.9	0.06	0.001	0.0001	0.001	0.001	0.001	0.01	0.001	0.001	0.0001
	Aug-25	No	9.7	94.9	-	15.4	9.8	7.00	294.9	3.93	0.02	0.001	0.0001	0.001	0.001	-	0.05	0.001	0.001	0.0001
*sample not an	Sep-25	No	5.3	93.3	-	101.1	63.1	8.20	177.5	0.8	0.03	0.001	0.0001	0.001	0.001	0.002	0.05	0.001	0.002	0.0001
	Oct-25	Yes	8.6	93.4	-	86.7	59.6	7.59	111.6	0.88	0.01	0.001	0.0001	0.001	0.001	0.002	0.05	0.001	0.002	0.0001
	Nov-25	No	16.3	76.4	-	99.2	4	7.88	161.3	0.73	0.01	0.001	0.0001	0.001	0.001	0.002	0.05	0.001	0.003	0.0001
	Dec-25	No	17.2	80.1	-	109.9	93.5	7.95	148	4.54	0.01	0.001	0.0001	0.001	0.001	0.002	0.05	0.001	0.003	0.0001
	Jan-26	No	27.6	90.2	-	84	88.1	8.22	113.9	6.91	0.01	0.001	0.0001	0.001	0.001	0.002	0.05	0.001	0.054	0.0001
	Feb-26	Yes	19.2	86.3	-	212	188.4	7.99	151.1	1.69	0.01	0.001	0.0001	0.001	0.001	0.002	0.05	0.001	0.011	0.0001
WC-IS	Mar-24	No	10.7	87.1	9.68	145.9	105.9	7.83	41.9	0.1	0.03	0.00015	0.00001	0.00001	0.002	0.01	0.03	0.002	0.003	0.00002
	Apr-24	No	10.7	95.0	-	145.2	-	8.45	-	0.9	0.01	0.001	0.0001	0.001	0.001	0.002	0.07	0.001	0.006	0.0001
	May-24	No	2.1	94.1	-	154.9	-	7.86	-	0.3	0.01	0.001	0.0001	0.001	0.001	0.004	0.05	0.001	0.007	0.0001
	Jun-24	No	4.8	93.3	-	126.7	-	7.72	-	0.35	0.01	0.001	0.0001	0.001	0.001	0.002	0.05	0.001	0.004	0.0001
	Jul-24	No	6.6	91.2	-	46.6	-	6.96	-	7.65	0.07	0.001	0.0001	0.001	0.001	0.002	0.05	0.001	0.002	0.0001
	Aug-24	No	10.5	91.5	-	45.6	-	7.83	-	5.85	0.02	0.001	0.0001	0.001	0.001	0.002	0.05	0.001	0.001	0.0001
	Sep-24	No	11.7	92.9	-	54.4	-	7.83	-	5.5	0.04	0.001	0.0001	0.001	0.001	0.002	0.05	0.001	0.005	0.0001
	Oct-24	No	9.5	93.3	-	52.1	-	7.66	-	1.4	0.02	0.001	0.0001	0.001	0.001	0.002	0.05	0.001	0.002	0.0001
	Nov-24	No	12.2	90.4	9.9	82	82	7.63	245	0.3	0.01	0.001	0.0001	0.001	0.001	0.002	0.05	0.001	0.002	0.0001
	Dec-24	No	12.7	91.1	10.1	41.3	72	7.48	259	1.4	0.01	0.001	0.0001	0.001	0.001	0.002	0.05	0.001	0.001	0.0001
	Jan-25	No	17.8	85.7	9.1	24.5	108	7.80	232	2.75	0.01	0.001	0.0001	0.001	0.001	0.002	0.05	0.001	0.007	0.0001
	Feb-25	No	16.3	85.2	9.4	26	123	7.80	164	4.06	0.06	0.001	0.0001	0.001	0.001	0.002	0.08	0.001	0.007	0.0001
	Mar-25	No	16.1	95.8	9.7	31.8	145	8.33	170	1.13	0.01	0.001	0.0001	0.001	0.001	0.002	0.05	0.001	0.006	0.0001
	Apr-25	No	17.3	92.8	10.6	33.5	155	8.66	197	1.02	0.01	0.001	0.0001	0.001	0.001	0.002	0.05	0.001	0.005	0.0001
	May-25	No	9.4	96.1	-	34.3	24.1	8.71	110.9	1.4	0.01	0.001	0.0001	0.001	0.001	0.002	0.05	0.001	0.006	0.0001
	Jun-25	No	5.8	89.6	-	24.5	15.5	8.30	113.6	5.1	0.02	0.001	0.0001	0.001	0.001	0.002	0.05	0.001	0.003	0.0001
	Jul-25	No	8.1	85.9	-	11.2	7.6	9.40	199.4	9.92	0.06	0.001	0.0001	0.001	0.001	0.002	0.05	0.001	0.001	0.0001
	Aug-25	No	10.3	96.5	-	13.7	9.8	7.00	294.9	3.93	0.02	0.001	0.0001	0.001	0.001	0.002	0.05	0.001	0.002	0.0001
	Sep-25	No	5.2	93.9	-	72.1	44.9	8.50	178.5	6	0.03	0.001	0.0001	0.001	0.003	0.002	0.05	0.001	0.002	0.0001
	Oct-25	No	11.9	100.6	-	89.7	67.2	7.64	110.3	0.88	0.01	0.001	0.0001	0.001	0.001	0.002	0.05	0.001	0.002	0.0001
	Nov-25	No	14.7	76.5	-	95.3	76.5	7.84	147	1.15	0.01	0.001	0.0001	0.001	0.005	0.002	0.05	0.001	0.003	0.0001
	Dec-25	No	17.6	81.8	-	109	93.5	8.10	132.1	4.29	0.02	0.001	0.0001	0.001	0.001	0.002	0.05	0.001	0.003	0.0001
	Jan-26	No	24.3	87.8	-	181.8	88.1	8.22	113.9	6.91	0.01	0.001	0.0001	0.001	0.001	0.002	0.05	0.001	0.008	0.0001
	Feb-26	No	21.0	90.4	-	206.9	191.7	8.05	145.6	1.28	0.01	0.001	0.0001	0.001	0.001	0.002	0.05	0.001	0.008	0.0001

Reference Site exceeds SSGV
 Impact Site Result exceeds SSGV or DGV
italics Result exceeds the Limit of Reporting

Parameter	Dissolved Ni (mg/L)	TN (mg/L)	TP (mg/L)	Dissolved Ag (mg/L)	Dissolved Zn (mg/L)	Ammonia (mg/L)	Nitrogen Oxides (mg/L)	Reactive Phosphorus (mg/L)	Total Hardness (mg/L) (CaCO3)	Total Kjeldahl Nitrogen (mg/L) (TKN)	TDS (mg/L)	TSS (mg/L)	Total Al (mg/L)	Total As (mg/L)	Total Cd (mg/L)	Total Cr (mg/L)	Total Cu (mg/L)	Total Pb (mg/L)	Total Mn (mg/L)	Total Ni (mg/L)	Total Ag (mg/L)	Total Zn (mg/L)	Total Fe (mg/L)	Total Hg (mg/L)	
YARRANGOBILLY CATCHMENT																									
Default Guideline Value (DGV)	0.008	0.25	0.02	0.00002	0.0024	0.013	0.015	0.015	-	-	-	0.2	0.027	0.0008	0.0006	0.00001	0.001	0.001	1.2	0.008	0.00002	0.0024	0.3	0.00006	
Limit of Reporting (LOR)	0.001	0.1	0.01	0.001	0.005	0.010	0.010	0.010	1	0.1	10	1	0.01	0.001	0.0001	0.001	0.001	0.001	0.001	0.001	0.001	0.005	0.05	0.0001	
Dec - May Site Specific Guideline Value (SSGV)	0.001	0.2	0.02	0.00002	0.002	0.013	0.015	0.020	47	0.2	52	0.2													
June - Nov SSGV	0.001	0.2	0.02	0.00002	0.002	0.013	0.015	0.015	30	0.2	39	1.0													
WC-RS	Mar-24	0.001	0.1	0.03	0.00001	0.001	0.050	0.05	0.005	42	0.1	70	0.1	-	-	-	-	-	-	-	-	-	-	-	
	Apr-24	0.001	0.1	0.02	0.001	0.005	0.010	0.01	-	70	0.01	-	1	0.02	0.001	0.0001	0.001	0.001	0.001	0.01	0.001	0.001	0.005	0.05	0.0001
	May-24	0.001	0.1	0.02	0.001	0.005	0.020	0.01	0.01	77	0.1	102	5	0.01	0.001	0.0001	0.001	0.001	0.001	0.007	0.001	0.001	0.005	0.05	0.0001
	Jun-24	0.001	0.2	0.01	0.001	0.005	0.010	0.23	0.01	53	0.1	81	2	0.01	0.001	0.0001	0.001	0.001	0.007	0.001	0.001	0.005	0.05	0.0001	
	Jul-24	0.001	0.1	0.05	0.001	0.005	0.010	0.01	0.01	17	0.1	38	8	0.09	0.001	0.0001	0.001	0.001	0.01	0.001	0.001	0.005	0.09	0.0001	
	Aug-24	0.001	0.1	0.01	0.001	0.005	0.010	0.01	0.01	28	0.1	51	4	0.06	0.001	0.0001	0.001	0.001	0.007	0.001	0.001	0.005	0.07	0.0001	
	Sep-24	0.001	0.4	0.03	0.001	0.005	0.040	0.22	0.01	31	0.2	65	3	0.04	0.001	0.0001	0.001	0.001	0.005	0.001	0.001	0.005	0.05	0.0001	
	Oct-24	0.001	0.1	0.02	0.001	0.005	0.010	0.02	0.01	31	0.1	46	1	0.07	0.001	0.0001	0.001	0.001	0.004	0.001	0.001	0.005	0.1	0.0001	
	Nov-24	0.001	0.1	0.06	0.001	0.005	0.020	0.02	0.01	36	0.1	60	2	0.01	0.001	0.0001	0.001	0.001	0.003	0.001	0.001	0.005	0.05	0.0001	
	Dec-24	0.001	0.1	0.01	0.001	0.005	0.010	0.01	0.01	31	0.1	51	2	0.09	0.001	0.0001	0.001	0.001	0.006	0.001	0.001	0.005	0.08	0.0001	
*sample not an	Jan-25	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	
	Feb-25	0.001	0.2	0.06	0.001	0.005	0.040	0.02	0.01	57	0.2	61	2	0.16	0.001	0.0001	0.001	0.001	0.011	0.001	0.001	0.008	0.15	0.0001	
	Mar-25	0.001	0.2	0.02	0.001	0.005	0.020	0.01	0.01	70	0.2	90	1	0.01	0.001	0.0001	0.001	0.001	0.01	0.001	0.001	0.005	0.05	0.0001	
	Apr-25	0.001	0.1	0.01	0.001	0.005	0.020	0.01	0.01	80	0.1	88	1	0.01	0.001	0.0001	0.001	0.001	0.009	0.001	0.001	0.005	0.06	0.0001	
	May-25	0.001	2.9	0.01	0.001	0.005	0.020	2.5	0.01	77	0.4	104	1	0.01	0.001	0.0001	0.001	0.001	0.009	0.001	0.001	0.005	0.05	0.0001	
	Jun-25	0.001	0.6	0.04	0.001	0.005	0.010	0.42	0.01	55	0.2	84	3	0.08	0.001	0.0001	0.001	0.001	0.008	0.001	0.001	0.005	0.09	0.0001	
	Jul-25	0.001	0.1	0.02	0.001	0.005	0.010	0.1	0.01	19	0.1	36	6	0.17	0.001	0.0001	0.001	0.001	0.011	0.001	0.001	0.005	0.16	0.0001	
	Aug-25	0.001	0.1	0.01	0.001	0.005	0.070	0.1	0.01	26	0.1	37	1	0.05	0.001	0.0001	0.001	0.001	0.004	0.001	0.001	0.005	0.05	0.0001	
*sample not an	Sep-25	0.001	0.1	0.03	0.001	0.01	0.010	0.01	0.01	23	0.1	46	1	0.09	0.001	0.0001	0.001	0.001	0.005	0.001	0.001	0.005	0.07	0.0001	
	Oct-25	0.001	0.1	0.04	0.001	0.005	0.040	0.01	0.01	33	0.1	44	1	0.04	0.001	0.0001	0.001	0.001	0.004	0.001	0.001	0.005	0.05	0.0001	
	Nov-25	0.001	0.2	0.04	0.001	0.025	0.010	0.01	0.01	41	0.2	52	1	0.02	0.001	0.0001	0.001	0.019	0.004	0.001	0.005	0.028	0.05	0.0001	
	Dec-25	0.001	0.1	0.01	0.001	0.005	0.030	0.02	0.01	41	0.1	93	3	0.11	0.001	0.0001	0.001	0.001	0.008	0.001	0.001	0.005	0.12	0.0001	
	Jan-26	0.001	0.4	0.03	0.001	0.054	0.010	0.02	0.01	77	0.4	125	1	0.04	0.001	0.0001	0.001	0.001	0.011	0.001	0.001	0.057	0.09	0.0001	
	Feb-26	0.001	0.1	0.03	0.001	0.012	0.003	0.01	0.01	101	0.1	121	1	0.01	0.001	0.0001	0.001	0.001	0.013	0.001	0.001	0.010	0.08	0.0001	
WC-IS	Mar-24	0.0005	0.1	0.005	0.00001	0.001	0.050	0.05	0.005	42	0.1	88	0.1	-	-	-	-	-	-	-	-	-	-	-	
	Apr-24	0.001	2.7	0.02	0.001	0.005	0.010	2.42	-	67	2.42	-	11	0.15	0.001	0.0001	0.001	0.001	0.022	0.004	0.001	0.005	0.22	0.0001	
	May-24	0.001	0.4	0.02	0.001	0.005	0.010	0.31	0.01	75	0.1	106	5	0.01	0.001	0.0001	0.001	0.001	0.006	0.001	0.001	0.005	0.05	0.0001	
	Jun-24	0.001	0.1	0.01	0.001	0.005	0.010	0.02	0.04	53	0.1	81	1	0.01	0.001	0.0001	0.001	0.001	0.005	0.001	0.001	0.005	0.05	0.0001	
	Jul-24	0.001	0.1	0.02	0.001	0.005	0.010	0.01	0.01	17	0.1	42	5	0.11	0.001	0.0001	0.001	0.001	0.011	0.001	0.001	0.005	0.1	0.0001	
	Aug-24	0.001	0.1	0.01	0.001	0.006	0.010	0.03	0.01	28	0.1	45	4	0.06	0.001	0.0001	0.001	0.001	0.006	0.001	0.001	0.005	0.06	0.0001	
	Sep-24	0.001	7.6	0.02	0.001	0.017	0.010	7.21	0.01	33	0.4	113	3	0.02	0.001	0.0001	0.001	0.001	0.002	0.001	0.001	0.005	0.05	0.0001	
	Oct-24	0.001	0.2	0.03	0.001	0.005	0.010	0.02	0.01	31	0.2	39	2	0.08	0.001	0.0001	0.001	0.001	0.004	0.005	0.001	0.005	0.12	0.0001	
	Nov-24	0.001	0.1	0.01	0.001	0.005	0.010	0.01	0.01	36	0.1	58	1	0.02	0.001	0.0001	0.001	0.001	0.003	0.001	0.001	0.005	0.05	0.0001	
	Dec-24	0.001	0.1	0.01	0.001	0.005	0.010	0.01	0.01	33	0.1	51	2	0.08	0.001	0.0001	0.001	0.001	0.006	0.001	0.001	0.005	0.09	0.0001	
	Jan-25	0.001	0.2	0.01	0.001	0.005	0.010	0.01	0.01	51	0.2	82	1	0.04	0.001	0.0001	0.001	0.001	0.015	0.001	0.001	0.005	0.07	0.0001	
	Feb-25	0.001	0.2	0.02	0.001	0.005	0.040	0.01	0.01	57	0.2	68	1	0.14	0.001	0.0001	0.001	0.001	0.010	0.001	0.001	0.005	0.14	0.0001	
	Mar-25	0.001	0.1	0.03	0.001	0.005	0.020	0.01	0.01	70	0.1	85	1	0.01	0.001	0.0001	0.001	0.001	0.007	0.001	0.001	0.005	0.05	0.0001	
	Apr-25	0.001	0.1	0.03	0.001	0.005	0.030	0.01	0.01	75	0.1	87	1	0.01	0.001	0.0001	0.001	0.001	0.006	0.001	0.001	0.005	0.06	0.0001	
	May-25	0.001	0.1	0.02	0.001	0.005	0.010	0.1	0.01	77	0.1	88	1	0.01	0.001	0.0001	0.001	0.001	0.006	0.001	0.001	0.005	0.05	0.0001	
	Jun-25	0.001	0.3	0.02	0.001	0.005	0.020	0.03	0.01	51	0.3	89	1	0.12	0.001	0.0001	0.001	0.001	0.016	0.001	0.001	0.005	0.19	0.0001	
	Jul-25	0.001	0.3	0.04	0.001	0.005	0.300	0.3	0.01	19	0.3	35	7	0.14	0.001	0.0001	0.001	0.001	0.01	0.001	0.001	0.005	0.13	0.0001	
	Aug-25	0.001	0.2	0.01	0.001	0.01	0.020	0.2	0.01	26	0.2	28	1	0.06	0.001	0.0001	0.001	0.001	0.005	0.001	0.001	0.012	0.05	0.0001	
	Sep-25	0.001	0.1	0.04	0.001	0.006	0.030	0.01	0.01	23	0.1	44	1	0.08	0.001	0.0001	0.001	0.004	0.005	0.001	0.001	0.006	0.07	0.0001	
	Oct-25	0.001	0.1	0.02	0.001	0.005	0.010	0.01	0.01	31	0.1	46	1	0.04	0.001	0.000									

Parameter	Sheen/ oil/ grease	Temp. (°C)	Dissolved Oxygen (DO %)	DO (ppm)	Specific EC (SPC uS/cm)	EC (uS/cm)	pH	Redox (mV)	Turbidity (NTU)	Dissolved Al (mg/L)	Dissolved As (mg/L)	Dissolved Cd (mg/L)	Dissolved Cr (mg/L)	Dissolved Cu (mg/L)	Cyanide (mg/L)	Dissolved Fe (mg/L)	Dissolved Pb (mg/L)	Dissolved Mn (mg/L)	Dissolved Hg (mg/L)	
YARRANGOBILLY CATCHMENT																				
Default Guideline Value (DGV)		No	-	90-110	-	30-350	30-350	6.5-8	-	2-25	0.027	0.0008	0.0006	0.00001	0.001	0.004	0.3	0.001	1.2	0.00006
Limit of Reporting (LOR)										0.1	0.01	0.001	0.0001	0.001	0.001	0.002	0.05	0.001	0.001	0.0001
Dec - May Site Specific Guideline Value (SSGV)				96.2	9.08	115	93.2	7.85	79.1	0.37	0.03	0.0003	0.00002	0.00001	0.0002	0.03	0.001	0.002	0.00003	
June - Nov SSGV				89.7	10.28	88	60.85	7.62	98.4	5.12	0.04	0.0003	0.00002	0.00001	0.0002	0.02	0.001	0.002	0.00003	
CG-IS	Mar-24	No Flow	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-
	Apr-24	No Flow	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-
	May-24	No Flow	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-
	Jun-24	No Flow	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-
	Jul-24	No Flow	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-
	Aug-24	No Flow	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-
	Sep-24	No Flow	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-
	Oct-24	No	12.7	93.2	-	362.6	-	8.17	-	1	0.01	0.001	0.0001	0.001	0.001	0.002	0.05	0.001	0.001	0.0001
	Nov-24	No Flow	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-
	Dec-24	No	14	88.5	9.7	29	480	8.12	255	2.84	0.01	0.001	0.0001	0.001	0.001	0.002	0.05	0.001	0.001	0.0001
	Jan-25	No Flow	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-
	Feb-25	No Flow	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-
	Mar-25	No Flow	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-
	Apr-25	No Flow	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-
	May-25	No Flow	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-
	Jun-25	No Flow	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-
	Jul-25	No	10.7	85.1	-	13.1	80.9	9.30	179	2.6	0.03	0.001	0.0001	0.001	0.001	0.002	0.05	0.001	0.004	0.0001
	Aug-25	No Flow	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-
	Sep-25	No	12.1	96.6	-	483	364.4	8.00	175.1	1.63	0.01	0.001	0.0001	0.001	0.001	0.002	0.05	0.001	0.001	0.0001
	Oct-25	No	14.4	95.8	-	582	464.4	7.84	124.5	0.24	0.01	0.001	0.0001	0.001	0.001	0.002	0.05	0.001	0.001	0.0001
	Nov-25	No Flow	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-
	Dec-25	No Flow	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-
	Jan-26	No Flow	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-
	Feb-26	No Flow	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-
YR1-IS	Mar-24	No	12.2	88.2	9.47	129.4	97.7	7.81	53.8	0.1	0.05	0.00015	0.00001	0.000005	0.002	0.001	0.03	0.0005	0.002	0.000015
	Apr-24	No	11.3	97.4	-	136.1	-	8.49	-	1.23	0.01	0.001	0.0001	0.001	0.001	0.002	0.05	0.001	0.002	0.0001
	May-24	No	3.1	95.6	-	138.8	-	7.91	-	0.42	0.01	0.001	0.0001	0.001	0.001	0.004	0.05	0.001	0.002	0.0001
	Jun-24	No	5.6	94.3	-	112.4	-	7.80	-	1.94	0.02	0.001	0.0001	0.001	0.001	0.002	0.14	0.001	0.003	0.0001
	Jul-24	No	6.4	93.0	-	51.5	-	6.93	-	10.05	0.16	0.001	0.0001	0.001	0.001	0.002	0.11	0.001	0.002	0.0001
	Aug-24	No	8.6	89.8	-	55.8	-	7.87	-	3.62	0.07	0.001	0.0001	0.001	0.001	0.002	0.05	0.001	0.001	0.0001
	Sep-24	No	13.3	93.1	-	61.4	-	7.77	-	0.79	0.04	0.001	0.0001	0.001	0.001	0.002	0.05	0.001	0.002	0.0001
	Oct-24	No	12.5	94.9	-	66.8	-	7.77	-	2	0.04	0.001	0.0001	0.001	0.001	0.002	0.05	0.001	0.001	0.0001
	Nov-24	No	15	92.2	9.7	105	105	7.69	251	0.8	0.01	0.001	0.0001	0.001	0.001	0.002	0.05	0.001	0.020	0.0001
	Dec-24	No	14.3	91.1	9.9	40.4	69	7.52	253	3.94	0.1	0.001	0.0001	0.001	0.001	0.002	0.06	0.001	0.001	0.0001
	Jan-25	No	19.5	86.6	9	19.2	110	8.01	235	14.18	0.04	0.001	0.0001	0.001	0.001	0.002	0.05	0.001	0.003	0.0001
	Feb-25	No	17.2	86.3	9.3	21.8	101	7.78	168	4.35	0.14	0.001	0.0001	0.001	0.001	0.002	0.13	0.001	0.005	0.0001
	Mar-25	No	19.5	101.4	9.6	39.3	178	8.46	175	1.16	0.01	0.001	0.0001	0.001	0.001	0.002	0.05	0.001	0.002	0.0001
	Apr-25	Yes	18.7	91.6	10.4	36.3	171	8.76	195	0.98	0.01	0.001	0.0001	0.001	0.001	0.002	0.05	0.001	0.006	0.0001
	May-25	Yes	10.3	95.1	-	35.1	25.2	8.84	110.9	1.29	0.01	0.001	0.0001	0.001	0.001	0.002	0.05	0.001	0.002	0.0001
	Jun-25	No	5.9	89.8	-	18.2	11.5	8.66	122.1	11.92	0.14	0.001	0.0001	0.001	0.001	0.002	0.12	0.001	0.003	0.0001
	Jul-25	No	9.3	88.8	-	15.3	10.7	8.60	207.5	7.02	0.12	0.001	0.0001	0.001	0.001	0.002	0.06	0.001	0.001	0.0001
	Aug-25	No	15.6	101.0	-	42.9	35.2	7.80	290	4.21	0.04	0.001	0.0001	0.001	0.001	0.002	0.05	0.001	0.002	0.0001
	Sep-25	No	8.6	96.6	-	85.1	58.4	8.30	166.5	1	0.7	0.001	0.0001	0.001	0.001	0.002	0.05	0.001	0.002	0.0001
	Oct-25	No	9.6	91.8	-	108.4	76.4	7.66	94.9	1.3	0.06	0.001	0.0001	0.001	0.001	0.002	0.05	0.001	0.002	0.0001
	Nov-25	No	16	76.6	-	111.9	92.6	7.93	139.7	1.75	0.02	0.001	0.0001	0.001	0.004	0.002	0.05	0.001	0.002	0.0001
	Dec-25	No	20.1	81.9	-	124.8	113.2	8.28	134.6	31.04	0.02	0.001	0.0001	0.001	0.001	0.002	0.05	0.001	0.002	0.0001
	Jan-26	No	23.7	87.8	-	169.5	165.4	8.17	127.1	0.9	0.01	0.001	0.0001	0.001	0.001	0.002	0.05	0.001	0.008	0.0001
	Feb-26	No	22.6	93.4	-	204.1	194.6	8.19	138.5	1.37	0.01	0.001	0.0001	0.001	0.001	0.002	0.05	0.001	0.01	0.0001

Reference Site exceeds SSGV
 Impact Site Result exceeds SSGV or DGV
italics Result exceeds the Limit of Reporting

Parameter	Dissolved Ni (mg/L)	TN (mg/L)	TP (mg/L)	Dissolved Ag (mg/L)	Dissolved Zn (mg/L)	Ammonia (mg/L)	Nitrogen Oxides (mg/L)	Reactive Phosphorus (mg/L)	Total Hardness (mg/L) (CaCO3)	Total Kjedaahl Nitrogen (mg/L) (TKN)	TDS (mg/L)	TSS (mg/L)	Total Al (mg/L)	Total As (mg/L)	Total Cd (mg/L)	Total Cr (mg/L)	Total Cu (mg/L)	Total Pb (mg/L)	Total Mn (mg/L)	Total Ni (mg/L)	Total Ag (mg/L)	Total Zn (mg/L)	Total Fe (mg/L)	Total Hg (mg/L)	
YARRANGOBILLY CATCHMENT																									
Default Guideline Value (DGV)	0.008	0.25	0.02	0.00002	0.0024	0.013	0.015	0.015	-	-	-	0.2	0.027	0.0008	0.0006	0.00001	0.001	0.001	1.2	0.008	0.00002	0.0024	0.3	0.00006	
Limit of Reporting (LOR)	0.001	0.1	0.01	0.001	0.005	0.010	0.010	0.010	1	0.1	10	1	0.01	0.001	0.0001	0.001	0.001	0.001	0.001	0.001	0.001	0.005	0.05	0.0001	
Dec - May Site Specific Guideline Value (SSGV)	0.001	0.2	0.02	0.00002	0.002	0.013	0.015	0.020	47	0.2	52	0.2													
June - Nov SSGV	0.001	0.2	0.02	0.00002	0.002	0.013	0.015	0.015	30	0.2	39	1.0													
CG-IS																									
Mar-24	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	
Apr-24	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	
May-24	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	
Jun-24	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	
Jul-24	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	
Aug-24	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	
Sep-24	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	
Oct-24	0.001	0.1	0.02	0.001	0.005	0.010	0.01	0.01	294	0.1	298	1	0.01	0.001	0.0001	0.001	0.001	0.001	0.001	0.001	0.001	0.005	0.05	0.0001	
Nov-24	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	
Dec-24	0.001	0.1	0.01	0.001	0.005	0.010	0.02	0.01	287	0.1	336	1	0.01	0.001	0.0001	0.001	0.001	0.001	0.001	0.001	0.001	0.005	0.05	0.0001	
Jan-25	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	
Feb-25	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	
Mar-25	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	
Apr-25	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	
May-25	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	
Jun-25	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	
Jul-25	0.001	0.1	0.02	0.001	0.005	0.040	0.07	0.01	290	0.1	347	1	0.03	0.001	0.0001	0.001	0.001	0.001	0.001	0.004	0.001	0.005	0.05	0.0001	
Aug-25	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	
Sep-25	0.001	0.2	0.01	0.001	0.005	0.010	0.01	0.01	249	0.2	312	1	0.01	0.001	0.0001	0.001	0.001	0.001	0.001	0.001	0.001	0.005	0.05	0.0001	
Oct-25	0.001	0.1	0.01	0.001	0.005	0.010	0.01	0.01	272	0.1	312	1	0.01	0.001	0.0001	0.001	0.001	0.001	0.001	0.002	0.001	0.001	0.005	0.05	0.0001
Nov-25	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	
Dec-25	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	
Jan-26	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	
Feb-26	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	
YR1-IS																									
Mar-24	0.001	0.1	0.005	0.00001	0.001	0.050	0.05	0.005	34	0.1	68	0.1													
Apr-24	0.001	0.1	0.01	0.001	0.005	0.010	0.05		61	0.05		1	0.01	0.001	0.0001	0.001	0.001	0.001	0.002	0.001	0.001	0.005	0.05	0.0001	
May-24	0.001	0.1	0.02	0.001	0.005	0.010	0.01	0.01	68	0.1	95	5	0.01	0.001	0.0001	0.001	0.001	0.001	0.001	0.001	0.001	0.005	0.05	0.0001	
Jun-24	0.001	0.1	0.01	0.001	0.005	0.010	0.01	0.03	51	0.1	68	1	0.03	0.001	0.0001	0.001	0.001	0.001	0.001	0.001	0.001	0.005	0.05	0.0001	
Jul-24	0.001	0.2	0.02	0.001	0.005	0.010	0.01	0.01	19	0.2	48	7	0.17	0.001	0.0001	0.001	0.001	0.001	0.009	0.001	0.001	0.005	0.15	0.0001	
Aug-24	0.001	0.2	0.01	0.001	0.005	0.010	0.01	0.01	33	0.2	55	3	0.12	0.001	0.0001	0.001	0.001	0.001	0.004	0.001	0.001	0.005	0.09	0.0001	
Sep-24	0.001	0.1	0.04	0.001	0.005	0.010	0.02	0.01	38	0.1	68	2	0.06	0.001	0.0001	0.001	0.001	0.001	0.003	0.001	0.001	0.005	0.05	0.0001	
Oct-24	0.001	0.1	0.02	0.001	0.006	0.020	0.01	0.01	41	0.1	60	2	0.08	0.001	0.0001	0.001	0.001	0.001	0.001	0.001	0.001	0.005	0.09	0.0001	
Nov-24	0.001	0.1	0.01	0.001	0.005	0.010	0.01	0.01	48	0.1	74	1	0.04	0.001	0.0001	0.001	0.001	0.001	0.003	0.001	0.001	0.005	0.05	0.0001	
Dec-24	0.001	0.1	0.01	0.001	0.005	0.010	0.02	0.01	31	0.1	52	4	0.17	0.001	0.0001	0.001	0.001	0.001	0.006	0.001	0.001	0.039	0.15	0.0001	
Jan-25	0.001	0.6	0.05	0.001	0.005	0.080	0.05	0.01	56	0.6	81	47	0.27	0.001	0.0001	0.001	0.001	0.001	0.051	0.001	0.001	0.009	0.33	0.0001	
Feb-25	0.001	0.2	0.03	0.001	0.005	0.040	0.02	0.01	46	0.2	51	4	0.15	0.001	0.0001	0.001	0.001	0.001	0.01	0.001	0.001	0.015	0.16	0.0001	
Mar-25	0.001	0.1	0.01	0.001	0.005	0.030	0.01	0.01	90	0.1	100	1	0.01	0.001	0.0001	0.001	0.001	0.001	0.003	0.001	0.001	0.005	0.05	0.0001	
Apr-25	0.001	0.2	0.02	0.001	0.005	0.040	0.01	0.01	87	0.2	100	1	0.01	0.001	0.0001	0.001	0.001	0.001	0.006	0.001	0.001	0.005	0.05	0.0001	
May-25	0.001	0.1	0.01	0.001	0.005	0.020	0.01	0.01	82	0.1	96	1	0.01	0.001	0.0001	0.001	0.001	0.001	0.002	0.001	0.001	0.005	0.05	0.0001	
Jun-25	0.001	0.3	0.02	0.001	0.008	0.020	0.02	0.01	36	0.3	83	7	0.71	0.001	0.0001	0.002	0.001	0.001	0.014	0.002	0.001	0.01	0.56	0.0001	
Jul-25	0.001	0.1	0.02	0.001	0.005	0.010	0.02	0.01	24	0.1	44	2	0.15	0.001	0.0001	0.001	0.001	0.001	0.005	0.001	0.001	0.005	0.2	0.0001	
Aug-25	0.001	0.2	0.03	0.001	0.005	0.010	0.2	0.01	41	0.1	53	1	0.07	0.001	0.0001	0.001	0.001	0.001	0.003	0.001	0.001	0.005	0.05	0.0001	
Sep-25	0.001	0.2	0.04	0.001	0.005	0.010	0.01	0.01	29	0.1	56	1	0.12	0.001	0.0001	0.001	0.001	0.001	0.004	0.001	0.001	0.005	0.08	0.0001	
Oct-25	0.001	0.1	0.01	0.001	0.005	0.040	0.01	0.01	41	0.1	63	1	0.12	0.001	0.0001	0.001	0.001	0.001	0.004	0.001	0.001	0.005	0.09	0.0001	
Nov-25	0.001	0.2	0.01	0.001	0.012	0.010	0.2	0.01	51	0.2	67	2	0.05	0.001	0.0001	0.001	0.014	0.001	0.01	0.001	0.001	0.013	0.14	0.0001	
Dec-25	0.001	0.2	0.01	0.001	0.005	0.060	0.01	0.01	48	0.2	110	1	0.03	0.001	0.0001	0.001	0.001	0.001	0.003	0.001	0.001	0.005	0.05	0.0001	
Jan-26	0.001	0.1	0.02	0.001	0.018	0.020	0.02	0.01	75	0.1	125	1	0.02	0.001	0.0001	0.001	0.001	0.001	0.008	0.001	0.001	0.015	0.06	0.0001	
Feb-26	0.001	0.3	0.02	0.001	0.01	0.070	0.01	0.01	99	0.3	116	1	0.01	0.001	0.0001	0.001	0.001	0.001	0.011	0.001	0.001	0.011	0.05	0.0001	

Reference Site exceeds SSGV |
Impact Site Result exceeds SSGV or DGV |
italics | Result exceeds the Limit of Reporting

Parameter	Sheen/ oil/ grease	Temp. (°C)	Dissolved Oxygen (DO %)	DO (ppm)	Specific EC (SPC uS/cm)	EC (uS/cm)	pH	Redox (mV)	Turbidity (NTU)	Dissolved Al (mg/L)	Dissolved As (mg/L)	Dissolved Cd (mg/L)	Dissolved Cr (mg/L)	Dissolved Cu (mg/L)	Cyanide (mg/L)	Dissolved Fe (mg/L)	Dissolved Pb (mg/L)	Dissolved Mn (mg/L)	Dissolved Hg (mg/L)	
YARRANGOBILLY CATCHMENT																				
Default Guideline Value (DGV)	No	-	90-110	-	30-350	30-350	6.5-8	-	2-25	0.027	0.0008	0.0006	0.00001	0.001	0.004	0.3	0.001	1.2	0.00006	
Limit of Reporting (LOR)									0.1	0.01	0.001	0.0001	0.001	0.001	0.002	0.05	0.001	0.001	0.0001	
Dec - May Site Specific Guideline Value (SSGV)			96.2	9.08	115	93.2	7.85	79.1	0.37	0.03	0.0003	0.00002	0.00001	0.0002	0.002	0.03	0.001	0.002	0.00003	
June - Nov SSGV			89.7	10.28	88	60.85	7.62	98.4	5.12	0.04	0.0003	0.00002	0.00001	0.0002	0.002	0.02	0.001	0.002	0.00003	
LHG-IS	Mar-24	Yes	11.9	59.2	6.38	596	447.2	7.35	-17.2	408.5	0.2	0.00015	0.00001	0.001	0.003	0.001	0.18	0.005	0.040	0.000015
	Apr-24	No	12.5	60.1	-	658	-	7.69	-	69.72	0.01	0.001	0.0001	0.001	0.001	0.02	0.34	0.001	0.184	0.0001
	May-24	No	7	63.3	-	618	-	7.00	-	1003.7	0.01	0.001	0.0001	0.001	0.001	0.004	0.71	0.001	0.184	0.0001
	Jun-24	No	8.5	70.4	-	616	-	7.65	-	10.05	0.01	0.001	0.0001	0.001	0.001	0.002	0.48	0.001	0.158	0.0001
	Jul-24	No	8	87.5	-	503	-	7.30	-	5.44	0.01	0.001	0.0001	0.001	0.001	0.002	0.07	0.001	0.025	0.0001
	Aug-24	No	11.4	83.0	-	408.8	-	7.74	-	76.59	0.01	0.001	0.0001	0.001	0.001	0.002	0.07	0.001	0.020	0.0001
	Sep-24	No	9.7	87.3	-	424.6	-	7.68	-	6.13	0.01	0.001	0.0001	0.001	0.001	0.002	0.06	0.001	0.045	0.0001
	Oct-24	No	12.4	86.5	-	432.4	-	7.59	-	2.2	0.01	0.001	0.0001	0.001	0.001	0.002	0.10	0.001	0.036	0.0001
	Nov-24	No	12.1	83.1	9.9	537	537	7.91	254	3.6	0.01	0.001	0.0001	0.001	0.001	0.002	0.05	0.001	0.002	0.0001
	Dec-24	No	17.6	87.4	9.4	278.1	473	8.24	252	6.7	0.01	0.001	0.0001	0.001	0.001	0.002	0.05	0.001	0.005	0.0001
	Jan-25	Yes	17.8	76.9	9.1	128.7	563	8.05	198	14.89	0.01	0.001	0.0001	0.001	0.001	0.002	0.07	0.001	0.041	0.0001
	Feb-25	Yes	18.6	79.2	9.3	136.1	591	7.80	187	7.23	0.01	0.001	0.0001	0.001	0.001	0.002	0.06	0.001	0.105	0.0001
	Mar-25	Yes	22	59.6	8.7	134.7	610	7.62	173	9.64	0.08	0.004	0.0001	0.001	0.015	0.002	2.51	0.001	0.597	0.0001
	Apr-25	Yes	17.9	54.1	8.9	131	645	7.52	207	50.12	0.01	0.003	0.0001	0.001	0.001	0.002	1.38	0.001	0.997	0.0001
	May-25	Yes	11.2	37.1	-	134	-	7.47	-	71.43	0.01	0.003	0.0001	0.001	0.001	0.002	1.9	0.001	0.736	0.0001
	Jun-25	No	9	68.5	-	136.5	94.9	7.25	112.7	1.32	0.01	0.001	0.0001	0.001	0.001	0.002	0.75	0.001	0.261	0.0001
	Jul-25	No	8.1	83.7	-	78.3	53.1	9.10	185.7	36.35	0.09	0.001	0.0001	0.001	0.001	0.002	0.07	0.001	0.001	0.0001
	Aug-25	No	14.8	96.7	-	67.2	54.1	7.80	287.5	6.39	0.01	0.001	0.0001	0.001	0.001	0.001	0.005	0.001	0.009	0.001
	Sep-25	No	9.6	91.9	-	527	372	8.00	174.7	6.43	0.01	0.001	0.0001	0.001	0.001	0.002	0.005	0.001	0.006	0.0001
	Oct-25	No	17.2	96.2	-	674	57	7.86	125.1	2.62	0.01	0.001	0.0001	0.001	0.001	0.002	0.5	0.001	0.011	0.0001
	Nov-25	No flow	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-
	Dec-25	No	21.6	72.3	-	61.9	57.9	7.72	117	5.58	0.01	0.001	0.0001	0.001	0.001	0.002	0.16	0.001	0.113	0.0001
	Jan-26	No flow	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-
	Feb-26	No flow	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-
YR2-IS	Mar-24	No	12.3	88.5	9.47	130.8	99.1	7.93	43.2	0.1	0.03	0.00015	0.00001	0.000005	0.001	0.001	0.02	0.005	0.001	0.000015
	Apr-24	No	11.8	97.1	-	139.7	-	8.52	-	1.16	0.01	0.001	0.0001	0.001	0.001	0.002	0.05	0.001	0.003	0.0001
	May-24	No	2.5	94.7	-	142.1	-	7.77	-	0.343	0.01	0.001	0.0001	0.001	0.001	0.024	0.05	0.001	0.004	0.0001
	Jun-24	No	4.7	97.1	-	118.6	-	7.24	-	0	0.02	0.001	0.0001	0.001	0.001	0.002	0.05	0.001	0.003	0.0001
	Jul-24	No	5.9	93.5	-	58.4	-	6.78	-	8.87	0.17	0.001	0.0001	0.001	0.001	0.002	0.12	0.001	0.002	0.0001
	Aug-24	No	9.3	93.5	-	58.5	-	7.98	-	6.97	0.06	0.001	0.0001	0.001	0.001	0.002	0.05	0.001	0.002	0.0001
	Sep-24	No	13.4	93.8	-	66.7	-	7.62	-	1.56	0.04	0.001	0.0001	0.001	0.001	0.002	0.05	0.001	0.005	0.0001
	Oct-24	No	11.6	93.7	-	69.9	-	7.34	-	1.8	0.03	0.001	0.0001	0.001	0.001	0.002	0.05	0.001	0.002	0.0001
	Nov-24	No	15.7	92.1	10	62	111	7.92	235	0.6	0.01	0.001	0.0001	0.001	0.001	0.002	0.05	0.001	0.002	0.0001
	Dec-24	No	13.6	90.3	9.8	44.1	75	7.84	220	5.84	0.09	0.001	0.0001	0.001	0.001	0.002	0.06	0.001	0.001	0.0001
	Jan-25	No	28.9	90.5	8.8	28.5	123	8.09	226	1.32	0.01	0.001	0.0001	0.001	0.001	0.002	0.05	0.001	0.004	0.0001
	Feb-25	No	19.3	91.3	9.4	23.3	109	7.97	170	5.89	0.11	0.001	0.0001	0.001	0.001	0.002	0.11	0.001	0.005	0.0001
	Mar-25	No	22.2	102.1	9.5	39.9	182	8.55	158	0.89	0.01	0.001	0.0001	0.001	0.001	0.002	0.05	0.001	0.003	0.0001
	Apr-25	No	18.1	95.3	10.5	37.7	178	8.46	195	0.94	0.01	0.001	0.0001	0.001	0.001	0.002	0.05	0.001	0.003	0.0001
	May-25	No	10.8	96.8	-	35.7	26	8.87	110.1	1.27	0.01	0.001	0.0001	0.001	0.001	0.002	0.05	0.001	0.001	0.0001
	Jun-25	No	5.9	89.8	-	18.2	12.6	8.66	112.7	11.92	0.26	0.001	0.0001	0.001	0.002	0.02	0.18	0.001	0.004	0.0001
	Jul-25	No	8.1	86.0	-	11.2	7.6	9.10	191.5	11.35	0.07	0.001	0.0001	0.001	0.001	0.002	0.05	0.001	0.002	0.0001
	Aug-25	No	12.1	97.7	-	15.4	11.6	7.60	294	6.18	0.8	0.001	0.0001	0.001	0.001	0.002	0.05	0.001	0.01	0.0001
	Sep-25	No	5.6	94.6	-	64.7	40.8	8.10	177.7	2	0.03	0.001	0.0001	0.001	0.001	0.002	0.05	0.001	0.003	0.0001
	Oct-25	No	14.3	100.2	-	102.2	81.1	7.78	112.6	1.44	0.05	0.001	0.0001	0.001	0.001	0.002	0.05	0.001	0.001	0.0001
	Nov-25	No	16.9	79.5	-	116.1	98.1	7.79	168.2	0.63	0.02	0.001	0.0001	0.001	0.011	0.002	0.05	0.001	0.002	0.0001
	Dec-25	No	18.2	81.4	-	109.7	95.5	8.13	131.5	4.83	0.1	0.001	0.0001	0.001	0.001	0.002	0.06	0.001	0.005	0.0001
	Jan-26	No	24.2	91.8	-	256.4	252.6	8.29	114.4	6.37	0.01	0.001	0.0001	0.001	0.001	0.002	0.05	0.001	0.004	0.0001
	Feb-26	No	24.7	95.1	-	205.5	204.2	8.29	134.0	1.37	0.01	0.001	0.0001	0.001	0.001	0.002	0.05	0.001	0.004	0.0001

Reference Site exceeds SSGV
Impact Site Result exceeds SSGV or DGV
italics Result exceeds the Limit of Reporting

Parameter	Dissolved Ni (mg/L)	TN (mg/L)	TP (mg/L)	Dissolved Ag (mg/L)	Dissolved Zn (mg/L)	Ammonia (mg/L)	Nitrogen Oxides (mg/L)	Reactive Phosphorus (mg/L)	Total Hardness (mg/L) (CaCO3)	Total Kjeldahl Nitrogen (mg/L) (TKN)	TDS (mg/L)	TSS (mg/L)	Total Al (mg/L)	Total As (mg/L)	Total Cd (mg/L)	Total Cr (mg/L)	Total Cu (mg/L)	Total Pb (mg/L)	Total Mn (mg/L)	Total Ni (mg/L)	Total Ag (mg/L)	Total Zn (mg/L)	Total Fe (mg/L)	Total Hg (mg/L)	
YARRANGOBILLY CATCHMENT																									
Default Guideline Value (DGV)	0.008	0.25	0.02	0.00002	0.0024	0.013	0.015	0.015	-	-	-	0.2	0.027	0.0008	0.0006	0.00001	0.001	0.001	1.2	0.008	0.00002	0.0024	0.3	0.00006	
Limit of Reporting (LOR)	0.001	0.1	0.01	0.001	0.005	0.010	0.010	0.010	1	0.1	10	1	0.01	0.001	0.0001	0.001	0.001	0.001	0.001	0.001	0.001	0.005	0.05	0.0001	
Dec - May Site Specific Guideline Value (SSGV)	0.001	0.2	0.02	0.00002	0.002	0.013	0.015	0.020	47	0.2	52	0.2													
June - Nov SSGV	0.001	0.2	0.02	0.00002	0.002	0.013	0.015	0.015	30	0.2	39	1.0													
LHG-IS																									
Mar-24	0.003	0.1	0.01	0.00001	0.006	0.050	0.05	0.005	297	1	330	20													
Apr-24	0.001	0.5	0.09	0.001	0.005	0.020	0.02	-	332	0.02	-	70	0.25	0.003	0.0001	0.001	0.002	0.001	0.51	0.006	0.001	0.009	2.22	0.0001	
May-24	0.001	0.5	0.05	0.001	0.005	0.040	0.06	0.01	365	0.4	402	5	0.07	0.001	0.0001	0.001	0.001	0.001	0.177	0.001	0.001	0.005	1.09	0.0001	
Jun-24	0.001	0.2	0.04	0.001	0.005	0.020	0.02	0.01	313	0.2	339	17	0.38	0.002	0.0001	0.001	0.001	0.001	0.282	0.001	0.001	0.005	1.54	0.0001	
Jul-24	0.001	0.1	0.01	0.001	0.005	0.010	0.01	0.01	250	0.1	324	10	0.53	0.001	0.0001	0.001	0.002	0.001	0.033	0.001	0.001	0.005	0.16	0.0001	
Aug-24	0.001	0.1	0.01	0.001	0.006	0.020	0.01	0.01	282	0.1	360	9	0.09	0.001	0.0001	0.001	0.001	0.001	0.026	0.001	0.001	0.005	0.17	0.0001	
Sep-24	0.001	0.2	0.09	0.001	0.006	0.010	0.01	0.01	294	0.06	394	10	0.06	0.001	0.0001	0.001	0.001	0.001	0.051	0.001	0.001	0.005	0.19	0.0001	
Oct-24	0.001	0.1	0.02	0.001	0.005	0.020	0.01	0.01	312	0.1	362	3	0.04	0.001	0.0001	0.001	0.001	0.001	0.034	0.001	0.001	0.005	0.26	0.0001	
Nov-24	0.001	0.1	0.01	0.001	0.005	0.100	0.01	0.01	307	0.1	363	16	0.15	0.001	0.0001	0.001	0.001	0.001	0.023	0.001	0.001	0.005	0.21	0.0001	
Dec-24	0.001	0.1	0.02	0.001	0.005	0.010	0.01	0.01	264	0.1	298	7	0.13	0.001	0.0001	0.001	0.001	0.001	0.014	0.001	0.001	0.005	0.12	0.0001	
Jan-25	0.001	0.1	0.04	0.001	0.005	0.030	0.01	0.01	333	0.1	362	33	0.26	0.002	0.0001	0.001	0.001	0.001	0.219	0.001	0.001	0.005	1.13	0.0001	
Feb-25	0.001	0.3	0.06	0.001	0.005	0.010	0.06	0.01	333	0.2	378	11	0.09	0.001	0.0001	0.001	0.001	0.001	0.121	0.001	0.001	0.007	0.41	0.0001	
Mar-25	0.001	0.3	0.1	0.001	0.005	0.070	0.04	0.01	326	0.3	372	50	0.1	0.001	0.0001	0.001	0.01	0.559	0.001	0.001	0.006	4.16	0.0001		
Apr-25	0.001	0.4	0.16	0.001	0.006	0.030	0.01	0.01	348	0.4	372	64	0.55	0.01	0.0001	0.001	0.002	0.001	1.17	0.001	0.001	0.008	8.45	0.0001	
May-25	0.001	0.2	0.44	0.001	0.005	0.040	0.03	0.01	333	0.2	406	131	0.61	0.019	0.0001	0.001	0.001	0.002	2.22	0.002	0.001	0.009	19.2	0.0001	
Jun-25	0.001	0.2	0.02	0.001	0.006	0.030	0.01	0.01	333	0.2	452	9	0.22	0.001	0.0001	0.001	0.001	0.001	0.281	0.001	0.001	0.005	1.32	0.0001	
Jul-25	0.001	0.2	0.04	0.001	0.005	0.020	0.03	0.01	177	0.2	247	68	0.46	0.001	0.0001	0.001	0.001	0.001	0.134	0.001	0.001	0.005	1.04	0.0001	
Aug-25	0.001	0.1	0.01	0.001	0.005	0.020	0.1	0.01	277	0.1	346	12	0.05	0.001	0.0001	0.001	0.001	0.001	0.014	0.001	0.001	0.005	0.09	0.0001	
Sep-25	0.001	0.1	0.04	0.001	0.005	0.030	0.01	0.01	265	0.1	350	1	0.08	0.001	0.0001	0.001	0.001	0.001	0.008	0.001	0.001	0.005	0.07	0.0001	
Oct-25	0.001	0.1	0.01	0.001	0.005	0.010	0.01	0.01	264	0.1	344	2	0.05	0.001	0.0001	0.001	0.001	0.001	0.016	0.001	0.001	0.006	0.1	0.0001	
Nov-25	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	
Dec-25	0.001	0.2	0.03	0.001	0.005	0.040	0.01	0.01	267	0.2	470	14	0.1	0.001	0.0001	0.001	0.001	0.001	0.11	0.001	0.001	0.005	0.38	0.0001	
Jan-26	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	
Feb-26	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	
YR2-IS																									
Mar-24	0.001	0.1	0.005	0.00001	0.001	0.050	0.05	0.005	27	1	58	0.1													
Apr-24	0.001	0.1	0.01	0.001	0.005	0.010	0.01	-	61	0.01	-	5	0.02	0.001	0.0001	0.001	0.001	0.001	0.004	0.001	0.001	0.005	0.05	0.0001	
May-24	0.001	0.8	0.03	0.001	0.007	0.020	0.34	0.01	68	0.5	98	5	0.01	0.001	0.0001	0.001	0.001	0.001	0.002	0.001	0.001	0.007	0.05	0.0001	
Jun-24	0.001	0.1	0.01	0.001	0.005	0.010	0.01	0.01	51	0.1	76	1	0.03	0.001	0.0001	0.001	0.001	0.001	0.002	0.001	0.001	0.005	0.05	0.0001	
Jul-24	0.001	0.4	0.03	0.001	0.005	0.010	0.24	0.01	26	0.2	46	10	0.17	0.001	0.0001	0.001	0.001	0.001	0.012	0.001	0.001	0.007	0.16	0.0001	
Aug-24	0.001	0.1	0.01	0.001	0.005	0.010	0.01	0.01	33	0.1	59	4	0.11	0.001	0.0001	0.001	0.001	0.001	0.005	0.001	0.001	0.005	0.09	0.0001	
Sep-24	0.001	0.1	0.02	0.001	0.005	0.010	0.01	0.01	46	0.1	68	3	0.07	0.001	0.0001	0.001	0.001	0.001	0.006	0.001	0.001	0.005	0.07	0.0001	
Oct-24	0.001	0.2	0.05	0.001	0.005	0.010	0.01	0.01	43	0.2	71	1	0.07	0.001	0.0001	0.001	0.001	0.001	0.002	0.001	0.001	0.005	0.08	0.0001	
Nov-24	0.001	0.1	0.05	0.001	0.005	0.010	0.02	0.01	51	0.1	77	1	0.04	0.001	0.0001	0.001	0.001	0.001	0.005	0.001	0.001	0.005	0.05	0.0001	
Dec-24	0.001	0.1	0.01	0.001	0.005	0.020	0.08	0.01	33	0.1	55	6	0.21	0.001	0.0001	0.001	0.001	0.001	0.007	0.001	0.001	0.005	0.18	0.0001	
Jan-25	0.001	0.2	0.01	0.001	0.005	0.010	0.01	0.01	63	0.2	87	1	0.2	0.001	0.0001	0.001	0.001	0.001	0.004	0.001	0.001	0.005	0.05	0.0001	
Feb-25	0.001	0.4	0.02	0.001	0.005	0.020	0.05	0.01	48	0.3	72	5	0.2	0.001	0.0001	0.001	0.001	0.001	0.01	0.001	0.001	0.005	0.21	0.0001	
Mar-25	0.001	0.1	0.01	0.001	0.005	0.010	0.01	0.01	90	0.1	104	1	0.01	0.001	0.0001	0.001	0.001	0.001	0.004	0.001	0.001	0.005	0.05	0.0001	
Apr-25	0.001	0.1	0.04	0.001	0.005	0.020	0.02	0.01	87	0.1	100	1	0.01	0.001	0.0001	0.001	0.001	0.001	0.004	0.001	0.001	0.005	0.05	0.0001	
May-25	0.001	0.1	0.01	0.001	0.005	0.010	0.03	0.01	82	0.1	94	1	0.01	0.001	0.0001	0.001	0.001	0.001	0.002	0.001	0.001	0.005	0.05	0.0001	
Jun-25	0.001	9.3	0.01	0.001	0.005	0.010	8.13	0.01	36	1.2	62	6	0.67	0.001	0.0001	0.002	0.001	0.001	0.011	0.002	0.001	0.005	0.48	0.0001	
Jul-25	0.001	0.1	0.05	0.001	0.005	0.000	0.1	<0.01	17	0.1	37	9	0.29	0.001	0.0001	0.001	0.001	0.001	0.013	0.001	0.001	0.005	0.28	0.0001	
Aug-25	0.001	0.1	0.01	0.001	0.005	0.010	0.1	0.01	31	0.1	37	9	0.07	0.001	0.0001	0.001	0.001	0.001	0.008	0.001	0.001	0.005	0.06	0.0001	
Sep-25	0.001	0.3	0.07	0.001	0.007	0.010	0.02	0.01	23	0.3	38	1	0.1	0.001	0.0001	0.001	0.001	0.001	0.005	0.001	0.001	0.006	0.09	0.0001	
Oct-25	0.001	0.1	0.02	0.001	0.005	0.010	0.01	0.01	33	0.1	58	1	0.08	0.001	0.0001	0.001	0.001	0.001	0.003	0.001	0.001	0.005	0.06	0.0001	
Nov-25	0.001	0.2	0.01	0.001	0.019	0.010	0.01	0.01	51	0.2	70	2	0.04	0.001	0.0001	0.001	0.011	0.001	0.004	0.001	0.001	0.017	0.05	0.0001	
Dec-25	0.001	0.2	0.01	0.001	0.005	0.030	0.01	0.01	41	0.2	98	1	0.09	0.001	0.0001	0.001	0.001	0.001	0.005	0.001	0.001	0.005	0.09	0.0001	
Jan-26	0.001	0.2	0.02	0.001	0.012	0.010	0.02	0.01	76	0.2	122	1	0.02	0.001	0.0001	0.001	0.001	0.001	0.004	0.001	0.001	0.083	0.05	0.0001	
Feb-26	0.001																								

Parameter	Sheen/ oil/ grease	Temp. (°C)	Dissolved Oxygen (DO %)	DO (ppm)	Specific EC (SPC) (uS/cm)	EC (uS/cm)	pH	Redox (mV)	Turbidity (NTU)	Dissolved Al (mg/L)	Dissolved As (mg/L)	Dissolved Cd (mg/L)	Dissolved Cr (mg/L)	Dissolved Cu (mg/L)	Cyanide (mg/L)	Dissolved Fe (mg/L)	Dissolved Pb (mg/L)	Dissolved Mn (mg/L)	Dissolved Hg (mg/L)
YARRANGOBILLY CATCHMENT																			
Default Guideline Value (DGV)	No	-	90-110	-	30-350	30-350	6.5-8	-	2-25	0.027	0.0008	0.0006	0.00001	0.001	0.004	0.3	0.001	1.2	0.00006
Limit of Reporting (LOR)									0.1	0.01	0.001	0.0001	0.001	0.001	0.002	0.05	0.001	0.001	0.0001
Dec - May Site Specific Guideline Value (SSGV)			96.2	9.08	115	93.2	7.85	79.1	0.37	0.03	0.0003	0.00002	0.00001	0.0002	0.002	0.03	0.001	0.002	0.00003
June - Nov SSGV			89.7	10.28	88	60.85	7.62	98.4	5.12	0.04	0.0003	0.00002	0.00001	0.0002	0.002	0.02	0.001	0.002	0.00003
SSC-IS																			
	Mar-24	No Flow	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-
	Apr-24	No Flow	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-
	May-24	No Flow	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-
	Jun-24	No Flow	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-
	Jul-24	No	8	90.1	-	152.6	6.29	-	17.88	0.1	0.001	0.0001	0.001	0.001	0.002	0.07	0.001	0.002	0.0001
	Aug-24	No	12.1	94.0	-	120.9	7.78	-	3.9	0.04	0.001	0.0001	0.001	0.001	0.002	0.05	0.001	0.001	0.0001
	Sep-24	No	12.2	84.1	-	122.2	7.10	-	3.53	0.05	0.001	0.0001	0.001	0.003	0.002	0.05	0.001	0.002	0.0001
	Oct-24	No	10.1	81.5	-	110.3	6.83	-	8.9	0.08	0.001	0.0001	0.001	0.001	0.002	0.05	0.001	0.001	0.0001
	Nov-24	No Flow	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-
	Dec-24	No	18.8	90.7	9.4	68.5	118	7.97	188	44.29	0.08	0.001	0.0001	0.001	0.001	0.002	0.05	0.001	0.001
	Jan-25	No Flow	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-
	Feb-25	No Flow	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-
	Mar-25	No Flow	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-
	Apr-25	No Flow	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-
	May-25	No Flow	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-
	Jun-25	No Flow	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-
	Jul-25	No	9.4	84.5	-	20.2	14.2	9.10	177.5	37.69	0.49	0.001	0.0001	0.001	0.001	0.002	0.31	0.001	0.001
	Aug-25	No Flow	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-
	Sep-25	No	9.9	93.1	-	118.5	84.4	8.20	171.2	4.33	0.05	0.001	0.0001	0.001	0.001	0.002	0.05	0.001	0.001
	Oct-25	No Flow	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-
	Nov-25	No Flow	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-
	Dec-25	No Flow	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-
	Jan-26	No Flow	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-
	Feb-26	No Flow	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-

Reference Site exceeds SSGV
 Impact Site Result exceeds SSGV or DGV
italics Result exceeds the Limit of Reporting

Parameter	Dissolved Ni (mg/L)	TN (mg/L)	TP (mg/L)	Dissolved Ag (mg/L)	Dissolved Zn (mg/L)	Ammonia (mg/L)	Nitrogen Oxides (mg/L)	Reactive Phosphorus (mg/L)	Total Hardness (mg/L) (CaCO3)	Total Kjeldahl Nitrogen (mg/L) (TKN)	TDS (mg/L)	TSS (mg/L)	Total Al (mg/L)	Total As (mg/L)	Total Cd (mg/L)	Total Cr (mg/L)	Total Cu (mg/L)	Total Pb (mg/L)	Total Mn (mg/L)	Total Ni (mg/L)	Total Ag (mg/L)	Total Zn (mg/L)	Total Fe (mg/L)	Total Hg (mg/L)
YARRANGOBILLY CATCHMENT																								
Default Guideline Value (DGV)	0.008	0.25	0.02	0.00002	0.0024	0.013	0.015	0.015	-	-	-	0.2	0.027	0.0008	0.0006	0.00001	0.001	0.001	1.2	0.008	0.00002	0.0024	0.3	0.00006
Limit of Reporting (LOR)	0.001	0.1	0.01	0.001	0.005	0.010	0.010	0.010	1	0.1	10	1	0.01	0.001	0.0001	0.001	0.001	0.001	0.001	0.001	0.001	0.005	0.05	0.0001
Dec - May Site Specific Guideline Value (SSGV)	0.001	0.2	0.02	0.00002	0.002	0.013	0.015	0.020	47	0.2	52	0.2												
June - Nov SSGV	0.001	0.2	0.02	0.00002	0.002	0.013	0.015	0.015	30	0.2	39	1.0												
SSC-IS																								
Mar-24	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-
Apr-24	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-
May-24	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-
Jun-24	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-
Jul-24	0.001	1.8	0.03	0.001	0.024	0.030	0.85	0.01	62	0.9	110	1	0.09	0.001	0.0001	0.001	0.001	0.001	0.006	0.001	0.001	0.025	0.4	0.0001
Aug-24	0.001	0.1	0.01	0.001	0.005	0.010	0.01	0.01	62	0.1	110	5	0.21	0.001	0.0001	0.001	0.001	0.001	0.001	0.001	0.001	0.005	0.09	0.0001
Sep-24	0.001	0.7	0.03	0.001	0.036	0.010	0.07	0.01	65	0.6	108	5	0.10	0.001	0.0001	0.001	0.003	0.001	0.004	0.001	0.001	0.028	0.08	0.0001
Oct-24	0.001	0.4	0.02	0.001	0.005	0.010	0.18	0.01	58	0.2	100	1	0.13	0.001	0.0001	0.001	0.001	0.001	0.001	0.001	0.001	0.005	0.1	0.0001
Nov-24	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-
Dec-24	0.001	0.1	0.01	0.001	0.005	0.01	0.01	0.01	53	0.1	85	8	0.57	0.001	0.0001	0.001	0.001	0.001	0.013	0.001	0.001	0.005	0.41	0.0001
Jan-25	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-
Feb-25	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-
Mar-25	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-
Apr-25	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-
May-25	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-
Jun-25	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-
Jul-25	0.002	0.2	0.05	0.001	0.005	0.16	0.01	0.01	39	0.2	71	6	1.64	0.001	0.0001	0.002	0.001	0.003	0.015	0.002	0.001	0.008	1.16	0.0001
Aug-25	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-
Sep-25	0.001	0.1	0.02	0.001	0.005	0.01	0.01	0.01	44	0.1	71	2	0.5	0.001	0.0001	0.001	0.001	0.001	0.003	0.001	0.001	0.005	0.29	0.002
Oct-25	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-
Nov-25	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-
Dec-25	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-
Jan-26	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-
Feb-26	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-

Reference Site exceeds SSGV
 Impact Site Result exceeds SSGV or DGV
italics Result exceeds the Limit of Reporting

Parameter		Sheen/ oil/ grease	Temp. (°C)	Dissolved Oxygen (DO %)	DO (ppm)	Specific EC (SPC uS/cm)	EC (uS/cm)	pH	Redox (mV)	Turbidity (NTU)	Dissolved Al (mg/L)	Dissolved As (mg/L)	Dissolved Cd (mg/L)	Dissolved Cr (mg/L)	Dissolved Cu (mg/L)	Cyanide (mg/L)	Dissolved Fe (mg/L)	Dissolved Pb (mg/L)	Dissolved Mn (mg/L)	Dissolved Hg (mg/L)	
TALBINGO RESERVOIR																					
DGV		No	-	90-110	-	30-350	30-350	6.5-8	-	2-25	0.027	0.0008	0.0006	0.00001	0.001	0.004	0.3	0.001	1.2	0.00006	
LOR										0.1	0.01	0.001	0.0001	0.001	0.001	0.002	0.05	0.001	0.001	0.0001	
Dec - May SSGV				91.3	8.79	24.0	20.3	7.59	91.2	0.09	0.03	0.003	0.00002	0.00001	0.0002	0.002	0.04	0.001	0.003	0.00003	
June - Nov SSGV				95.5	11.53	38.7	26.2	7.59	95.4	1.56	0.015	0.0003	0.00002	0.00001	0.0002	0.002	0.02	0.001	0.002	0.00003	
TR-RS																					
	Mar-24	No	13.4	72.5	7.57	24	18.7	7.10	55	0.10	0.015	0.00015	0.00001	0.000005	0.0001	0.001	0.05	0.005	0.005	0.000015	
	Apr-24	No	12.2	85.9	-	25.9	-	7.17	-	0.02	0.01	0.001	0.0001	0.001	0.001	0.005	0.02	0.05	0.001	0.026	0.0001
	May-24	No	10.1	91.5	-	30.2	-	6.80	-	0.65	0.01	0.001	0.0001	0.001	0.001	0.004	0.05	0.001	0.002	0.0001	
	Jun-24	No	8.7	91.6	-	26.4	-	8.32	-	0.10	0.01	0.001	0.0001	0.001	0.001	0.002	0.05	0.001	0.010	0.0001	
	Jul-24	No	6	92.1	-	28.7	-	7.76	-	1.35	0.02	0.001	0.0001	0.001	0.001	0.002	0.05	0.001	0.003	0.0001	
	Aug-24	No	12.7	91.5	-	26.3	-	6.67	-	2.0	0.02	0.001	0.0001	0.001	0.001	0.002	0.05	0.001	0.002	0.0001	
	Sep-24	No	10.2	96.2	-	25	-	7.78	-	0.58	0.02	0.001	0.0001	0.001	0.001	0.002	0.05	0.001	0.002	0.0001	
	Oct-24	No	9.5	95.2	-	15.3	-	7.78	-	1.7	0.04	0.001	0.0001	0.001	0.001	0.002	0.05	0.001	0.008	0.0001	
	Nov-24	No	15.6	92.1	9.7	55	55	7.73	271	1.6	0.01	0.001	0.0001	0.001	0.001	0.002	0.05	0.001	0.005	0.0001	
	Dec-24	No	22.8	95.5	9.1	22.2	38	7.97	200	3.76	0.02	0.001	0.0001	0.001	0.001	0.002	0.05	0.001	0.001	0.0001	
	Jan-25	No	25.7	91.6	9.1	27.8	44	7.23	234	1.61	0.01	0.001	0.0001	0.001	0.001	0.002	0.05	0.001	0.001	0.0001	
	Feb-25	No	24.6	94.8	9.1	8.7	40	7.61	168	2.16	0.01	0.001	0.0001	0.001	0.001	0.002	0.05	0.001	0.002	0.0001	
	Mar-25	No	21.3	90.1	8.9	8.3	36	7.56	138	3.25	0.01	0.001	0.0001	0.001	0.001	0.002	0.05	0.001	0.002	0.0001	
	Apr-25	No	17.6	67.6	9.9	5.8	26	6.96	190	1.3	0.01	0.001	0.0001	0.001	0.001	0.002	0.05	0.001	0.03	0.0001	
	May-25	No	12.3	88.6	-	5.9	4.5	7.59	109.8	1.68	0.01	0.001	0.0001	0.001	0.001	0.002	0.05	0.001	0.003	0.0001	
	Jun-25	No	10.5	86.4	-	6.1	4.4	8.34	111.9	3.15	0.02	0.001	0.0001	0.001	0.001	0.002	0.05	0.001	0.008	0.0001	
	Jul-25	No	7.9	90	-	6.5	4.4	7.78	168.1	7.5	0.1	0.001	0.0001	0.001	0.001	0.002	0.18	0.001	0.011	0.0001	
	Aug-25	No	12.5	103.6	-	5.8	4.5	7.1	246.8	6.08	0.01	0.001	0.0001	0.001	0.001	0.002	0.05	0.001	0.002	0.0001	
	Sep-25	No	11.3	95.6	-	41.3	30.5	4.9	107.8	1.92	0.02	0.001	0.0001	0.001	0.001	0.002	0.05	0.001	0.003	0.0001	
	Oct-25	No	13.2	45.9	-	47	36.4	7.35	136.6	1.46	0.02	0.001	0.0001	0.001	0.001	0.002	0.05	0.001	0.001	0.0001	
	Nov-25	No	18.8	80.7	-	40	37.9	6.91	184.3	1.15	0.01	0.001	0.0001	0.001	0.001	0.002	0.05	0.001	0.003	0.001	
	Dec-25	No	18.3	78.1	-	41.2	36	7.45	155.3	3.59	0.01	0.001	0.0001	0.001	0.001	0.002	0.05	0.001	0.002	0.0001	
	Jan-26	No	24.5	93.4	-	47.4	46.9	7.92	134.4	1.83	0.02	0.002	0.0001	0.001	0.001	0.002	0.05	0.001	0.001	0.0001	
	Feb-26	No	17.6	79.1	-	122.3	105.0	7.4	122.1	2.67	0.01	0.001	0.0001	0.001	0.001	0.002	0.05	0.001	0.007	0.0001	

	Reference Site exceeds SSGV
	Impact Site Result exceeds SSGV or DGV
<i>italics</i>	Result exceeds the Limit of Reporting

Parameter	Dissolved Ni (mg/L)	TN (mg/L)	TP (mg/L)	Dissolved Ag (mg/L)	Dissolved Zn (mg/L)	Ammonia (mg/L)	Nitrogen Oxides (mg/L)	Reactive Phosphorus (mg/L)	Total Hardness (mg/L) (CaCO3)	Total Kjeldahl Nitrogen (mg/L) (TKN)	TDS (mg/L)	TSS (mg/L)	Total Al (mg/L)	Total As (mg/L)	Total Cd (mg/L)	Total Cr (mg/L)	Total Cu (mg/L)	Total Pb (mg/L)	Total Mn (mg/L)	Total Ni (mg/L)	Total Ag (mg/L)	Total Zn (mg/L)	Total Fe (mg/L)	Total Hg (mg/L)
TALBINGO RESERVOIR																								
DGV	0.008	0.25	0.02	0.00002	0.0024	0.013	0.015	0.015	-	-	-	0.2	0.027	0.0008	0.0006	0.00001	0.001	0.001	1.2	0.008	0.00002	0.0024	0.3	0.00006
LOR	0.001	0.1	0.01	0.001	0.005	0.010	0.010	0.01	1	0.1	10	1	0.01	0.001	0.0001	0.001	0.001	0.001	0.001	0.001	0.001	0.005	0.05	0.0001
Dec - May SSGV	0.001	0.2	0.02	0.00002	0.002	0.013	0.015	0.02	7.5	0.1	12.5	0.2												
June - Nov SSGV	0.001	0.2	0.02	0.00002	0.002	0.013	0.015	0.015	8	0.2	15	0.2												
TR-RS	0.0005	0.1	0.01	0.00001	0.001	0.050	0.05	0.005	8	0.1	44	0.1												
Mar-24	0.001	1.3	0.02	0.001	0.066	0.030	0.12	-	5	0.12	-	3	0.02	0.001	0.0001	0.001	0.006	0.001	0.039	0.002	0.001	0.067	0.07	0.0001
Apr-24	0.001	0.3	0.03	0.001	0.023	0.020	0.03	0.01	5	0.3	35	5	0.03	0.001	0.0001	0.001	0.001	0.001	0.033	0.001	0.001	0.012	0.06	0.0001
May-24	0.001	2.3	0.01	0.001	0.005	0.010	1.92	0.01	5	0.4	17	2	0.03	0.001	0.0001	0.001	0.001	0.001	0.056	0.001	0.001	0.005	0.07	0.0001
Jun-24	0.001	0.1	0.02	0.001	0.005	0.030	0.04	0.01	5	0.1	17	2	0.05	0.001	0.0001	0.001	0.001	0.001	0.014	0.001	0.001	0.005	0.06	0.0001
Jul-24	0.001	0.4	0.02	0.001	0.011	0.020	0.07	0.01	12	0.3	30	1	0.04	0.001	0.0001	0.001	0.001	0.001	0.004	0.001	0.001	0.008	0.05	0.0001
Aug-24	0.001	0.2	0.03	0.001	0.005	0.010	0.06	0.01	14	0.1	27	2	0.06	0.001	0.0001	0.001	0.001	0.001	0.006	0.001	0.001	0.005	0.07	0.0001
Sep-24	0.001	0.2	0.02	0.001	0.013	0.040	0.02	0.01	14	0.2	38	4	0.07	0.001	0.0001	0.001	0.001	0.001	0.01	0.001	0.001	0.005	0.11	0.0001
Oct-24	0.001	0.1	0.05	0.001	0.005	0.010	0.02	0.01	21	0.1	45	5	0.14	0.001	0.0001	0.001	0.001	0.001	0.07	0.001	0.001	0.005	0.23	0.0001
Nov-24	0.001	0.1	0.06	0.001	0.005	0.010	0.01	0.01	14	0.1	25	2	0.04	0.001	0.0001	0.001	0.001	0.001	0.007	0.001	0.001	0.007	0.06	0.0001
Dec-24	0.001	0.2	0.02	0.001	0.005	0.020	0.01	0.01	17	0.2	46	6	0.03	0.001	0.0001	0.001	0.001	0.001	0.018	0.001	0.001	0.005	0.05	0.0001
Jan-25	0.001	0.2	0.03	0.001	0.005	0.020	0.01	0.01	14	0.2	28	1	0.04	0.001	0.0001	0.001	0.001	0.001	0.017	0.001	0.001	0.005	0.07	0.0001
Feb-25	0.001	0.2	0.03	0.001	0.005	0.010	0.01	0.01	14	0.2	28	1	0.04	0.001	0.0001	0.001	0.001	0.001	0.019	0.001	0.001	0.005	0.06	0.0001
Mar-25	0.001	0.4	0.05	0.001	0.005	0.020	0.05	0.01	5	0.3	22	1	0.03	0.001	0.0001	0.001	0.001	0.001	0.051	0.001	0.001	0.005	0.09	0.0001
Apr-25	0.001	0.2	0.07	0.001	0.005	0.030	0.01	0.02	9	0.2	16	1	0.01	0.001	0.0001	0.001	0.001	0.001	0.03	0.001	0.001	0.005	0.05	0.0001
May-25	0.001	0.1	0.06	0.001	0.005	0.040	0.04	0.01	5	0.1	56	1	0.02	0.001	0.0001	0.001	0.001	0.001	0.046	0.001	0.001	0.005	0.05	0.0001
Jun-25	0.001	0.1	0.03	0.001	0.005	0.020	0.1	0.01	9	0.1	22	5	0.16	0.001	0.0001	0.001	0.001	0.001	0.111	0.001	0.001	0.009	0.18	0.0001
Jul-25	0.001	0.1	0.01	0.001	0.005	0.020	0.03	0.01	5	0.1	18	2	0.04	0.001	0.0001	0.001	0.001	0.001	0.006	0.001	0.001	0.005	0.05	0.0001
Aug-25	0.001	3.2	0.02	0.001	0.006	0.020	2.66	0.01	14	0.5	46	1	0.03	0.001	0.0001	0.001	0.001	0.001	0.005	0.001	0.001	0.01	0.05	0.0001
Sep-25	0.001	0.1	0.04	0.001	0.005	0.020	0.01	0.01	12	0.1	20	1	0.04	0.001	0.0001	0.001	0.001	0.001	0.004	0.001	0.001	0.005	0.05	0.0001
Oct-25	0.001	0.2	0.04	0.001	0.021	0.010	0.01	0.01	14	0.2	31	1	0.05	0.001	0.0001	0.001	0.001	0.001	0.009	0.001	0.001	0.005	0.08	0.0001
Nov-25	0.001	0.2	0.02	0.001	0.005	0.010	0.01	0.01	12	0.2	57	1	0.03	0.001	0.0001	0.001	0.001	0.001	0.008	0.001	0.001	0.005	0.05	0.0001
Dec-25	0.001	1.1	0.01	0.001	0.005	0.010	0.86	0.01	14	0.2	24	1	0.09	0.001	0.0001	0.001	0.001	0.001	0.01	0.001	0.001	0.022	0.14	0.0001
Jan-26	0.001	0.7	0.01	0.001	0.127	0.050	0.33	0.01	14	0.4	31	1	0.02	0.001	0.0001	0.001	0.001	0.001	0.015	0.001	0.001	0.087	0.08	0.0001
Feb-26	0.001	0.7	0.01	0.001	0.127	0.050	0.33	0.01	14	0.4	31	1	0.02	0.001	0.0001	0.001	0.001	0.001	0.015	0.001	0.001	0.087	0.08	0.0001

Reference Site exceeds SSGV |
Impact Site Result exceeds SSGV or DGV |
italics | Result exceeds the Limit of Reporting

Parameter	Sheen/ oil/ grease	Temp. (°C)	Dissolved Oxygen (DO %)	DO (ppm)	Specific EC (SPC uS/cm)	EC (uS/cm)	pH	Redox (mV)	Turbidity (NTU)	Dissolved Al (mg/L)	Dissolved As (mg/L)	Dissolved Cd (mg/L)	Dissolved Cr (mg/L)	Dissolved Cu (mg/L)	Cyanide (mg/L)	Dissolved Fe (mg/L)	Dissolved Pb (mg/L)	Dissolved Mn (mg/L)	Dissolved Hg (mg/L)	
YORKERS CREEK CATCHMENT																				
DGV	No	-	90-110	-	30-350	30-350	6.5-8	-	2-25	0.027	0.0008	0.0006	0.00001	0.001	0.004	0.3	0.001	1.2	0.00006	
LOR									0.1	0.01	0.001	0.0001	0.001	0.001	0.002	0.05	0.001	0.001	0.0001	
Dec - May SSGV			89.6	8.35	31	24	6.79	94.6	9	0.36	0.003	0.00002	0.00001	0.002	0.002	0.41	0.001	0.005	0.00003	
June - Nov SSGV			88.7	10.2	27.9	20.5	6.61	106.1	7.87	0.32	0.0003	0.00002	0.00001	0.0002	0.002	0.23	0.001	0.003	0.00003	
YK-RS	Mar-24	Yes	16.3	82.5	8.09	31.5	26.2	6.69	64.5	12.24	0.6	0.00015	0.00001	0.000005	0.001	0.001	0.66	0.002	0.013	0.000015
	Apr-24	No	6.8	80.7	-	36.5	-	7.04	-	17.27	0.10	-	0.0001	0.001	0.001	0.02	0.001	0.014	0.0001	
	May-24	No	4.2	85.1	-	34.7	-	6.62	-	0.3	0.10	0.001	0.0001	0.001	0.001	0.004	0.17	0.001	0.026	0.0001
	Jun-24	No	3.5	84.2	-	30.1	-	7.99	-	26.48	0.09	0.001	0.0001	0.001	0.001	0.002	0.18	0.001	0.021	0.0001
	Jul-24	No	2.9	83.1	-	27.8	-	7.40	-	7.97	0.19	0.001	0.0001	0.001	0.001	0.002	0.21	0.001	0.010	0.0001
	Aug-24	No	7.3	82.7	-	21.6	-	6.89	-	19.36	0.33	0.001	0.0001	0.001	0.001	0.002	0.29	0.001	0.017	0.0001
	Sep-24	No	12.3	86.5	-	19.5	-	7.58	-	15.51	0.09	0.001	0.0001	0.001	0.001	0.002	0.16	0.001	0.013	0.0001
	Oct-24	No	18.3	87.8	-	21.8	-	7.55	-	17.9	0.14	0.001	0.0001	0.001	0.001	0.002	0.15	0.001	0.013	0.0001
	Nov-24	No	19.3	84.8	9	30	30	6.68	259	13.8	0.06	0.001	0.0001	0.001	0.001	0.002	0.12	0.001	0.014	0.0001
	Dec-24	No	22.9	82.6	8.3	18.7	31	7.52	238	19	0.13	0.001	0.0001	0.001	0.001	0.002	0.16	0.001	0.024	0.0001
	Jan-25	No	17.4	72.5	8.8	24.5	40	7.26	209	15.77	0.08	0.001	0.0001	0.001	0.001	0.002	0.15	0.001	0.015	0.0001
	Feb-25	Yes	22.8	76.3	8.9	8.6	38	7.09	174	21.19	0.18	0.001	0.0001	0.001	0.001	0.002	0.32	0.001	0.009	0.0001
	Mar-25	No	17.4	81.4	9.3	9.7	43	7.46	170	20.65	0.45	0.001	0.0001	0.001	0.001	0.002	0.3	0.001	0.009	0.0001
	Apr-25	No	11	77.6	10.2	8.6	39	7.64	148	15.23	0.12	0.001	0.0001	0.001	0.001	0.002	0.17	0.001	0.004	0.0001
	May-25	Yes	4.2	83.9	-	9.1	5.5	7.73	116.9	11.81	0.08	0.001	0.0001	0.001	0.001	0.002	0.14	0.001	0.004	0.0001
	Jun-25	No	5.4	83.0	-	7.8	4.9	8.24	114.3	14.6	0.19	0.001	0.0001	0.001	0.001	0.002	0.31	0.001	0.016	0.0001
	Jul-25	No Flow	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-
	Aug-25	No Flow	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-
	Sep-25	No	6.6	85.4	-	28.2	18.3	6.80	112.7	16.12	0.1	0.001	0.0001	0.001	0.001	0.002	0.15	0.001	0.011	0.0001
	Oct-25	No	9.9	40.7	-	38.9	27.3	6.80	134.9	10.07	0.14	0.001	0.0001	0.001	0.001	0.002	0.57	0.001	0.025	0.0001
	Nov-25	No	20.1	74.5	-	43.9	39.8	6.88	164.7	14.8	0.16	0.001	0.0001	0.001	0.001	0.002	0.25	0.001	0.015	0.0001
	Dec-25	No	11.1	58.9	-	55.2	40.5	6.84	151.7	32.56	0.26	0.001	0.0001	0.001	0.001	0.002	1.04	0.001	0.132	0.0001
	Jan-26	No Flow	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-
	Feb-26	No Flow	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-
YK-IS (D/S)	Mar-24	No	10	81.6	9.21	39.1	27.9	7.02	63.2	0.1	0.0065	0.00015	0.00001	0.000005	0.0001	0.001	0.26	0.0005	0.006	0.000015
	Apr-24	No	5.9	86.0	-	39.4	-	7.33	-	221.78	0.05	0.001	0.0001	0.001	0.001	0.002	0.11	0.001	0.014	0.0001
	May-24	No	3.1	85.9	-	39.6	-	6.59	-	0.8	0.09	0.001	0.0001	0.001	0.001	0.004	0.15	0.001	0.021	0.0001
	Jun-24	No	3.2	84.6	-	38.9	-	7.76	-	2.46	0.06	0.001	0.0001	0.001	0.001	0.002	0.1	0.001	0.009	0.0001
	Jul-24	No	3.2	85.0	-	32.8	-	7.11	-	8.29	0.28	0.001	0.0001	0.001	0.001	0.002	0.22	0.001	0.005	0.0001
	Aug-24	No	7.3	84.7	-	23.2	-	6.85	-	22.38	0.51	0.001	0.0001	0.001	0.001	0.002	0.34	0.001	0.011	0.0001
	Sep-24	No	9.3	84.5	-	26.9	-	7.52	-	3.34	0.07	0.001	0.0001	0.001	0.001	0.002	0.1	0.001	0.008	0.0001
	Oct-24	No	11.3	84.0	-	27	-	7.36	-	6.4	0.1	0.001	0.0001	0.001	0.001	0.002	0.12	0.001	0.010	0.0001
	Nov-24	No	13.5	83.3	9.4	38	38	7.17	268	5.5	0.05	0.001	0.0001	0.001	0.001	0.002	0.1	0.001	0.011	0.0001
	Dec-24	No	17.7	82.9	9.2	22.2	550	7.03	463	6.27	0.07	0.001	0.0001	0.001	0.001	0.002	0.1	0.001	0.004	0.0001
	Jan-25	No	16.2	79.2	9.2	28.2	48	7.40	233	2.44	0.04	0.001	0.0001	0.001	0.001	0.002	0.14	0.001	0.013	0.0001
	Feb-25	No	20.5	85.0	9.3	10.4	47	7.09	150	5.32	0.14	0.001	0.0001	0.001	0.001	0.002	0.24	0.001	0.016	0.0001
	Mar-25	No	15.9	89.2	9.6	10.7	48	7.32	152	3.01	0.07	0.001	0.0001	0.001	0.002	0.02	0.21	0.001	0.016	0.0001
	Apr-25	No	12.5	84.0	10.7	11.1	49	7.42	166	2.71	0.04	0.001	0.0001	0.001	0.001	0.002	0.1	0.001	0.018	0.0001
	May-25	No	5.4	85.5	-	10.6	6.6	7.54	111.1	2.84	0.05	0.001	0.0001	0.001	0.001	0.002	0.1	0.001	0.013	0.0001
	Jun-25	No	5.6	83.1	-	8.1	5.1	8.07	114.4	18.14	0.18	0.001	0.0001	0.001	0.001	0.002	0.3	0.001	0.01	0.0001
	Jul-25	No	5.7	81.6	-	6.4	4.1	7.95	170.2	18.25	0.45	0.001	0.0001	0.001	0.001	0.002	0.29	0.001	0.005	0.0001
	Aug-25	No	6.7	89.7	-	10.6	6.9	7.20	253.9	7.77	0.17	0.001	0.0001	0.001	0.001	0.002	0.15	0.001	0.009	0.0001
	Sep-25	No	7.1	87.9	-	35.8	23.5	6.10	115.3	4.58	0.6	0.001	0.0001	0.001	0.001	0.002	0.19	0.001	0.01	0.0001
	Oct-25	No	9.9	40.7	-	44.6	31.7	6.93	156.2	4.01	0.08	0.001	0.0001	0.001	0.001	0.002	0.1	0.001	0.008	0.0001
	Nov-25	No	15.5	68.9	-	24.6	20.2	6.96	165.7	4.4	0.09	0.001	0.0001	0.001	0.001	0.002	0.15	0.001	0.011	0.0001
	Dec-25	No	11.8	71.6	-	55.2	40.5	6.84	151.7	32.56	0.1	0.001	0.0001	0.001	0.001	0.002	0.16	0.001	0.011	0.0001
	Jan-26	No Flow	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-
	Feb-26	No Flow	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-

Reference Site exceeds SSGV
 Impact Site Result exceeds SSGV or DGV
italics Result exceeds the Limit of Reporting

Parameter	Dissolved Ni (mg/L)	TN (mg/L)	TP (mg/L)	Dissolved Ag (mg/L)	Dissolved Zn (mg/L)	Ammonia (mg/L)	Nitrogen Oxides (mg/L)	Reactive Phosphorus (mg/L)	Total Hardness (mg/L) (CaCO3)	Total Kjeldahl Nitrogen (mg/L) (TKN)	TDS (mg/L)	TSS (mg/L)	Total Al (mg/L)	Total As (mg/L)	Total Cd (mg/L)	Total Cr (mg/L)	Total Cu (mg/L)	Total Pb (mg/L)	Total Mn (mg/L)	Total Ni (mg/L)	Total Ag (mg/L)	Total Zn (mg/L)	Total Fe (mg/L)	Total Hg (mg/L)
YORKERS CREEK CATCHMENT																								
DGV	0.008	0.25	0.02	0.00002	0.0024	0.013	0.015	0.015	-	-	-	0.2	0.027	0.0008	0.0006	0.00001	0.001	0.001	1.2	0.008	0.00002	0.0024	0.3	0.00006
LOR	0.001	0.1	0.01	0.001	0.005	0.010	0.010	0.01	1	0.1	10	1	0.01	0.001	0.0001	0.001	0.001	0.001	0.001	0.001	0.001	0.005	0.05	0.0001
Dec - May SSGV	0.001	0.2	0.02	0.00002	0.002	0.013	0.015	0.02	1	0.1	30	3												
June - Nov SSGV	0.001	0.2	0.02	0.00002	0.002	0.013	0.015	0.02	7	0.2	10	0.2												
YK-RS	0.0005	0.1	0.03	0.00001	0.003	0.050	0.05	0.005	1	0.1	30	3												
Mar-24	0.001	0.6	0.04	0.001	0.013	0.020	0.02	-	9	0.02	-	24	0.15	0.001	0.0001	0.001	0.007	0.001	0.021	0.006	0.001	0.016	0.46	0.0001
Apr-24	0.001	0.3	0.04	0.001	0.005	0.030	0.02	0.01	9	0.3	37	5	0.10	0.001	0.0001	0.001	0.001	0.001	0.027	0.001	0.001	0.005	0.34	0.0001
May-24	0.001	0.4	0.04	0.001	0.005	0.020	0.02	0.03	9	0.4	21	15	0.23	0.001	0.0001	0.001	0.001	0.001	0.032	0.001	0.001	0.005	0.50	0.0001
Jun-24	0.001	0.4	0.04	0.001	0.007	0.010	0.05	0.01	9	0.4	41	7	0.59	0.001	0.0001	0.001	0.001	0.001	0.017	0.001	0.001	0.005	0.53	0.0001
Jul-24	0.001	0.9	0.07	0.001	0.012	0.010	0.01	0.01	9	0.9	34	19	1.82	0.001	0.0001	0.003	0.001	0.001	0.076	0.001	0.001	0.005	1.77	0.0001
Aug-24	0.001	0.2	0.05	0.001	0.010	0.010	0.04	0.01	9	0.2	28	19	0.28	0.001	0.0001	0.001	0.001	0.001	0.023	0.001	0.001	0.005	0.52	0.0001
Sep-24	0.001	0.2	0.03	0.001	0.005	0.010	0.05	0.01	5	0.2	21	22	0.24	0.001	0.0001	0.001	0.001	0.001	0.02	0.001	0.001	0.005	0.45	0.0001
Oct-24	0.001	0.1	0.04	0.001	0.008	0.020	0.03	0.01	9	0.1	46	30	1.29	0.001	0.0001	0.002	0.001	0.001	0.032	0.001	0.001	0.005	1.05	0.0001
Nov-24	0.001	0.3	0.04	0.001	0.005	0.010	0.04	0.01	9	0.3	40	22	0.22	0.001	0.0001	0.001	0.001	0.001	0.031	0.001	0.001	0.005	0.51	0.0001
Dec-24	0.001	0.7	0.05	0.001	0.005	0.080	0.06	0.01	12	0.6	62	27	0.43	0.001	0.0001	0.001	0.001	0.001	0.038	0.001	0.001	0.005	0.96	0.0001
Jan-25	0.001	0.6	0.07	0.001	0.005	0.040	0.01	0.01	9	0.6	58	12	0.4	0.001	0.0001	0.001	0.001	0.001	0.017	0.001	0.001	0.007	0.77	0.0001
Feb-25	0.001	0.4	0.06	0.001	0.005	0.020	0.01	0.01	16	0.4	28	20	0.39	0.001	0.0001	0.001	0.001	0.001	0.015	0.001	0.001	0.005	0.7	0.0001
Mar-25	0.001	0.2	0.01	0.001	0.005	0.040	0.01	0.01	16	0.2	30	8	0.78	0.001	0.0001	0.001	0.001	0.001	0.009	0.001	0.001	0.005	0.74	0.0001
Apr-25	0.001	0.3	0.02	0.001	0.005	0.010	0.18	0.01	16	0.1	33	4	0.52	0.001	0.0001	0.001	0.001	0.001	0.009	0.001	0.001	0.005	0.63	0.0001
May-25	0.001	0.6	0.09	0.001	0.005	0.010	0.02	0.01	9	0.6	90	30	1.07	0.001	0.0001	0.002	0.001	0.001	0.023	0.001	0.001	0.005	0.88	0.0001
Jun-25	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-
Jul-25	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-
Aug-25	0.001	0.3	0.05	0.001	0.005	0.010	0.01	0.01	9	0.3	50	3	0.25	0.001	0.0001	0.001	0.001	0.001	0.013	0.001	0.001	0.005	0.27	0.0001
Sep-25	0.001	0.2	0.04	0.001	0.005	0.010	0.01	0.01	9	0.2	21	7	0.6	0.001	0.0001	0.001	0.001	0.001	0.025	0.001	0.001	0.005	0.57	0.0001
Oct-25	0.001	0.3	0.01	0.001	0.005	0.010	0.01	0.01	9	0.3	42	9	0.94	0.001	0.0001	0.002	0.001	0.001	0.03	0.001	0.001	0.005	0.87	0.0001
Nov-25	0.001	0.9	0.09	0.001	0.024	0.060	0.04	0.01	16	0.9	85	61	1.36	0.001	0.0001	0.002	0.002	0.001	0.161	0.002	0.001	0.017	2.43	0.0001
Dec-25	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-
Jan-26	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-
Feb-26	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-
YK-IS (D/S)	0.0005	0.1	0.02	0.00001	0.002	0.050	0.05	0.005	1	0.1	15	0.1												
Mar-24	0.001	0.1	0.02	0.001	0.005	0.010	0.03	-	16	0.03	-	3	0.1	0.001	0.0001	0.001	0.001	0.001	0.016	0.003	0.001	0.006	0.26	0.0001
Apr-24	0.001	0.8	0.04	0.001	0.005	0.010	0.53	0.01	12	0.3	39	9	0.12	0.001	0.0001	0.003	0.001	0.001	0.035	0.002	0.001	0.005	0.61	0.0001
May-24	0.001	0.2	0.04	0.001	0.005	0.010	0.01	0.01	12	0.2	25	2	0.48	0.001	0.0001	0.001	0.001	0.001	0.027	0.001	0.001	0.005	0.66	0.0001
Jun-24	0.001	0.6	0.04	0.001	0.007	0.010	0.28	0.01	9	0.3	52	5	0.3	0.001	0.0001	0.001	0.001	0.001	0.011	0.001	0.001	0.005	0.32	0.0001
Jul-24	0.001	0.6	0.04	0.001	0.005	0.010	0.09	0.01	9	0.5	70	17	1.02	0.001	0.0001	0.005	0.001	0.001	0.026	0.001	0.001	0.005	0.89	0.0001
Aug-24	0.001	0.2	0.02	0.001	0.011	0.010	0.01	0.01	12	0.2	29	3	0.16	0.001	0.0001	0.001	0.001	0.001	0.012	0.001	0.001	0.005	0.26	0.0001
Sep-24	0.001	0.3	0.04	0.001	0.009	0.030	0.11	0.01	5	0.2	24	4	0.22	0.001	0.0001	0.001	0.001	0.001	0.01	0.001	0.001	0.005	0.28	0.0001
Oct-24	0.001	0.1	0.04	0.001	0.005	0.010	0.01	0.01	12	0.1	48	8	0.26	0.001	0.0001	0.001	0.001	0.001	0.07	0.001	0.001	0.005	0.41	0.0001
Nov-24	0.001	0.2	0.01	0.001	0.005	0.010	0.02	0.01	12	0.2	124	5	0.13	0.001	0.0001	0.001	0.001	0.001	0.01	0.001	0.001	0.011	0.27	0.0001
Dec-24	0.001	0.2	0.03	0.001	0.005	0.050	0.02	0.01	18	0.2	62	2	0.04	0.001	0.0001	0.001	0.001	0.001	0.013	0.001	0.001	0.005	0.14	0.0001
Jan-25	0.001	0.3	0.04	0.001	0.005	0.020	0.01	0.01	18	0.3	51	1	0.25	0.001	0.0001	0.001	0.001	0.001	0.021	0.001	0.001	0.005	0.45	0.0001
Feb-25	0.001	0.3	0.02	0.001	0.005	0.050	0.09	0.01	18	0.2	43	2	0.06	0.001	0.0001	0.001	0.001	0.001	0.019	0.001	0.001	0.005	0.33	0.0001
Mar-25	0.001	0.2	0.02	0.001	0.005	0.030	0.01	0.01	18	0.2	39	1	0.08	0.001	0.0001	0.001	0.001	0.001	0.02	0.001	0.001	0.005	0.26	0.0001
Apr-25	0.001	0.1	0.01	0.001	0.005	0.010	0.01	0.01	18	0.1	36	1	0.17	0.001	0.0001	0.001	0.001	0.001	0.033	0.001	0.001	0.005	0.44	0.0001
May-25	0.001	0.4	0.04	0.001	0.005	0.010	0.01	0.01	12	0.4	89	5	0.24	0.001	0.0001	0.001	0.001	0.001	0.015	0.001	0.001	0.005	0.46	0.0001
Jun-25	0.001	0.2	0.04	0.001	0.005	0.010	0.03	0.01	5	0.2	55	6	0.67	0.001	0.0001	0.001	0.001	0.001	0.009	0.001	0.001	0.005	0.48	0.0001
Jul-25	0.001	0.2	0.06	0.001	0.005	0.080	0.14	0.01	16	0.14	27	2	0.61	0.001	0.0001	0.001	0.001	0.001	0.009	0.001	0.001	0.005	0.18	0.0001
Aug-25	0.001	0.2	0.04	0.001	0.014	0.010	0.02	0.01	12	0.2	48	2	0.12	0.001	0.0001	0.001	0.001	0.001	0.01	0.001	0.001	0.007	0.19	0.0001
Sep-25	0.001	0.1	0.02	0.001	0.005	0.020	0.01	0.01	12	0.1	22	2	0.27	0.001	0.0001									

Parameter	Sheen/ oil/ grease	Temp. (°C)	Dissolved Oxygen (DO %)	DO (ppm)	Specific EC (SPC uS/cm)	EC (uS/cm)	pH	Redox (mV)	Turbidity (NTU)	Dissolved Al (mg/L)	Dissolved As (mg/L)	Dissolved Cd (mg/L)	Dissolved Cr (mg/L)	Dissolved Cu (mg/L)	Cyanide (mg/L)	Dissolved Fe (mg/L)	Dissolved Pb (mg/L)	Dissolved Mn (mg/L)	Dissolved Hg (mg/L)	
YORKERS CREEK CATCHMENT																				
DGV	No	-	90-110	-	30-350	30-350	6.5-8	-	2-25	0.027	0.0008	0.0006	0.00001	0.001	0.004	0.3	0.001	1.2	0.00006	
LOR	-	-	-	-	-	-	-	-	0.1	0.01	0.001	0.0001	0.001	0.001	0.002	0.05	0.001	0.001	0.0001	
Dec - May SSGV	-	-	89.6	8.35	31	24	6.79	94.6	9	0.36	0.003	0.00002	0.00001	0.002	0.002	0.41	0.001	0.005	0.00003	
June - Nov SSGV	-	-	88.7	10.2	27.9	20.5	6.61	106.1	7.87	0.32	0.0003	0.00002	0.00001	0.0002	0.002	0.23	0.001	0.003	0.00003	
NZG-IS	Mar-24	No	9.6	80.2	9.13	64.2	45.3	7.45	31.1	0.1	0.14	0.00015	0.00001	0.000005	0.0001	0.001	0.18	0.0005	0.004	0.000015
	Apr-24	No	6.4	84.9	-	67.1	-	7.38	-	0.96	0.03	-	0.0001	0.001	0.001	0.002	0.08	0.001	0.006	0.0001
	May-24	No	3.9	85.8	-	66.6	-	6.68	-	0.2	0.04	0.001	0.0001	0.001	0.001	0.004	0.07	0.001	0.007	0.0001
	Jun-24	No	4.4	82.7	-	64.1	-	8.14	-	0.89	0.04	0.001	0.0001	0.001	0.001	0.002	0.07	0.001	0.005	0.0001
	Jul-24	No	3.7	83.9	-	34.8	-	7.44	-	13.66	0.2	0.001	0.0001	0.001	0.001	0.002	0.18	0.001	0.004	0.0001
	Aug-24	No	7.7	84.4	-	28.9	-	6.95	-	15.47	0.44	0.001	0.0001	0.001	0.001	0.002	0.31	0.001	0.008	0.0001
	Sep-24	No	8.2	84.6	-	38.2	-	7.32	-	2.02	0.06	0.001	0.0001	0.001	0.001	0.002	0.08	0.001	0.004	0.0001
	Oct-24	No	11.1	84.5	-	39.6	-	7.47	-	5.3	0.08	0.001	0.0001	0.001	0.001	0.002	0.11	0.001	0.008	0.0001
	Nov-24	No	12.4	82.2	9.6	32.4	57	7.29	276	1.4	0.04	0.001	0.0001	0.001	0.001	0.002	0.06	0.001	0.005	0.0001
	Dec-24	No	17.3	84.8	9.2	32.8	52	7.30	304	3.79	0.04	0.001	0.0001	0.001	0.001	0.002	0.06	0.001	0.001	0.0001
	Jan-25	No	13.6	75.2	9.3	42.7	72	7.40	208	4.83	0.02	0.001	0.0001	0.001	0.001	0.005	0.05	0.001	0.004	0.0001
	Feb-25	No	19	87.1	9.3	16.6	75	7.42	176	2.72	0.07	0.001	0.0001	0.001	0.001	0.002	0.09	0.001	0.004	0.0001
	Mar-25	No	13.6	84.1	9.6	17.4	78	7.75	165	1.91	0.03	0.001	0.0001	0.001	0.001	0.002	0.07	0.001	0.005	0.0001
	Apr-25	No	9	78.4	10.7	16.6	75	8.24	177	2.03	0.05	0.001	0.0001	0.001	0.001	0.002	0.1	0.001	0.007	0.0001
	May-25	No	3.7	80.3	-	16.4	9.7	7.71	117.1	1.78	0.02	0.001	0.0001	0.001	0.001	0.002	0.05	0.001	0.004	0.0001
	Jun-25	No	5.5	83.5	-	5.1	5.1	8.47	114.1	4.66	0.06	0.001	0.0001	0.001	0.001	0.002	0.14	0.001	0.006	0.0001
	Jul-25	No	5.7	81.2	-	14.8	5.1	7.97	169.7	9.32	0.18	0.001	0.0001	0.001	0.001	0.002	0.15	0.001	0.003	0.0001
	Aug-25	No	8.8	89.4	-	12.1	8.4	7.10	250.3	23.99	0.12	0.001	0.0001	0.001	0.001	0.002	0.08	0.001	0.004	0.0001
	Sep-25	No	7.2	87.9	-	48.4	31.9	6.80	126.6	2.68	0.04	0.001	0.0001	0.001	0.001	0.002	0.06	0.001	0.004	0.0001
	Oct-25	No	10.1	39.9	-	65.1	46.6	7.06	152.3	3.28	0.08	0.001	0.0001	0.001	0.001	0.002	0.07	0.001	0.004	0.0001
	Nov-25	No	17.5	67.8	-	31.1	26.7	6.71	133.7	1.81	0.08	0.001	0.0002	0.001	0.509	0.002	0.08	0.013	0.006	0.0001
	Dec-25	No	11.5	69.2	-	101.2	75	7.41	142.2	5.55	0.04	0.001	0.0001	0.001	0.001	0.002	0.07	0.001	0.025	0.0001
	Jan-26	No	19.8	83.1	-	81.6	73.4	7.43	154.9	7.56	0.03	0.001	0.0001	0.001	0.001	0.002	0.05	0.001	0.007	0.0001
	Feb-26	No	12.8	76.8	-	106.0	81.2	8.29	127.9	5.29	0.03	0.001	0.0001	0.001	0.001	0.002	0.05	0.001	0.008	0.0001
YK-IS	Mar-24	No	11.4	78.0	8.53	35	25.9	6.70	41.1	21.44	0.48	0.00015	0.00001	0.000005	0.001	0.001	0.4	0.0005	0.018	0.000015
	Apr-24	No	6.8	80.7	-	36.5	-	7.04	-	12.37	0.09	0.001	0.0001	0.001	0.001	0.002	0.15	0.001	0.016	0.0001
	May-24	No	4.7	82.7	-	35.8	-	6.43	-	0.2	0.06	0.001	0.0001	0.001	0.001	0.004	0.1	0.001	0.015	0.0001
	Jun-24	No	3.9	83.1	-	35.1	-	7.88	-	7.99	0.08	0.001	0.0001	0.001	0.001	0.002	0.15	0.001	0.010	0.0001
	Jul-24	No	3.2	82.8	-	32.5	-	7.00	-	11.9	0.31	0.001	0.0001	0.001	0.001	0.002	0.25	0.001	0.008	0.0001
	Aug-24	No	7.2	81.3	-	23.5	-	6.70	-	25.12	0.67	0.001	0.0001	0.001	0.001	0.002	0.46	0.001	0.015	0.0001
	Sep-24	No	9.3	83.4	-	23.8	-	7.41	-	6.24	0.09	0.001	0.0001	0.001	0.001	0.002	0.13	0.001	0.009	0.0001
	Oct-24	No	13.7	86.3	-	23.7	-	7.83	-	3.1	0.07	0.001	0.0001	0.001	0.001	0.002	0.06	0.001	0.004	0.0001
	Nov-24	No	14.7	83.3	9.3	27.7	32	7.17	279	4.6	0.06	0.001	0.0001	0.001	0.001	0.002	0.12	0.001	0.016	0.0001
	Dec-24	No	18.4	80.2	8.7	21.4	35	7.15	256	10.86	0.08	0.001	0.0001	0.001	0.001	0.002	0.16	0.001	0.017	0.0001
	Jan-25	No	16.1	69.0	8.7	25.7	43	7.09	232	1.98	0.01	0.001	0.0001	0.001	0.001	0.002	0.12	0.001	0.051	0.0001
	Feb-25	No	21	73.5	8.8	9.1	40	6.61	175	9.85	0.46	0.001	0.0001	0.001	0.001	0.002	0.46	0.001	0.036	0.0001
	Mar-25	No	17.6	71.4	8.8	10.5	45	6.77	161	13.54	0.02	0.001	0.0001	0.001	0.001	0.002	0.19	0.001	0.059	0.0001
	Apr-25	Yes	11.9	65.4	9.7	10.9	49	6.93	183	7.27	0.07	0.001	0.0001	0.001	0.001	0.002	0.19	0.001	0.036	0.0001
	May-25	No	4.9	70.3	-	9.7	6	7.21	15.8	5.62	0.08	0.001	0.0001	0.001	0.001	0.002	0.18	0.001	0.021	0.0001
	Jun-25	No	5.9	84.9	-	8.9	5.6	8.07	110.3	13.6	0.14	0.001	0.0001	0.001	0.001	0.002	0.25	0.001	0.01	0.0001
	Jul-25	No	5.7	81.2	-	7.9	5	7.97	169.7	9.32	0.26	0.001	0.0001	0.001	0.001	0.002	0.2	0.001	0.004	0.0001
	Aug-25	No	6.3	84.1	-	12.2	7.8	7.90	252.8	8.58	0.18	0.001	0.0001	0.001	0.001	0.002	0.14	0.001	0.006	0.0001
	Sep-25	No	7	84.2	-	30.6	20.1	7.00	122.5	7.52	0.1	0.001	0.0001	0.001	0.001	0.002	0.12	0.001	0.006	0.0001
	Oct-25	No	11	41.0	-	39.1	28.6	6.61	151.6	5.67	0.13	0.001	0.0001	0.001	0.001	0.002	0.14	0.001	0.009	0.0001
	Nov-25	No	17.2	67.7	-	15.7	N/A	6.18	N/A	6.52	0.3	0.001	0.0001	0.001	0.154	0.002	0.23	0.002	0.017	0.0001
	Dec-25	No	17.2	67.7	-	15.7	35.8	6.90	143.9	8.09	0.14	0.001	0.0001	0.001	0.001	0.002	0.23	0.001	0.025	0.0001
	Jan-26	Yes	24.1	78.8	-	53.6	52.7	6.69	159.5	21.83	0.09	0.001	0.0001	0.001	0.001	0.002	0.34	0.001	0.087	0.0001
	Feb-26	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-

Reference Site exceeds SSGV
Impact Site Result exceeds SSGV or DGV
italics Result exceeds the Limit of Reporting

Parameter	Dissolved Ni (mg/L)	TN (mg/L)	TP (mg/L)	Dissolved Ag (mg/L)	Dissolved Zn (mg/L)	Ammonia (mg/L)	Nitrogen Oxides (mg/L)	Reactive Phosphorus (mg/L)	Total Hardness (mg/L) (CaCO3)	Total Kjedaahl Nitrogen (mg/L) (TKN)	TDS (mg/L)	TSS (mg/L)	Total Al (mg/L)	Total As (mg/L)	Total Cd (mg/L)	Total Cr (mg/L)	Total Cu (mg/L)	Total Pb (mg/L)	Total Mn (mg/L)	Total Ni (mg/L)	Total Ag (mg/L)	Total Zn (mg/L)	Total Fe (mg/L)	Total Hg (mg/L)
YORKERS CREEK CATCHMENT																								
DGV	0.008	0.25	0.02	0.00002	0.0024	0.013	0.015	0.015	-	-	-	0.2	0.027	0.0008	0.0006	0.00001	0.001	0.001	1.2	0.008	0.00002	0.0024	0.3	0.00006
LOR	0.001	0.1	0.01	0.001	0.005	0.010	0.010	0.01	1	0.1	10	1	0.01	0.001	0.0001	0.001	0.001	0.001	0.001	0.001	0.001	0.005	0.05	0.0001
Dec - May SSGV	0.001	0.2	0.02	0.00002	0.002	0.013	0.015	0.02	1	0.1	30	3												
June - Nov SSGV	0.001	0.2	0.02	0.00002	0.002	0.013	0.015	0.02	7	0.2	10	0.2												
NZG-IS	0.0005	0.1	0.01	0.00001	0.002	0.050	0.05	0.005	10	0.1	22	0.1												
Mar-24	0.001	0.1	0.02	0.001	0.005	0.010	0.01	-	23	0.01	-	6	0.04	0.001	0.0001	0.001	0.001	0.001	0.012	0.001	0.001	0.005	0.24	0.0001
Apr-24	0.001	0.2	0.06	0.001	0.007	0.010	0.03	0.01	23	0.2	60	5	0.06	0.001	0.0001	0.001	0.001	0.001	0.021	0.001	0.001	0.005	0.35	0.0001
May-24	0.001	0.2	0.01	0.001	0.005	0.010	0.01	0.01	23	0.2	38	20	0.12	0.001	0.0001	0.001	0.001	0.001	0.037	0.001	0.001	0.005	0.67	0.0001
Jun-24	0.001	0.2	0.04	0.001	0.005	0.010	0.04	0.01	12	0.2	52	8	0.22	0.001	0.0001	0.001	0.001	0.001	0.009	0.001	0.001	0.005	0.26	0.0001
Jul-24	0.001	0.4	0.04	0.001	0.005	0.010	0.01	0.01	12	0.4	44	19	0.92	0.001	0.0001	0.001	0.001	0.001	0.023	0.001	0.001	0.005	0.85	0.0001
Aug-24	0.001	0.1	0.04	0.001	0.005	0.010	0.01	0.01	21	0.1	41	3	0.07	0.001	0.0001	0.001	0.001	0.001	0.006	0.001	0.001	0.005	0.15	0.0001
Sep-24	0.001	0.3	0.03	0.001	0.005	0.020	0.07	0.01	12	0.2	26	3	0.17	0.001	0.0001	0.001	0.001	0.001	0.01	0.002	0.001	0.005	0.27	0.0001
Oct-24	0.001	0.1	0.04	0.001	0.005	0.010	0.01	0.01	21	0.1	60	1	0.11	0.001	0.0001	0.001	0.001	0.001	0.006	0.001	0.001	0.005	0.14	0.0001
Nov-24	0.001	0.2	0.01	0.001	0.005	0.010	0.01	0.01	21	0.2	50	1	0.09	0.001	0.0001	0.001	0.001	0.001	0.007	0.001	0.001	0.005	0.16	0.0001
Dec-24	0.001	0.4	0.02	0.001	0.005	0.070	0.4	0.01	26	0.4	74	4	0.06	0.001	0.0001	0.001	0.001	0.001	0.008	0.001	0.001	0.005	0.16	0.0001
Jan-25	0.001	0.2	0.04	0.001	0.005	0.030	0.01	0.01	30	0.2	64	2	0.07	0.001	0.0001	0.001	0.001	0.001	0.007	0.001	0.001	0.005	0.14	0.0001
Feb-25	0.001	0.2	0.02	0.001	0.005	0.010	0.17	0.02	32	0.1	66	2	0.11	0.001	0.0001	0.001	0.001	0.001	0.007	0.001	0.001	0.005	0.18	0.0001
Mar-25	0.001	0.2	0.04	0.001	0.005	0.020	0.01	0.01	30	0.2	58	1	0.04	0.001	0.0001	0.001	0.001	0.001	0.006	0.001	0.001	0.005	0.12	0.0001
Apr-25	0.001	0.1	0.02	0.001	0.005	0.010	0.01	0.02	30	0.1	54	1	0.11	0.001	0.0001	0.001	0.005	0.001	0.008	0.001	0.001	0.011	0.16	0.0001
May-25	0.001	0.1	0.02	0.001	0.005	0.010	0.01	0.01	23	0.1	85	1	0.14	0.001	0.0001	0.001	0.001	0.001	0.005	0.001	0.001	0.005	0.18	0.0001
Jun-25	0.001	0.2	0.03	0.001	0.005	0.020	0.01	0.01	12	0.2	31	4	0.21	0.001	0.0001	0.001	0.001	0.001	0.006	0.001	0.001	0.005	0.21	0.0001
Jul-25	0.001	0.1	0.05	0.001	0.005	0.010	0.01	0.01	21	0.1	43	1	0.2	0.001	0.0001	0.001	0.001	0.001	0.006	0.001	0.001	0.005	0.17	0.0001
Aug-25	0.001	0.2	0.03	0.001	0.005	0.010	0.01	0.01	18	0.2	57	1	0.16	0.001	0.0001	0.001	0.001	0.001	0.006	0.001	0.001	0.005	0.18	0.0001
Sep-25	0.001	0.1	0.02	0.001	0.005	0.010	0.01	0.01	21	0.1	28	3	0.15	0.001	0.0001	0.001	0.001	0.001	0.007	0.001	0.001	0.005	0.17	0.0001
Oct-25	0.001	0.2	0.02	0.001	0.005	0.010	0.01	0.01	23	0.2	57	1	0.13	0.001	0.0001	0.001	0.001	0.001	0.008	0.001	0.0001	0.005	0.18	0.0001
Nov-25	0.001	0.3	0.07	0.001	0.005	0.010	0.01	0.01	23	0.3	84	42	0.43	0.001	0.0001	0.001	0.001	0.001	0.025	0.001	0.001	0.005	0.68	0.0001
Dec-25	0.001	0.03	0.04	0.001	0.005	0.010	0.03	0.01	26	0.2	47	18	0.33	0.001	0.0001	0.001	0.001	0.001	0.021	0.001	0.001	0.01	0.47	0.0001
Jan-26	0.001	0.4	0.02	0.001	0.031	0.280	0.1	0.01	32	0.3	56	1	0.05	0.001	0.0001	0.001	0.001	0.001	0.012	0.001	0.001	0.023	0.11	0.0001
Feb-26	0.001	0.4	0.02	0.001	0.031	0.280	0.1	0.01	32	0.3	56	1	0.05	0.001	0.0001	0.001	0.001	0.001	0.012	0.001	0.001	0.023	0.11	0.0001
YK-IS	0.0005	0.1	0.01	0.00001	0.004	0.050	0.05	0.005	1	0.1	21	1												
Mar-24	0.001	0.3	0.02	0.001	0.005	0.010	0.06	-	12	0.06	-	13	0.15	0.001	0.0001	0.001	0.001	0.001	0.024	0.001	0.001	0.005	0.52	0.0001
Apr-24	0.001	0.2	0.03	0.001	0.005	0.010	0.05	0.01	12	0.1	48	5	0.04	0.001	0.0001	0.001	0.001	0.001	0.014	0.001	0.001	0.005	0.16	0.0001
May-24	0.001	0.3	0.03	0.001	0.005	0.010	0.06	0.01	9	0.2	19	6	0.32	0.001	0.0001	0.001	0.001	0.001	0.014	0.001	0.001	0.005	0.42	0.0001
Jun-24	0.001	0.3	0.07	0.001	0.009	0.010	0.01	0.01	9	0.3	52	7	0.8	0.001	0.0001	0.001	0.001	0.001	0.015	0.001	0.001	0.005	0.62	0.0001
Jul-24	0.001	0.4	0.04	0.001	0.005	0.030	0.01	0.01	9	0.4	62	15	1.22	0.001	0.0001	0.003	0.001	0.001	0.026	0.001	0.001	0.005	0.99	0.0001
Aug-24	0.002	0.4	0.04	0.001	0.005	0.020	0.01	0.01	9	0.2	26	4	0.16	0.001	0.0001	0.001	0.001	0.001	0.012	0.001	0.001	0.005	0.26	0.0001
Sep-24	0.001	0.2	0.06	0.001	0.005	0.010	0.01	0.01	21	0.2	40	4	0.14	0.001	0.0001	0.001	0.001	0.001	0.006	0.001	0.001	0.005	0.23	0.0001
Oct-24	0.001	0.1	0.04	0.001	0.01	0.010	0.01	0.01	9	0.1	42	3	0.31	0.001	0.0001	0.001	0.001	0.001	0.022	0.001	0.001	0.005	0.39	0.0001
Nov-24	0.001	0.2	0.03	0.001	0.005	0.020	0.02	0.01	12	0.2	40	6	0.59	0.001	0.0001	0.001	0.001	0.001	0.026	0.001	0.001	0.005	0.55	0.0001
Dec-24	0.001	0.2	0.02	0.001	0.008	0.020	0.01	0.02	14	0.2	59	3	0.07	0.001	0.0001	0.001	0.001	0.001	0.055	0.001	0.001	0.005	0.61	0.0001
Jan-25	0.001	0.4	0.07	0.001	0.005	0.020	0.02	0.01	12	0.4	42	5	1.44	0.001	0.0001	0.002	0.001	0.001	0.048	0.001	0.001	0.005	1.31	0.0001
Feb-25	0.001	0.2	0.03	0.001	0.005	0.010	0.01	0.01	7	0.2	41	13	0.25	0.001	0.0001	0.001	0.001	0.001	0.054	0.001	0.001	0.005	0.74	0.0001
Mar-25	0.001	0.2	0.02	0.001	0.005	0.020	0.04	0.01	21	0.2	37	4	0.15	0.001	0.0001	0.001	0.001	0.001	0.095	0.001	0.001	0.005	0.88	0.0001
Apr-25	0.001	0.1	0.03	0.001	0.005	0.010	0.01	0.01	14	0.1	33	1	0.15	0.001	0.0001	0.001	0.001	0.001	0.027	0.001	0.001	0.005	0.58	0.0001
May-25	0.001	0.2	0.04	0.001	0.005	0.020	0.01	0.01	12	0.2	90	5	0.28	0.001	0.0001	0.001	0.001	0.001	0.011	0.001	0.001	0.005	0.38	0.0001
Jun-25	0.001	0.3	0.06	0.001	0.005	0.040	0.01	0.01	5	0.3	27	4	0.26	0.001	0.0001	0.001	0.001	0.001	0.004	0.001	0.001	0.005	0.2	0.0001
Jul-25	0.001	0.2	0.03	0.0001	0.005	0.070	0.01	0.01	9	0.2	28	5	0.3	0.001	0.0001	0.001								



Appendix D: Calibration Certificate

CALIBRATION CERTIFICATE - WATER

Invoice No: 17218

Equipment Received: YSI ProDSS

Handheld S/N 23H104391

Cable S/N:

Included Items:

SENSOR CALIBRATION DETAILS

	Pre Calibration	Post Calibration	Accuracy	Pass	Fail
Temp	Factory	Calibrated	+/- 0.2C	<input checked="" type="checkbox"/>	<input type="checkbox"/>
pH	4.1	pH 4.00	+/- 0.2	<input checked="" type="checkbox"/>	<input type="checkbox"/>
pH	7	pH 7.00	+/- 0.2	<input checked="" type="checkbox"/>	<input type="checkbox"/>
ORP	220	225.3mV@24.3	+/- 30mV	<input checked="" type="checkbox"/>	<input type="checkbox"/>
Conductivity <input type="checkbox"/>	12950uS/cm	12900uS/cm	+/- 0.5%	<input checked="" type="checkbox"/>	<input type="checkbox"/>
DO <input type="checkbox"/>	98%	100% @763.3	+/- 2%	<input checked="" type="checkbox"/>	<input type="checkbox"/>
Turbidity	0	0 FNU	+/- 0.3 FNU	<input checked="" type="checkbox"/>	<input type="checkbox"/>
Turbidity	118	124 FNU	+/- 20 FNU	<input checked="" type="checkbox"/>	<input type="checkbox"/>
			+/-	<input type="checkbox"/>	<input type="checkbox"/>
			+/-	<input type="checkbox"/>	<input type="checkbox"/>
			+/-	<input type="checkbox"/>	<input type="checkbox"/>

Findings/ Recommendations /Comments:

- 1/ DO cap and calibration cup seal replaced.
- 2/ Firmware version upgraded.
- 3/ Calibrated.
- 4/

This is to certify that where possible, this instrument has been calibrated in accordance with the manufacturer's calibration procedure as recommended in the instrument service manual.

Regards,

Navid Black

 Equipment Specialist
 ECO Environmental Holdings

06-Nov-2025